



A SunCam online continuing education course

MBBR Wastewater Treatment Processes

by


Harlan H. Bengtson, PhD, P.E.



1. Introduction

The Moving Bed Biofilm Reactor (MBBR) wastewater treatment process is a relatively recent addition in the wastewater treatment field. It was developed in Norway in the 1980's and is now in use in many countries throughout the world. It is an attached growth process, but is similar to activated sludge in some ways also. It uses plastic carriers to provide a surface on which biofilm grows. The plastic carriers are kept suspended in the aeration tank by an aerator for an aerobic process or by mechanical mixing for an anoxic or anaerobic process. The plastic carriers are kept in the system by a sieve at the outlet of the tank. There is no need for sludge recycle in an MBBR process and the required reactor size is typically significantly smaller than for an activated sludge process treating the same wastewater flow, or for other common attached growth processes like the trickling filter or RBC. The MBBR process can be used for BOD removal, nitrification and/or denitrification. This course includes background information about the MBBR process and a description of a commonly used design approach, along with several worked examples illustrating the calculations.

A sample spreadsheet for making MBBR process design calculations is included with this course. Coverage of spreadsheet use for MBBR process design calculations is discussed in the course and illustrated with example calculations.

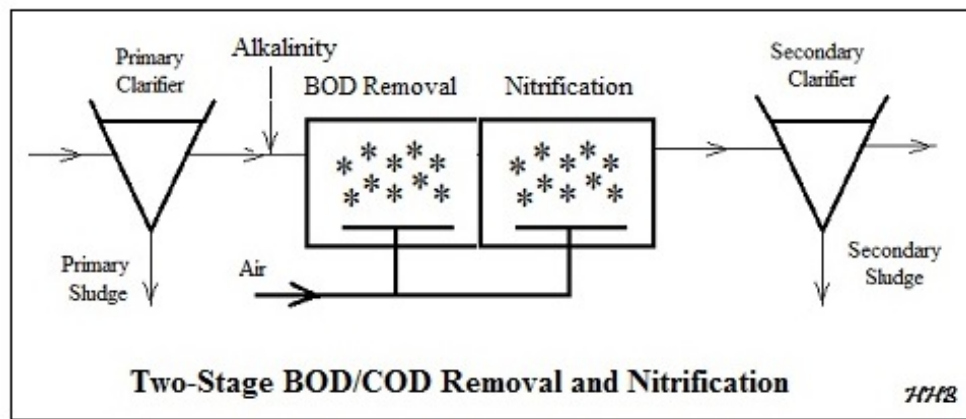



Your Course Title Here
A SunCam online continuing education course

2. Learning Objectives

At the conclusion of this course, the student will

- Know the differences between attached growth and suspended growth biological wastewater treatment processes
- Be familiar with the general configuration and components of an MBBR wastewater treatment process
- Be able to name the six MBBR process configurations discussed in this course
- Be able to calculate the loading rate of a wastewater constituent to an MBBR process (in lb/day and g/day) for specified wastewater flow rate and constituent concentration
- Be able to calculate the required carrier surface area for an MBBR wastewater treatment process for specified SALR and loading rate
- Be able to calculate the required MBBR tank volume for specified carrier surface area, carrier specific surface area, and the carrier fill %
- Be able to calculate the liquid volume in an MBBR tank for known tank volume, carrier volume and carrier % void space
- Be able to calculate the BOD, $\text{NH}_3\text{-N}$, or $\text{NO}_3\text{-N}$ removal rate for known values of the surface area removal rate (SARR) and design carrier surface area
- Be able to calculate an estimated effluent BOD, $\text{NH}_3\text{-N}$, or $\text{NO}_3\text{-N}$ concentration based on known values of the appropriate loading rate, estimated removal rate, and design wastewater flow rate
- Be able to use the sample spreadsheet included with the course to make process design calculations for a single stage BOD removal process in either U.S. units or S.I. units.



Your Course Title Here
A SunCam online continuing education course

- Be able to use the sample spreadsheet included with the course to make process design calculations for a single stage nitrification process in either U.S. units or S.I. units.
- Be able to make process design calculations for a post-Anoxic denitrification MBBR process, including required tank sizes, estimated effluent concentrations, alkalinity requirement and carbon source requirement.
- Be able to make process design calculations for a pre-anoxic denitrification MBBR process, including required tank sizes, estimated effluent concentrations, and alkalinity requirements.

3. Topics Covered in this Course

I. General Information about the MBBR Wastewater Treatment Process

- A. Initial Development of the Process
- B. General Description of the Process
- C. The MBBR Media Support Carrier System
- D. MBBR Process Alternatives

II. MBBR Process Design Calculations – BOD Removal and Nitrification

- A. Overview of MBBR Process Design Calculations
- B. Single Stage BOD Removal Process Design Calculations
- C. Single Stage Tertiary Nitrification Design Calculations
- D. Two-Stage BOD Removal Process Design Calculations
- E. Two-Stage BOD Removal/Nitrification Design Calculations

III. MBBR Denitrification Processes

- A. Introduction to MBBR Denitrification Processes
- B. Post-Anoxic Denitrification Process Design Calculations
- C. Pre-Anoxic Denitrification Process Design Calculations

IV. Summary

V. References



Your Course Title Here
A SunCam online continuing education course

4. General Information about the MBBR Wastewater Treatment Process

Initial Development of the Process

The MBBR process for wastewater treatment was invented and initially developed by Professor Hallvard Ødegaard in the late 1980s at the Norwegian University of Science and Technology. Use of this wastewater treatment process has spread rapidly. Per Ødegaard, 2014 (Reference #1 at the end of this course), there were already more than 800 MBBR wastewater treatment plants in more than 50 countries at that time (2014), with about half treating domestic wastewater and about half treating industrial wastewater. At least part of the reason for the interest in the MBBR process is its small footprint in comparison with other biological treatment processes. The tank volume needed for a MBBR process is typically significantly less than that needed for either an activated sludge process or a trickling filter designed to treat the same wastewater flow.

General Description of the Process



The MBBR process is an attached growth biological wastewater treatment process. That is, the microorganisms that carry out the treatment are attached to a solid medium, as in trickling filter or RBC systems. By contrast, in a suspended growth biological wastewater treatment process, like the activated sludge process, the microorganisms that carry out the treatment are kept suspended in the mixed liquor in the aeration tank.

In the conventional attached growth, biological treatment processes, like trickling filter or RBC systems the microorganisms are attached to a medium that is fixed in place and the wastewater being treated flows past the surfaces of the medium with their attached biological growth. In contrast, an MBBR process utilizes small plastic carrier media that are described in more detail in the next section. The MBBR treatment processes typically take place in a tank similar to an activated sludge aeration tank. The carrier media are kept suspended by a diffused air aeration system for an aerobic process or by a mechanical mixing system for an anoxic or anaerobic process, as indicated in figures 1 and 2 below. A sieve is typically used at the tank exit to keep the carrier media in the tank.

Primary clarification is typically used ahead of the MBBR tank. Secondary clarification is also typically used, but there is no recycle activated sludge sent back into the process.



Your Course Title Here
A SunCam online continuing education course

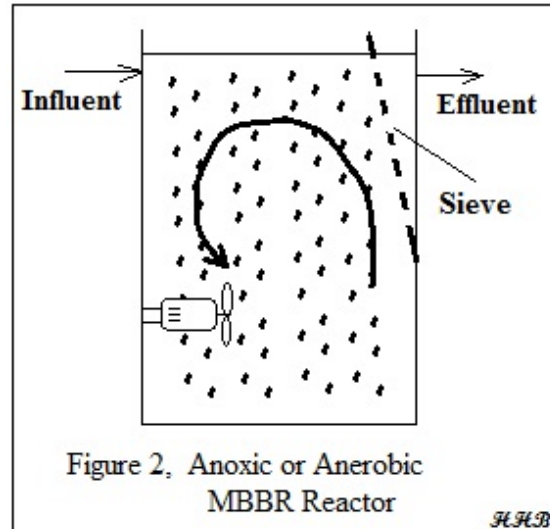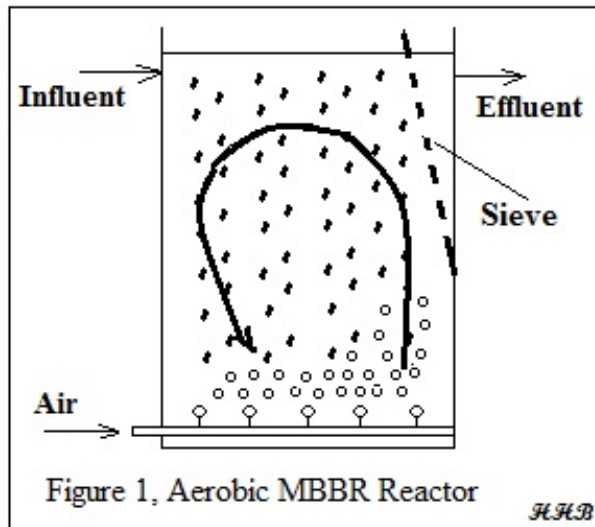

The MBBR Media Support Carrier System

MBBR processes use plastic media support carriers similar to those shown in Figure 3. As shown in the figure, the carrier is typically designed to have a high surface area per unit volume, so that there is a lot of surface area on which the microorganisms attach and grow. Media support carriers like those shown in Figure 3 are available from numerous vendors. Two properties of the carrier are needed for the process design calculations to be described and discussed in this course. Those properties are the specific surface area in m^2/m^3 and the void ratio. The specific surface area of MBBR carriers is typically in the range from 350 to 1200 m^2/m^3 and the void ratio typically ranges from 60% to 90%. Design values for these carrier properties should be obtained from the carrier manufacturer or vendor.



Your Course Title Here
A SunCam online continuing education course



Figure 3, Typical MBBR Media Support Carriers

MBBR Process Alternatives

The MBBR wastewater treatment process is quite flexible and can be used in several different ways. There will be a description and discussion of the following six MBBR process alternatives in this course:

1. Single stage BOD removal
2. Single stage tertiary Nitrification
3. Two-stage BOD removal
4. Two-stage BOD removal and Nitrification
5. Pre-Anoxic BOD removal/Nitrification/Denitrification
6. Post-Anoxic BOD removal/Nitrification/Denitrification

Flow diagrams for these six MBBR process alternatives are shown in the diagram below:



Your Course Title Here
A SunCam online continuing education course

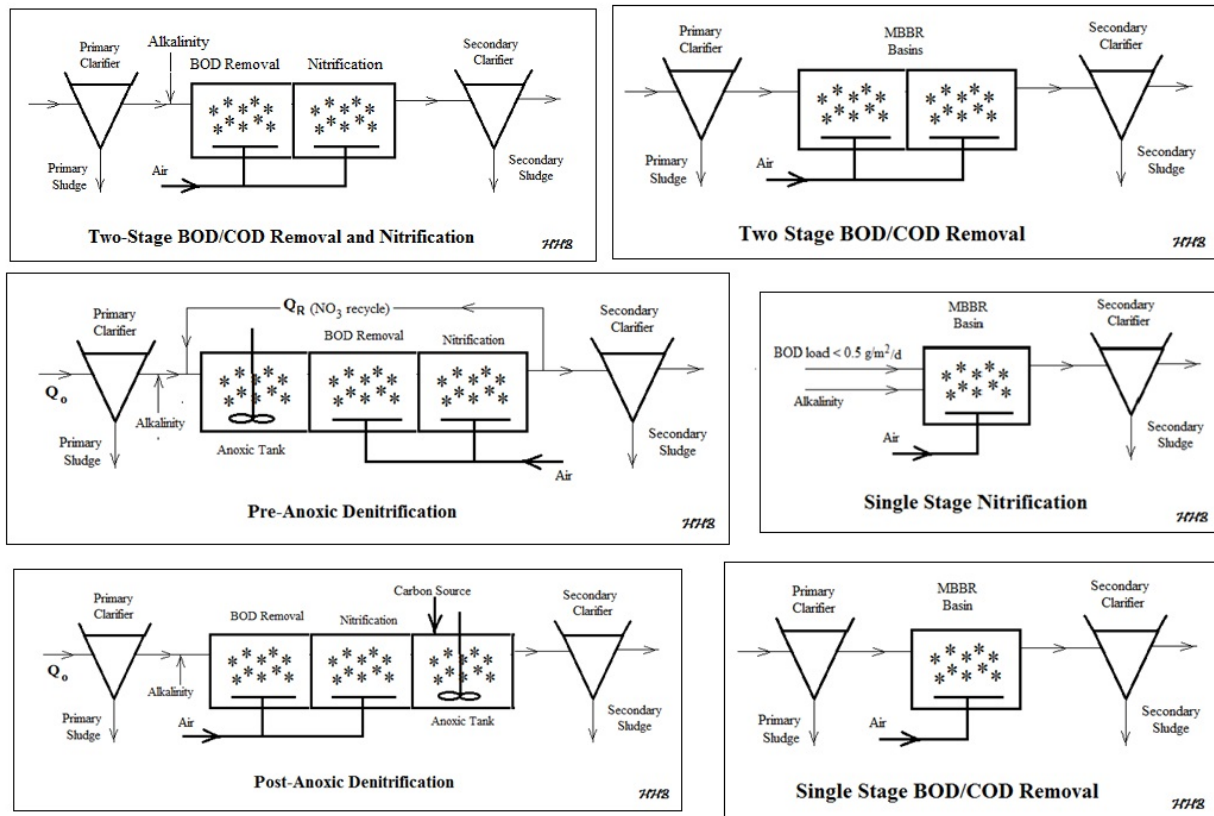


Figure 4. MBBR Wastewater Treatment Process Alternatives

Each of the process alternatives shown in Figure 4 will be covered in more detail later in the course.

5. MBBR Process Design Calculations for BOD Removal and Nitrification

Overview of MBBR Process Design Calculations

The key empirical design parameter used to determine the required MBBR tank size is the surface area loading rate (SALR) in $\text{g}/\text{m}^2/\text{d}$. The g/d in the SALR units refers to the g/d of the parameter being removed and the m^2 in the SALR units refers to the surface



Your Course Title Here
A SunCam online continuing education course

area of the carrier. Thus, for BOD removal the SALR would be g BOD/day entering the MBBR tank per m^2 of carrier surface area. For a nitrification reactor, the SALR would be g $\text{NH}_3\text{-N}$ /day entering the MBBR tank per m^2 of carrier surface area. Finally, for denitrification design, the SALR would be g $\text{NO}_3\text{-N}$ /day per m^2 of carrier surface area.

For any of these processes, a design value for SALR can be used together with design values of wastewater flow rate and BOD, ammonia or nitrate concentration, to calculate the required carrier surface area in the MBBR tank. The design carrier volume can then be calculated using a known value for the carrier specific surface area (m^2/m^3). Finally, a design value for the carrier fill % can be used to calculate the required tank volume.

Process design calculations for each of the process alternatives shown in **Figure 4** will be covered in the next several sections.

Single Stage BOD Removal Process Design Calculations

An MBBR single stage BOD removal process may be used as a free-standing secondary treatment process or as a roughing treatment prior to another secondary treatment process, in some cases to relieve overloading of an existing secondary treatment process. In either case the key design parameter for sizing the MBBR tank is the surface area loading rate (SALR), typically with units of $\text{g}/\text{m}^2/\text{day}$, that is g/day of BOD coming into the MBBR tank per m^2 of carrier surface area. Using design values for wastewater flow rate and BOD concentration entering the MBBR tank, the loading rate in g BOD/day can be calculated. Then dividing BOD loading rate in g/day by the SALR in $\text{g}/\text{m}^2/\text{day}$ gives the required carrier surface area in m^2 . The carrier fill %, carrier specific surface area, and carrier % void space can then be used to calculate the required carrier volume, tank volume and the volume of liquid in the reactor. A typical flow diagram for a single stage MBBR BOD removal process is shown in **Figure 5** below.



Your Course Title Here
A SunCam online continuing education course

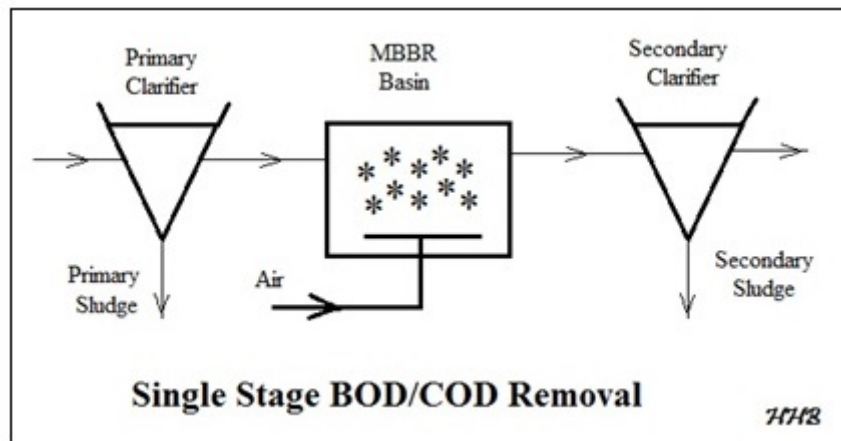


Figure 5. Single Stage MBBR Process for BOD/COD Removal

The equations for making those calculations are as follows:

1. **BOD loading rate** = $Q \cdot S_o \cdot 8.34 \cdot 453.59$

where: **Q** is the wastewater flow rate into the MBBR reactor in MGD

S_o is the BOD concentration in that influent flow in mg/L

8.34 is the conversion factor from mg/L to lb/MG

453.59 is the conversion factor from lb to g

The calculated **BOD loading rate** will be in g/day.

2. **required carrier surface area** = **BOD Loading Rate/SALR**

where: **BOD Loading Rate** is in g/day

SALR is the design surface area loading rate in g/m²/day

The calculated **required carrier surface area** will be in m².

3. **required carrier volume**
= **required carrier surface area/carrier specific surface area**

where: **required carrier surface Area** is in m²

carrier specific surface Area is in m²/m³

The calculated **required carrier volume** will be in m³.

4. **required tank volume** = **required carrier volume/carrier fill %**



Your Course Title Here
A SunCam online continuing education course

where: **required tank volume** will be in the same units as **required carrier volume**.

5. liquid volume in tank = required tank volume
– [required carrier volume(1 – carrier % void space)]

where: all three volumes will be in the same units.

Note that volumes calculated in m³ can be converted to ft³ by multiplying by 3.2808³ ft³/m³.

Although hydraulic retention time (HRT) is not typically used as a primary design parameter for MBBR reactors, it can be calculated at the design wastewater flow rate, if the liquid volume in the tank is known. Also, if a design peak hour factor is specified, then the HRT at peak hourly flow can be calculated as well. The equations for these calculations are as follows:

1. Ave. HRT_{des ave} = liquid vol. in tank*7.48)/[Q*10⁶/(24*60)]

where: **liquid vol. in tank** is in ft³

Q is in MGD

7.48 is the conversion factor for ft³ to gal

10⁶ is the conversion factor for MG to gal

24*60 is the conversion factor for days to min

Ave. HRT_{des ave} will be in min

2. Ave. HRT_{peak hr} = Ave. HRT_{des ave}/Peak Hour Factor

where: **Ave. HRT_{peak hr}** will also be in min

Table 1 on the next page shows typical SALR design values for BOD removal in MBBR reactors. Reference #2 at the end of the course is the source for the values in **Table 1**.



Your Course Title Here
A SunCam online continuing education course

Table 1. Typical Design SALR Values for BOD Removal

Typical Design Values for MBBR reactors at 15°C		
Purpose	Treatment Target % Removal	Design SALR g/m ² -d
BOD Removal		
High Rate	75 - 80 (BOD ₇)	25 (BOD ₇)
Normal Rate	85 - 90 (BOD ₇)	15 (BOD ₇)
Low Rate	90 - 95 (BOD ₇)	7.5 (BOD ₇)

Example #1: A design wastewater flow of 0.2 MGD containing 180 mg/L BOD (in the primary effluent) is to be treated in an MBBR reactor.

- What is the BOD loading rate to the reactor in g/day?
- What is a suitable design SALR to use for a target % removal of 90-95% ?
- If the MBBR carrier has a specific surface area of 500 m²/m³ and design carrier fill % of 40%, what would be the required volume of carrier and required MBBR tank volume?
- If the design carrier % void space is 60%, what would be the volume of liquid in the MBBR reactor.
- If the design peak hour factor is 4, calculate the average hydraulic retention time at design average wastewater flow and at design peak hourly wastewater flow.

Solution:

- The BOD loading rate will be $(0.2 \text{ MGD})(180 \text{ mg/L})(8.34 \text{ lb/MG/mg/L}) = 300.2 \text{ lb/day} = (300.2 \text{ lb/day})(453.59 \text{ g/lb}) = \underline{\underline{136,186 \text{ g BOD/day}}}$
- From Table 1 above, a suitable design SALR value for BOD removal with a target BOD removal of 90–95% would be 7.5 g/m²/day
- Required carrier surface area = $(136,186 \text{ g/day})/(7.5 \text{ g/m}^2/\text{day}) = 18,158 \text{ m}^2$.
Required carrier volume = $18,158 \text{ m}^2/500 \text{ m}^2/\text{m}^3 = 36.316 \text{ m}^3 = (36.316 \text{ m}^3)(3.2808^3 \text{ ft}^3/\text{m}^3) = \underline{\underline{1282 \text{ ft}^3}}$.

For 40% carrier fill: Required tank volume = $1282 \text{ ft}^3/0.40 = \underline{\underline{3206.2 \text{ ft}^3}}$.

- The volume of liquid in the reactor can be calculated as:
tank volume – [carrier volume(1 – void %)], Thus the volume of liquid is:
 $3206.2 - [1282(1 - 0.60)] = \underline{\underline{2693.2 \text{ ft}^3}}$.
- The HRT at design ave ww flow can be calculated as:



Your Course Title Here
A SunCam online continuing education course

$$\text{HRT}_{\text{des ave}} = \text{reactor liquid volume} * 7.48 / [Q * 10^6 / (24 * 60)] = \\ 2693.2 * 7.48 / [0.2 * 10^6 / (24 * 60)] = \underline{\underline{145 \text{ min}}}$$

$$\text{HRT}_{\text{peak hr}} = \text{HRT}_{\text{des ave}} / \text{peak hour factor} = 145 / 4 = \underline{\underline{36 \text{ min}}}$$

Use of an Excel Spreadsheet

The type of calculations just discussed can be done conveniently using an Excel spreadsheet. The screenshot in **Figure 6** below shows a screenshot of worksheet 2 of the course spreadsheet set up to make the calculations just described for **Example #1**. The worksheet shows user input values of the given information entered in the blue cells. The values in the yellow cells are calculated by the spreadsheet using the equations presented and discussed above. The values calculated by the spreadsheet for the following parameters are the same as those shown in the solution to **Example #1** above: i) the BOD loading in g/day, ii) the required tank volume, iii) the liquid volume in the tank, iv) the hydraulic retention time at design average flow, and v) the hydraulic retention time at peak hourly flow.

You may have noticed that there are a few additional calculations in the worksheet screenshot. If the user selected tank shape is "rectangular," the worksheet calculates the tank length and width for the calculated required tank volume. If the user selected tank shape is cylindrical, the worksheet will calculate the tank diameter. These calculations simply use the formulas for the volume of a rectangular tank ($V = L * W * H$) or for the volume of a cylindrical tank ($V = \pi D^2 H / 4$), with user entered values for L:W ratio being used for rectangular tank calculations and the user entered value for the liquid depth in the tank, H, being used by both. The worksheet also calculates an estimated effluent BOD concentration, which is discussed in the next section (after Example #2, which illustrates a solution with S.I. units).



Your Course Title Here
A SunCam online continuing education course

MBBR Process Design Calculations - U.S. units					
Single-Stage Process for BOD Removal					
Instructions: Enter values in blue boxes. Spreadsheet calculates values in yellow boxes					
1. General Inputs					
Data points for SARR/SALR vs SALR					
Design ww Flow Rate, Q =	0.2	MGD	SALR (g/m ² /d):	7.5	15.0
Prim. Effl. BOD, S_o =	180	mg/L	SARR/SALR:	0.925	0.875
Peak Hour Factor =	4	(default values above are based on the table of typical values of % BOD removal vs SALR at the right)			
Design Value of BOD Surface			Slope, SARR/SALR vs SALR:	-0.007	
Area Loading Rate (SALR) =	7.5	g/m ² /d	Intercept, SARR/SALR vs SALR:	0.975	
See information on typical design values for SALR below right.			Est. of SARR/SALR Ratio =	0.925	
			(Surf. Area Removal Rate/Surf. Area Loading Rate) (for SALR value specified at left)		
2. Calculation of Carrier Volume and Required Tank Volume & Dimensions					
Inputs					
			Liquid Depth in Tank =	8	ft
Carrier Spec. Surf. Area =	500	m ² /m ³	Tank L:W ratio =	1.5	
(value from carrier mfr/vendor)		(target L:W - only used if tank is rectangular)			
Design Carrier Fill % =	40%	Click on green box and then on			
(Carrier fill % is typically between 30% and 70%. Lower values are more conservative, allowing future capacity expansion or reduction of SALR by adding more carrier.)		arrow to Select Tank Shape:		rectangular	
			Carrier % Void Space =	60%	
		(from carrier mfr/vendor - only needed to calculate hydraulic detention time)			
Calculations					
BOD Daily Loading =	300.2	lb/day	Calculated Tank Volume =	90.8	m ³
	136186	g/day	=	3206.2	ft ³
			=	23983	gal
Carrier Surf. Area needed =	18158.1	m ²	Calculated Tank Width =	16.3	ft
Calculated Carrier Volume =	36.316	m ³	Calculated Tank Length =	24.5	ft
Tank Liquid Volume =	2693.2	ft ³	Nominal Hydraulic Retention Time at		
			Design Average Flow =	145	min
Estimate of BOD Surface Area			Peak Hourly Flow =	36	min
Removal Rate, SARR =	6.94	g/m ² /d			
Est. of BOD Removal Rate:	125972	g/day	Estimated Effl BOD Conc.:	14	mg/L
	277.7	lb/day	If the estimated Effl. BOD conc. is too high, the design value of SALR (in cell C13) should be reduced.		

Figure 6. Screenshot – Single Stage BOD Removal Calculations – U.S. units



Your Course Title Here
A SunCam online continuing education course

Example #2: (working with S.I. units) Repeat Example #1 if the wastewater flow is specified as 757 m³/d instead of 0.2 MGD. The rest of the given information remains the same. The wastewater flow containing 180 mg/L BOD is to be treated in an MBBR reactor.

- a) What is the BOD loading rate to the reactor in g/day?
- b) What would be a suitable design SALR to use for a target removal of 90-95% ?
- c) If the MBBR carrier has a specific surface area of 500 m²/m³ and design carrier fill % of 40%, what would be the required volume of carrier and required MBBR tank volume?
- d) If the design carrier % void space is 60%, what would be the volume of liquid in the MBBR reactor.
- e) If the design peak hour factor is 4, calculate the average hydraulic retention time at design average wastewater flow and at design peak hourly wastewater flow.

Solution:

- a) The BOD loading rate will be (757 m³/d)(180 g/m³) = **136,260 g BOD/day**
- b) From Table 1 above, a suitable design SALR value for BOD removal with a target BOD removal of 90–95% would be **7.5 g/m²/day**
- c) Required carrier surface area = (136,260 g/day)/(7.5 g/m²/day) = 18,168 m².
- d) The volume of liquid in the reactor can be calculated as:
tank volume – [carrier volume(1 – void %)], Thus the volume of liquid is: 90.8 – [36.34(1 – 0.60)] = **76.3 m³**.
- e) The HRT at design ave ww flow can be calculated as:
HRT_{des ave} = reactor liquid volume/[Q/(24*60)]
= 76.3/[757/(24*60)] = **145 min**

HRT_{peak hr} = HRT_{des ave}/peak hour factor = 145/4 = **36 min**

The Excel spreadsheet screenshot on the next page (from worksheet 3 in the course spreadsheet) shows the spreadsheet solution to Example #2. There are slight differences from the solution with U.S. units due to rounding of the design flow conversion from MGD to m³/s.



Your Course Title Here
A SunCam online continuing education course

MBBR Process Design Calculations - S.I. units					
Single-Stage Process for BOD Removal					
Instructions: Enter values in blue boxes. Spreadsheet calculates values in yellow boxes					
1. General Inputs					
Data points for SARR/SALR vs SALR					
Design ww Flow Rate, Q =	757	m ³ /d	SALR (g/m ² /d):	7.5	15.0
Prim. Effl. BOD, S_o =	180	mg/L	SARR/SALR:	0.925	0.875
Peak Hour Factor =	4		(default values above are based on the table of typical values of % BOD removal vs SALR at the right)		
Design Value of BOD Surface Area Loading Rate (SALR) =	7.5	g/m ² /d	Slope, SARR/SALR vs SALR:	-0.007	
See information on typical design values for SALR below right.			Intercept, SARR/SALR vs SALR:	0.975	
			Est. of SARR/SALR Ratio =	0.925	
			(Surf. Area Removal Rate/Surf. Area Loading Rate) (for SALR value specified at left)		
2. Calculation of Carrier Volume and Required Tank Volume & Dimensions					
Inputs					
Carrier Spec. Surf. Area =	500	m ² /m ³	Liquid Depth in Tank =	2	m
(value from carrier mfr/vendor)			Tank L:W ratio =	1.5	
Design Carrier Fill % =	40%		(target L:W - only used if tank is rectangular)		
(Carrier fill % is typically between 30% and 70%. Lower values are more conservative, allowing future capacity expansion or reduction of SALR by adding more carrier.)			Click on green box and then on arrow to Select Tank Shape:	rectangular	
			Carrier % Void Space =	60%	
			(from carrier mfr/vendor - only needed to calculate hydraulic detention time)		
Calculations					
BOD Daily Loading =	136.3	kg/day	Calculated Tank Volume =	90.8	m ³
	136260	g/day			
Carrier Surf. Area needed =	18168	m ²	Calculated Tank Width =	5.0	m
Calculated Carrier Volume =	36.34	m ³	Calculated Tank Length =	7.5	m
Tank Liquid Volume =	76.3	m ³	Nominal Hydraulic Retention Time at		
			Design Average Flow =	145	min
Estimate of BOD Surface Area Removal Rate, SARR =	6.94	g/m ² /d	Peak Hourly Flow =	36	min
Est. of BOD Removal Rate:	126041	g/day	Calculated Effl BOD Conc.:	14	mg/L
			If the calculated Effl. BOD conc. is too high, the design value of SALR (in cell C13) should be reduced.		

Figure 7. Screenshot – Single Stage BOD Removal Calculations – S.I. units



Your Course Title Here
A SunCam online continuing education course

Estimation of Effluent Concentration

Use of an estimated surface area removal rate (SARR) allows calculation of the estimated effluent concentration of the parameter being removed. That is, for BOD removal, the estimated effluent BOD concentration can be calculated. For nitrification, the estimated effluent ammonia nitrogen concentration can be calculated and for denitrification, the estimated effluent nitrate nitrogen concentration can be calculated.

Based on graphs and tables provided in several of the references at the end of this course, the SARR/SALR ratio for all the different types of MBBR treatment being covered in this course ranges from about 0.8 to nearly 1.0 over the range of SALR values typically used. The SARR/SALR ratio is nearly one at very low SALR values and decreases as the SALR value increases.

The upper right portion of the screenshot on the previous two pages illustrates an approach for estimating a value for the SARR/SALR ratio for a specified design value of SALR. In the four blue cells at the upper right, two sets of values for SARR/SALR and SALR are entered. In this case, they are based on the typical values of % BOD removal vs SALR in Table 1 above. In the yellow cells below those entries, the slope and intercept of a SARR/SALR vs SALR straight line are calculated using the Excel SLOPE and INTERCEPT functions. Then the SARR/SALR ratio is calculated for the specified design value of SALR.

Note that the ratio SARR/SALR is equal to the % BOD removal expressed as a fraction. This can be shown as follows:

$$\text{BOD removal rate in g/day} = (\text{SARR in g/m}^2/\text{d})(\text{Carrier Surf. Area in m}^2)$$

$$\text{BOD rate into plant in g/day} = (\text{SALR in g/m}^2/\text{d})(\text{Carrier Surf. Area in m}^2)$$

$$\% \text{ BOD removal} = (\text{BOD removal rate/BOD rate into plant}) * 100\%$$

$$= (100\%)(\text{SARR} * \text{Carrier Surf Area}) / (\text{SALR} * \text{Carrier Surf Area})$$

$$= (\text{SARR/SALR}) 100\%$$

Note that the value of **0.925** for the **SARR/SALR** ratio at **SALR = 7.5 g/m²/d** was obtained from **Table 1** above as the midpoint of the 90-95% estimated % BOD removal for **SALR = 7.5 g/m²/d**. Similarly, the value of **0.875** for the **SARR/SALR** ratio at **SALR = 15 g/m²/d** was obtained from **Table 1** above as the midpoint of the 85-90% estimated % BOD removal for **SALR = 15 g/m²/d**.



Your Course Title Here
A SunCam online continuing education course

At the bottom of the screenshot worksheet, the estimated value of the surface area removal rate (SARR) is calculated. It is used to calculate an estimated BOD removal rate in g BOD/day and lb BOD/day. Then an estimate of the effluent BOD concentration is calculated. The equations for these calculations are as follows:

1. estimated SARR = (calculated SARR/SALR)(design value of SALR)
2. estimated BOD removal rate = (estimated SARR)(carrier surface area)
3. estimated effluent BOD conc.
= [(BOD loading rate - estimated BOD removal rate)/Q_o]/8.34

The calculations are exactly the same for S.I. units except that the 8.34 conversion factor isn't needed in the last calculation.

Example #3: Calculate the estimated effluent BOD concentration for the wastewater flow described in **Example #1** being treated in the MBBR reactor sized in **Example #1**.

Solution: The solution is included in the **Figure 6** and **Figure 7** spreadsheet screenshots that were used for the solutions to **Example #1** and **Example #2** above. The pair of points for **SARR/SALR vs SALR** that were discussed above and are shown on the **Figure 6** and **Figure 7** screenshots lead to the following values for the slope and intercept for the **SARR/SALR vs SALR** line: **Slope = -0.007, Intercept = 0.975.**

Thus, the estimated **SARR/SALR** ratio for the given **SALR** value of **7.5 g/m²/d** would be calculated as: **SARR/SALR = - (0.007)(7.5) + 0.975 = 0.925**

The SARR value can be calculated as:

$$\text{SARR} = (\text{SARR/SALR})(\text{SALR}) = (0.925)(7.5) = 6.94 \text{ g/m}^2/\text{d}$$

Then, the estimated BOD removal rate can be calculated as:

$$\text{est BOD removal rate} = (\text{est SARR})(\text{carrier surface area})$$

$$= (6.94 \text{ g/m}^2/\text{d})(18,158.1 \text{ m}^2) = 125,972 \text{ g/d} = 125,772/453.59 \text{ lb/day}$$

$$\text{est BOD removal rate} = 277.7 \text{ lb/day} \quad (\text{or } 126,041 \text{ g/day})$$

The estimated effluent BOD concentration can then be calculated from the equation:



Your Course Title Here
A SunCam online continuing education course

est effluent BOD conc. = $[(\text{BOD loading rate} - \text{est BOD removal rate})/Q_0]/8.34$

Substituting calculated and given values:

Est. effluent BOD conc. = $[(300.2 - 277.7)/0.2]/8.34 = 14 \text{ mg/L}$

Note that this **14 mg/L** value for the **estimated effluent BOD** concentration is shown near the bottom of the **Figure 6** and **Figure 7** spreadsheet screenshots.

6. Single Stage Nitrification Process Design Calculations

A single stage MBBR nitrification process would typically be used as a tertiary treatment process following some type of secondary treatment that reduced the BOD to a suitable level. A typical flow diagram for a single stage MBBR process for nitrification is shown in **Figure 8** below. Note that alkalinity is used in the nitrification process, so alkalinity addition is typically required. As shown on the diagram, the influent BOD level should be low enough so that the BOD load to the nitrification process is less than 0.5 g/m²/day. Higher BOD loading to an MBBR nitrification reactor results in too many BOD removing microorganisms and not enough nitrification microorganisms.

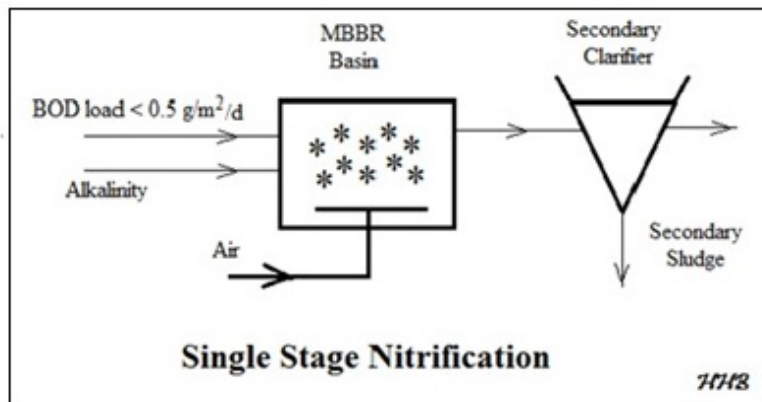


Figure 8. Single Stage MBBR Process for Nitrification



Your Course Title Here
A SunCam online continuing education course

The process design calculations for this single stage MBBR process are similar to those described above for a single stage BOD removal MBBR process, but the design SALR value for nitrification can be calculated rather than using an empirical value from a table of typical values, as was done for BOD removal. The design SALR can be calculated using a kinetic model for the surface area removal rate (SARR) as a function of the dissolved oxygen concentration in the MBBR reactor and the bulk liquid ammonia nitrogen concentration, which is equal to the effluent ammonia nitrogen concentration assuming completely mixed conditions in the MBBR tank.

The kinetic model to be discussed here is from Metcalf and Eddy (2014), Figure 9-25 [attributed to Odegaard (2006)] and Equation 9-48. This figure and equation will now be shown and discussed briefly. **Figure 9** below was prepared based on Metcalf and Eddy's Figure 9-25 and their Equation 9-48 (shown below). Note that the figure and equation are for operation at 15°C. Correction of the SARR and SALR for some other operational temperature can be done with the equation: $SARR_T = SARR_{15}\theta^{(T-15)}$ where T is the design operational temperature in °C. From Salvetti, et.al (2006): $\theta = 1.058$ for D.O. limited conditions and $\theta = 1.098$ if ammonia nitrogen concentration is the limiting factor.

Equation 9-48 from Metcalf and Eddy (2014) is:

$$SARR = [N_e / (2.2 + N_e)] * 3.3 \quad , \quad N_e = \text{effluent ammonia N conc.}$$

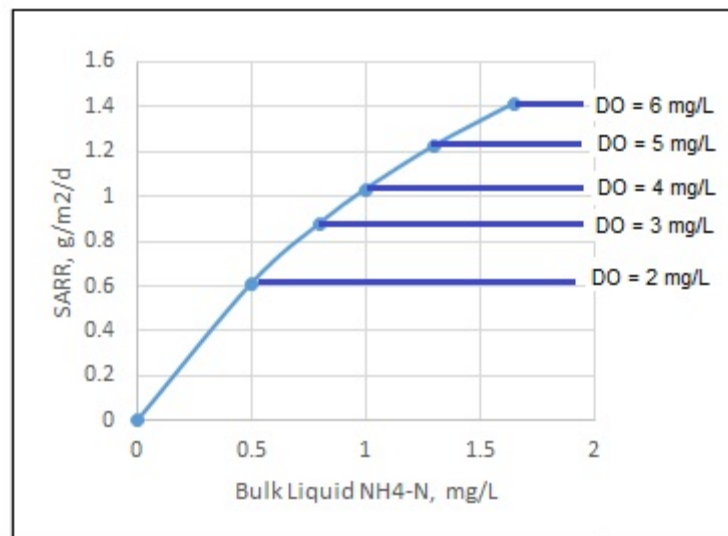


Figure 9. Adapted from Metcalf & Eddy (2014), Fig 9-25



Your Course Title Here
A SunCam online continuing education course

The horizontal lines in **Figure 9** show the nitrification **SARR** under DO limiting conditions for each of the DO levels shown. The **SARR** will be DO limited when the **NH₃-N** concentration is above the value at the left end of the horizontal line for each D.O. level. When the **NH₃-N** concentration is below that value, then the **SARR** is ammonia concentration limited and the **SARR** is a function of the effluent **NH₃-N** concentration per the equation: **SARR = [N_e/(2.2 + N_e)]*3.3.**

As shown previously for BOD removal, **SALR/SARR = % BOD removal**. Similarly, for nitrification, **SALR/SARR = % NH₃-N removal**. After the **SARR** has been determined, the **SALR** can be calculated as: **SALR = SARR/% removal**.

The maximum **SARR** for each of the D.O. levels shown in **Figure 11** are shown in **Table 2** below, along with the ammonia nitrogen concentration above which the **SARR** will be at that maximum value.

Table 2. Values of **SARR_{max}** and **NH₃-N_e @ SARR_{max}**

D.O.	SARR _{max}	min NH ₃ -N _e @ SARR _{max}
mg/L	g/m ² /d	mg/L
2	0.61	0.5
3	0.88	0.8
4	1.03	1
5	1.23	1.3
6	1.41	1.65

The process design calculations for single stage nitrification are illustrated in the next example.

Example #4: A design secondary effluent flow of 0.2 MGD has the following characteristics: 15 mg/L BOD, 35 mg/L TKN, and alkalinity of 140 mg/L as CaCO₃. This flow is to be treated in a single stage nitrification MBBR reactor. The target effluent NH₃-N is 3.3 mg/L. The dissolved oxygen is to be maintained at 3.0 mg/L in the MBBR reactor. The design minimum wastewater temperature is to be 45°F.



Your Course Title Here
A SunCam online continuing education course

- Determine an appropriate $\text{NH}_3\text{-N}$ surface area loading rate (SALR) for this nitrification process, in $\text{g NH}_3\text{-N/m}^2/\text{d}$.
- What is the $\text{NH}_3\text{-N}$ loading rate to the reactor in g/day ?
- If the MBBR carrier has a specific surface area of $500 \text{ m}^2/\text{m}^3$ and design carrier fill % of 40%, what would be the required volume of carrier and required MBBR tank volume?
- Calculate the BOD surface area loading rate (SALR) to ensure that it is less than $0.5 \text{ g BOD/m}^2/\text{day}$.
- If the design carrier % void space is 60%, what would be the volume of liquid in the MBBR reactor.
- If the design peak hour factor is 4, calculate the average hydraulic retention time at design average wastewater flow and at design peak hourly wastewater flow.
- Calculate the alkalinity requirement in lb/day as CaCO_3 and in lb/day NaHCO_3 .

Solution:

The solution, as calculated with the course spreadsheet, is shown in the screenshots in **Figure 10** and **Figure 11** below. A summary of the calculations is given here:

- The D.O. limited **SARR** can be obtained as **SARR_{max}** from **Table 2** for the specified D.O level, and the minimum ammonia nitrogen concentration for that **SARR** value can be obtained from the same table. The values from **Table 2**, for a D.O. of 3.0 are: **SARR_{max} = 0.88 g/m²/d** and minimum **NH₃-N_e** for **SARR_{max} = 0.80 mg/L**. (in the worksheet shown in the **Figure 12** screenshot, these two values are obtained using Excel's VLOOKUP function from a table like **Table 2**, above that is on the worksheet.

The **SARR** for the design D.O. and ammonia nitrogen removal at 15°C will then be equal to **SARR_{max}** if the target effluent ammonia nitrogen concentration is greater than the 0.80 mg/L value determined above. If the target effluent ammonia nitrogen concentration is less than 0.80 mg/L, then the SARR needs to be calculated using Metcalf & Eddy's equation 9-48. In this case, the target effluent $\text{NH}_3\text{-N}$ of 3.3 mg/L is greater than 0.8 mg/L, so the SARR at 15°C is 0.88 $\text{g/m}^2/\text{d}$.

The design value for the SARR at the design minimum wastewater temperature can then be calculated as: $\text{SARR}_T = \text{SARR}_{15^\circ\text{C}}^{\theta(T - 15)}$, where the WW temperature must be in °C. Since this case has D.O. limited conditions, $\theta = 1.058$. Carrying out this calculations gives: **design value of SALR = 0.63 g/m²/d**.



Your Course Title Here
A SunCam online continuing education course

- b) The Nitrate loading rate will be $(0.2 \text{ MGD})(35 \text{ mg/L})(8.34 \text{ lb/MG/mg/L}) = 58.4 \text{ lb/day}$
 $\text{lb/day} = (58.4 \text{ lb/day})(453.59 \text{ g/lb}) = \underline{\mathbf{26,481 \text{ g BOD/day}}}$
- c) Required carrier surface area = $(26,481 \text{ g/day})/(0.63 \text{ g/m}^2\text{/day}) = 42,255 \text{ m}^2$.
- Required carrier volume = $42,255 \text{ m}^2/500 \text{ m}^2/\text{m}^3 = 84.51 \text{ m}^3 = (84.51 \text{ m}^3)(3.2808^3 \text{ ft}^3/\text{m}^3) = \underline{\mathbf{2984 \text{ ft}^3}} \quad (\mathbf{84.51 \text{ m}^3})$
- For 40% carrier fill: Required tank volume = $2984 \text{ ft}^3/0.40 = \underline{\mathbf{7461 \text{ ft}^3}} \quad (\mathbf{211.3 \text{ m}^3})$
- d) The BOD SALR will be $(0.2 \text{ MGD})(15 \text{ mg/L})(8.34 \text{ lb/MG/mg/L})/(42255 \text{ m}^2) = \underline{\mathbf{0.27 \text{ g/m}^2\text{/day}}}$ (Note that this is less than $0.5 \text{ g/m}^2\text{/day}$ as required.)
- e) The volume of liquid in the reactor can be calculated as:
 tank volume – [carrier volume(1 – void %)], Thus the volume of liquid is: $7461 - [2984(1 - 0.60)] = \underline{\mathbf{6267 \text{ ft}^3}} \quad (\mathbf{177.5 \text{ m}^3})$
- f) The HRT at design ave ww flow can be calculated as:
 $\text{HRT}_{\text{des ave}} = \text{reactor liquid volume} * 7.48 / [Q * 10^6 / (24 * 60)] = 6267 * 7.48 / [0.2 * 10^6 / (24 * 60)] = \underline{\mathbf{338 \text{ min}}}$
- $\text{HRT}_{\text{peak hr}} = \text{HRT}_{\text{des ave}} / \text{peak hour factor} = 338 / 4 = \underline{\mathbf{84 \text{ min}}}$
- g) Calculation of the alkalinity requirement is shown in the **Figure 11** spreadsheet screenshot below. Using the equivalent weight of CaCO_3 as 50, the equivalent weight of NaHCO_3 as 84, the alkalinity use for nitrification as $7.14 \text{ g CaCO}_3/\text{g NH}_3\text{-N}$ and the target effluent alkalinity as $80 \text{ mg/L as CaCO}_3$, give the calculated alkalinity requirement as $189.9 \text{ mg/L as CaCO}_3$. The rate of alkalinity addition needed can then be calculated as: $(0.2 \text{ MGD})(189.9 \text{ mg/L}) * 8.34 = \underline{\mathbf{316.8 \text{ lb/day as CaCO}_3}} \quad (\mathbf{143.7 \text{ kg/day as CaCO}_3})$. Multiplying this by the ratio of the equivalent weight of NaHCO_3 to the equivalent weight of CaCO_3 gives the daily NaHCO_3 requirement as **532.1 lb/day NaHCO₃**. **(241.4 kg/d as NaHCO₃)**.

The S.I. version of the spreadsheet can be used with the 0.2 MGD wastewater flow rate specified as $757 \text{ m}^3/\text{d}$. All of the other inputs remain as given above. The answers in S.I. units (if different than the U.S. solution) are shown in parentheses at the end of each part of the solution above.



Your Course Title Here
A SunCam online continuing education course

MBBR Process Design Calculations - U.S. units					
Single Stage Tertiary Nitrification Process					
Instructions: Enter values in blue boxes. Spreadsheet calculates values in yellow boxes					
1. General Inputs					
		Peak Hour Factor =		4	
		Target Effl NH ₄ -N Conc, NH₄-N_e =		3.3	mg/L
Design ww Flow Rate, Q =	0.2	MGD	Min Design Temp., T =	45	°F
Influent NH ₄ -N Conc. =	35	mg/L			
Influent BOD, S_o =	15	mg/L	Click on cell H10 and on arrow to select D.O Conc.		
Prim. Effl. Alkalinity =	140	mg/L as CaCO ₃	D.O Conc. in Reactor =	3.0	mg/L
2. Preliminary Calculations - Design SALR value					
% NH ₄ -N removal =	91%		NH ₄ -N _e @ SARR _{max} =	0.80	mg/L
Maximum SARR =	0.88	g/m ² /d	SARR @ NH ₄ -N _e , 15°C, SARR₁₅ =	0.88	g/m ² /d
			SARR @ NH ₄ -N _e , T °C, SARR_T =	0.57	g/m ² /d
SARR Temp. Coeff, θ =	1.058				
			Design Value for SALR =	0.63	g/m ² /d
3. Calculation of Carrier Volume and Required Tank Volume & Dimensions					
Inputs					
Carrier Spec. Surf. Area =	500	m ² /m ³	Liquid Depth in Tank =	8	ft
(value from carrier mfr/vendor)			Tank L:W ratio =	1.5	
			(target L:W - only used if tank is rectangular)		
Design Carrier Fill % =	40%		Click on green box and then on		
(Carrier fill % is typically between 30% and 70%. Lower values are more conservative, allowing future capacity expansion or reduction of SALR by adding more carrier.)			arrow to Select Tank Shape:		rectangular
			Carrier % Void Space =	60%	
			(from carrier mfr/vendor - only needed to calculate hydraulic detention time)		
Calculations					
NH ₃ -N Daily Loading =	58.4	lb/day	Calculated Tank Volume =	211.3	m ³
	26481	g/day	=	7461.1	ft ³
Carrier Surf. Area needed =	42255	m ²	=	55809	gal
Calculated Carrier Volume =	84.510	m ³	Calculated Tank Width =	24.9	ft
Tank Liquid Volume =	6267.4	ft ³	Calculated Tank Length =	37.4	ft
			Nominal Hydraulic Retention Time at		
			Design Average Flow =	338	min
BOD Surf. Loading Rate (SALR):	0.27	g/m ² /d	Peak Hourly Flow =	84	min
(should be < 0.5 g/m ² /d in order to achieve a good nitrification rate)					

Fig. 10. Screenshot of MBBR Process Design Calculations – Single Stage Nitrification



Your Course Title Here
A SunCam online continuing education course

5. Alkalinity Requirement			
Input:			
Target Effluent Alkalinity =		80	mg/L
Constants needed for Calculations:			
Equiv Wt. of CaCO_3 =	50	g/equiv.	Equiv Wt. of NaHCO_3 = 84 g/equiv.
Alkalinity used for Nitrification =	7.14	g CaCO_3 /g $\text{NH}_3\text{-N}$	
Calculations			
Alkalinity to be added =	189.9	mg/L as CaCO_3	
Daily Alkalinity Requirement =	316.8	lb/day as CaCO_3	
For sodium bicarbonate use to add alkalinity:			
Daily NaHCO_3 Requirement =	532.1	lb/day NaHCO_3	

Figure 11. Screenshot of MBBR Process Design Calculations – Alkalinity Requirements

7. Two-Stage BOD Removal Process Design Calculations

A two-stage MBBR BOD removal process may be used instead of a single stage process. In this case, a high SALR “roughing” treatment will typically be used for the first stage and a lower SALR will typically be used for the second stage. This will result in less total tank volume needed for a two-stage process than for a single stage process. Also, a two-stage MBBR process can typically achieve a lower effluent BOD concentration than a single stage MBBR process. A typical flow diagram for a two-stage MBBR process for BOD removal is shown in **Figure 12** below. Note that an intermediate clarifier is not typically used between stages.



Your Course Title Here
A SunCam online continuing education course

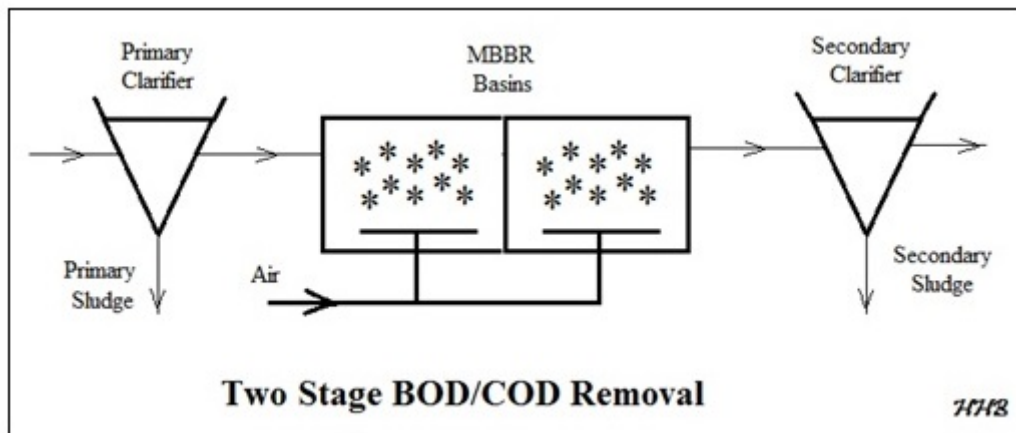


Figure 12. Two-Stage MBBR Process for BOD/COD Removal

The process design calculations for each stage of a two-stage MBBR process are essentially the same as shown for the single stage process above in section 5. These calculations are illustrated in **Example #5**.

Example #5: A design wastewater flow of 0.2 MGD (757 m³/d) containing 180 mg/L BOD (in the primary effluent) is to be treated for BOD removal in a two stage MBBR reactor. The design SALR for the first stage is to be 25 g/m²/d and the design SALR for the second stage is to be 7.5 g/m²/d.

- a) For the first stage calculate each of the following:
 - i) The BOD loading
 - ii) The required carrier volume for a carrier with specific surface area of 600 m²/m³
 - iii) The required MBBR tank volume for a design carrier fill % of 40%
 - iv) The volume of liquid in the MBBR reactor for design carrier % void space of 60%.
 - v) The average hydraulic retention time at design average wastewater flow and at design peak hourly flow if the design peak hour factor is 4.
 - vi) The estimated effluent BOD concentration from the first stage.
- b) Calculate the same parameters for the second stage.

Solution: The solution as calculated with an Excel spreadsheet is shown in the spreadsheet screenshot in **Figure 13** and **Figure 14**. **Figure 13**, which is the top part of



Your Course Title Here
A SunCam online continuing education course

the spreadsheet, shows primarily the user input values. It also includes the calculation of the slope and intercept for the SARR/SALR vs SALR equation and the calculation of the estimated SARR for each stage. These calculations and the resulting SARR/SALR values are the same as those discussed above for the single-stage BOD removal MBBR process. The resulting values for SARR/SALR are **0.775** for the first stage with SALR = 25, and **0.925** for the second stage with SALR = 7.5.

The S.I. version of the spreadsheet can be used with the 0.2 MGD wastewater flow rate specified as 757 m³/d. All of the other inputs remain as given above. The answers in S.I. units (if different than the U.S. solution) are shown in parentheses at the end of each part of the solution below

Figure 14 is the bottom part of the spreadsheet and shows the calculated values as follows.

a) For the first stage:

i) The BOD loading rate will be $(0.2 \text{ MGD})(180 \text{ mg/L})(8.34 \text{ lb/MG/mg/L}) = 300.2 \text{ lb/day} = (300.2 \text{ lb/day})(453.59 \text{ g/lb}) = \underline{\underline{136,186 \text{ g BOD/day}}}$

ii) Required carrier surface area = $(136,186 \text{ g/day})/(25 \text{ g/m}^2/\text{day}) = 5447.4 \text{ m}^2$.

Required carrier volume = $5447.4 \text{ m}^2/600 \text{ m}^2/\text{m}^3 = 9.079 \text{ m}^3 = (9.079 \text{ m}^3)(3.2808^3 \text{ ft}^3/\text{m}^3) = \underline{\underline{384.7 \text{ ft}^3}} \quad (10.895 \text{ m}^3)$

iii) For 40% carrier fill: Required tank volume = $384.7 \text{ ft}^3/0.40 = \underline{\underline{961.9 \text{ ft}^3}}$.

iv) The volume of liquid in the reactor can be calculated as:

tank volume – [carrier volume(1 – void %)], Thus the volume of liquid is: $961.9 - [384.7(1 - 0.60)] = \underline{\underline{808 \text{ ft}^3}} \quad (22.88 \text{ m}^3)$

v) The HRT at design ave ww flow can be calculated as:

$\text{HRT}_{\text{des ave}} = \text{reactor liquid volume} * 7.48 / [Q * 10^6 / (24 * 60)] = 808 * 7.48 / [0.2 * 10^6 / (24 * 60)] = \underline{\underline{44 \text{ min}}}$

$\text{HRT}_{\text{peak hr}} = \text{HRT}_{\text{des ave}} / \text{peak hour factor} = 44/4 = \underline{\underline{11 \text{ min}}}$

Calculation of the estimated effluent BOD concentration from the first stage as shown above for the single stage process gives a value of **41 mg/L**.



Your Course Title Here
A SunCam online continuing education course

MBBR Process Design Calculations - U.S. units			
Two-Stage Process for BOD Removal			
Instructions: Enter values in blue boxes. Spreadsheet calculates values in yellow boxes			
I. Wastewater Parameter Inputs			
1. Parameters for Both First and Second Stage			
Design ww Flow Rate, Q =	0.2	MGD	Peak Hour Factor =
			4
2. Parameters for First Stage:		Data points for SARR/SALR vs SALR	
Prim. Effl. BOD, S_{o1} =	180	mg/L	SALR (g/m ² /d):
			SARR/SALR:
			7.5 25.0
			0.925 0.775
(default values above are based on the table of typical values of % BOD removal vs SALR at the right)			
Design Value of BOD Surface		Slope, SARR/SALR vs SALR:	
Area Loading Rate (SALR) =		Intercept, SARR/SALR vs SALR:	
	25	g/m ² /d	-0.009
See information on typical design values for SALR below right.			Est. of SARR/SALR Ratio =
			0.775
(Surf. Area Removal Rate/Surf. Area Loading Rate)			
3. Parameters for Second Stage:			
Design Value of BOD Surface		Est. of SARR/SALR Ratio =	
Area Loading Rate (SALR) =		(Surf. Area Removal Rate/Surf. Area Loading Rate)	
	7.5	g/m ² /d	0.925
See information on typical design values for SALR to the right.			
II. Carrier Parameter and Tank Shape Inputs for both First and Second Stages			
Carrier Spec. Surf. Area =		Liquid Depth in Tank =	
(value from carrier mfr/vendor)		Tank L:W ratio =	
	500	m ² /m ³	8 ft
Design Carrier Fill % =		(target L:W - only used if tank is rectangular)	
40%			
(Carrier fill % is typically between 30% and 70%. Lower values are more conservative, allowing future capacity expansion or reduction of SALR by adding more carrier.)		Click on green box and then on arrow to Select Tank Shape:	
		rectangular	
		Carrier % Void Space =	
		60%	
		(from carrier mfr/vendor - only needed to calculate hydraulic detention time)	

Figure 13. Screenshot of MBBR Process Design Calculations – Two-Stage BOD Removal – Part 1



Your Course Title Here
A SunCam online continuing education course

III. Calculation of Carrier Volume and Required Tank Volume & Dimensions						
1. First Stage Calculations (BOD Removal)						
BOD Daily Loading =	300.2	lb/day	Calculated Tank Volume =	27.2	m ³	
	136186	g/day	=	961.9	ft ³	
Carrier Surf. Area needed =	5447.4	m ²	=	7195	gal	
Calculated Carrier Volume =	10.895	m ³	Calculated Tank Width =	9.0	ft	
Tank Liquid Volume =	808.0	ft ³	Calculated Tank Length =	13.4	ft	
Nominal Hydraulic Retention Time at						
Estimate of BOD Surface Area			Design Average Flow =	44	min	
Removal Rate, SARR =	19.38	g/m ² /d	Peak Hourly Flow =	11	min	
Est. of BOD Removal Rate:	105544	g/day				
	232.7	lb/day	Calculated Effl BOD Conc.: (from First Stage)	41	mg/L	
2. Second Stage Calculations (BOD Removal)						
BOD Daily Loading =	67.6	lb/day	Calculated Tank Volume =	20.4	m ³	
	30642	g/day	=	721.4	ft ³	
Carrier Surf. Area needed =	4085.6	m ²	=	5396	gal	
Calculated Carrier Volume =	8.171	m ³	Calculated Tank Width =	7.8	ft	
Tank Liquid Volume =	606.0	ft ³	Calculated Tank Length =	11.6	ft	
Nominal Hydraulic Retention Time at						
Estimate of BOD Surface Area			Design Average Flow =	33	min	
Removal Rate, SARR =	6.94	g/m ² /d	Peak Hourly Flow =	8	min	
Est. of BOD Removal Rate:	28344	g/day				
	62.5	lb/day	Calculated Effl BOD Conc.: (from Second Stage)	3.0	mg/L	
If the calculated Effl. BOD conc. is too high for either stage, the design value of SALR should be reduced for that stage.						

Figure 14. Screenshot of MBBR Process Design Calculations – Two-Stage BOD Removal – Part 2



Your Course Title Here
A SunCam online continuing education course

b) For the second stage:

i) The BOD loading rate will be $(0.2 \text{ MGD})(41 \text{ mg/L})(8.34 \text{ lb/MG/mg/L}) = 67.6 \text{ lb/day}$
 $\text{lb/day} = (67.6 \text{ lb/day})(453.59 \text{ g/lb}) = \underline{\underline{30,642 \text{ g BOD/day}}}$

ii) Required carrier surface area = $(30642 \text{ g/day})/(7.5 \text{ g/m}^2\text{/day}) = 4085.6 \text{ m}^2$.

Required carrier volume = $4085.6 \text{ m}^2/600 \text{ m}^2/\text{m}^3 = 8.171 \text{ m}^3 = (8.171 \text{ m}^3)(3.2808^3 \text{ ft}^3/\text{m}^3) = \underline{\underline{288.6 \text{ ft}^3}}. \quad (\mathbf{8.171 \text{ m}^3})$

iii) For 40% carrier fill: Required tank volume = $288.55 \text{ ft}^3/0.40 = \underline{\underline{721.4 \text{ ft}^3}}. \quad (\mathbf{20.43 \text{ m}^3})$

iv) The volume of liquid in the reactor can be calculated as:
 tank volume – [carrier volume(1 – void %)], Thus the volume of liquid is: $721.4 - [288.6(1 - 0.60)] = \underline{\underline{606 \text{ ft}^3}}. \quad (\mathbf{17.1 \text{ m}^3})$

v) The HRT at design ave ww flow can be calculated as:
 $\text{HRT}_{\text{des ave}} = \text{reactor liquid volume} * 7.48 / [Q * 10^6 / (24 * 60)] = 606 * 7.48 / [0.2 * 10^6 / (24 * 60)] = \underline{\underline{33 \text{ min}}}$

$\text{HRT}_{\text{peak hr}} = \text{HRT}_{\text{des ave}} / \text{peak hour factor} = 44/4 = \underline{\underline{8 \text{ min}}}$

Calculation of the estimated effluent BOD concentration from the second stage as shown above for the single stage process gives a value of **3.0 mg/L**.

Example #6: Compare the MBBR tank volume, carrier surface area, and estimated effluent BOD concentration for the single stage BOD removal process in **Example #1** and the same WW flow and BOD with a two-stage BOD removal process as calculated in **Example #5**.

Solution: The results are summarized below:

	<u>Single Stage Process</u>	<u>Two Stage Process</u>
MBBR Volume:	3206 ft ³	1683 ft ³
Carrier Surf. Area:	18158 m ²	9533 m ²
Est. Effl. BOD:	14 mg/L	3 mg/L



Note that the two-stage process requires only about half of the tank volume and half of the carrier quantity in comparison with the single stage process, while achieving a significantly lower estimated effluent BOD.

8. Two-Stage BOD Removal and Nitrification Process Design Calculations

A two stage MBBR process may also be used to achieve both BOD removal and nitrification. Nitrification with an MBBR process requires a rather low BOD concentration. Thus the first stage for this process is used for BOD removal and the second stage is used for nitrification. A typical flow diagram for a two stage MBBR process for BOD removal and nitrification is shown in **Figure 15** below.

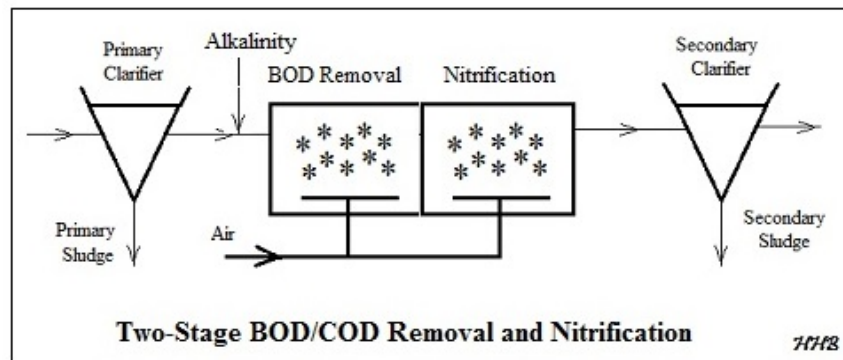


Figure 15. Two-Stage MBBR Process for BOD Removal and Nitrification

Table 3 shows typical design values for the SALR (surface area loading rate) for the BOD removal stage and for the nitrification stage. The source for the values in this table is the Odgaard reference #2 below. The design SALR value for nitrification, however, will be calculated based on the design D.O concentration and the target effluent NH₃-N concentration, as it was for the single-stage nitrification process.



Your Course Title Here
A SunCam online continuing education course

Table 3. Typical Design SALR Values for Nitrification

Typical Design Values for MBBR reactors at 15°C		
Purpose	Treatment Target % Removal	Design SALR g/m ² -d
Nitrification		
BOD removal stage	90 - 95 (BOD ₇)	6.0 (BOD ₇)
Effl. NH ₃ -N > 3 mg/L ²	90 (NH ₃ -N)	1.00 (NH ₃ -N)
Effl. NH ₃ -N < 3 mg/L ²	90 (NH ₃ -N)	0.45 (NH ₃ -N)

The process design calculations for the two-stage BOD Removal/Nitrification process would be essentially the same as those just discussed for the two-stage BOD removal process, with the second stage calculations being like those for the single stage nitrification process.

9. Introduction to MBBR Denitrification Processes

Denitrification Background: In order to carry out denitrification of a wastewater flow (removal of the nitrogen from the wastewater), it is necessary to first nitrify the wastewater, that is, convert the ammonia nitrogen typically present in the influent wastewater to nitrate. As previously noted, nitrification will only take place at a reasonable rate if the BOD level is quite low. Thus, an MBBR denitrification process will need a reactor for BOD removal, one for nitrification, and one for denitrification. The nitrification reactor will always follow the BOD removal reactor, because of the need for a low BOD level in the nitrification reactor. The denitrification reactor may be either before the BOD removal reactor (called pre-anoxic denitrification) or after the nitrification reactor (called post-anoxic denitrification). Flow diagrams for these two denitrification options are shown in **Figure 16** below.



Your Course Title Here
A SunCam online continuing education course

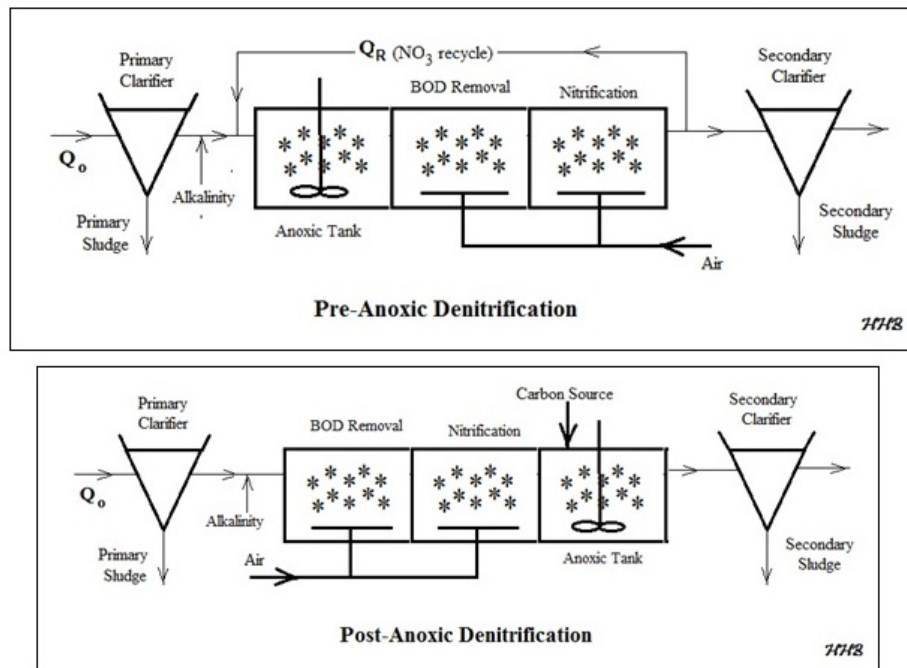


Figure 16. MBBR Denitrification Process Alternatives

A bit more information about the denitrification reactions will be useful for further discussion of these two denitrification options. The denitrification reactions, which convert nitrate ion to nitrogen gas, and hence remove it from the wastewater flow, will take place only in the absence of oxygen, that is, in an anoxic reactor. Also, the denitrification reactions require a carbon source. With these factors in mind the functioning of the pre-anoxic denitrification process and of the post-anoxic denitrification process can be described as follows.

In a pre-anoxic denitrification process, the BOD in the primary effluent wastewater is used as the carbon source for denitrification. In this process, however the primary effluent entering the pre-anoxic reactor still has ammonia nitrogen present rather than the nitrate nitrogen needed for denitrification. A recycle flow of effluent from the nitrification reactor is used to send nitrate nitrogen to the denitrification reactor.

In a post-anoxic denitrification process, the influent to the denitrification reactor comes from the nitrification reactor, so the ammonia nitrogen present in the wastewater influent has been converted to nitrate as required for denitrification. The BOD has also been removed prior to the post anoxic denitrification reactor, however, so an external carbon



Your Course Title Here
A SunCam online continuing education course

source is required for the denitrification reactions. Methanol is a commonly used carbon source.

Choosing between Pre-Anoxic and Post-Anoxic Denitrification: The pre-anoxic denitrification process has the advantage of not requiring an external carbon source and it reduces the BOD load to the BOD removal part of the process because BOD is used in the denitrification reactions. However, the pre-anoxic process requires an influent C/N ratio greater than 4, where C/N is taken to be BOD/TKN, and the post-anoxic process can achieve a more complete nitrogen removal.

From the Odegaard references (#1 and #2 below) suitable criteria for determining whether to use pre- or post-anoxic denitrification are as follows:

1. Pre-anoxic denitrification is suitable if **$C/N \geq 4$**
and **target % Removal of N < 75%**
2. Post-anoxic denitrification should be used if **$C/N < 4$**
or **target % Removal of N > 75%**

10. Post-Anoxic Denitrification Process Design Calculations

Process design of a post-anoxic denitrification MBBR system, requires sizing an MBBR tank for BOD removal, one for nitrification and one for denitrification. For each of these three reactors the calculations for sizing the reactor are as discussed and illustrated with examples above. A typical flow diagram for a post-anoxic denitrification MBBR process is shown in **Figure 17** below.



Your Course Title Here
A SunCam online continuing education course

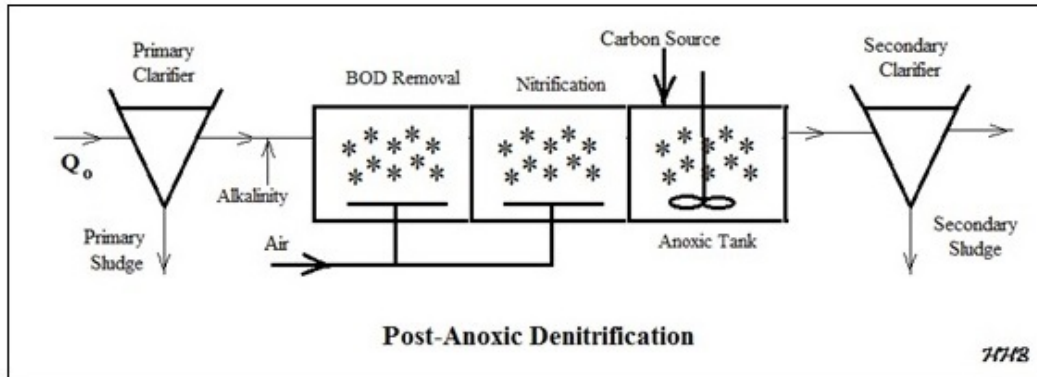


Figure 17. Flow Diagram for Post-Anoxic Denitrification

Example #7: A design wastewater flow of 0.2 MGD containing 180 mg/L BOD, 35 mg/L TKN, and 140 mg/L alkalinity as CaCO_3 (in the primary effluent) is to be treated in a post-anoxic denitrification MBBR process. Carry out the process design for the denitrification stage as described below, using a design SALR of 2 g $\text{NO}_3\text{-N}/\text{m}^2/\text{d}$.

For the third (Denitrification) stage calculate each of the following:

- The nitrate loading
- The required carrier volume for a carrier with specific surface area of $500 \text{ m}^2/\text{m}^3$
- The required MBBR tank volume for a design carrier fill % of 40%
- The volume of liquid in the MBBR reactor for design carrier % void space of 60%.
- The average hydraulic retention time at design average wastewater flow and at design peak hourly flow if the design peak hour factor is 4.
- The alkalinity requirement in lb/day as CaCO_3 and in lb/day NaHCO_3 , for target effluent alkalinity of 80 mg/L as CaCO_3 .
- The methanol requirement in lb/day for methanol use as the carbon source.

Solution: The nitrate loading to the anoxic reactor will be calculated using (primary clarifier TKN conc. – effluent nitrate conc. from nitrification stage) as the nitrate concentration coming into the post anoxic reactor. Thus, the BOD removal reactor and Nitrification reactor must be designed before the post-anoxic denitrification reactor. The results for those two reactors will be presented and briefly discussed first. Then the calculations for the anoxic stage will be presented.



Your Course Title Here
A SunCam online continuing education course

The calculations for the BOD removal stage would be carried out as described in Examples #1 and #3, using 6.0 g BOD/m²/d as the design SALR based on Table 3, rather than the 7.5 g BOD/m²/d used in Examples #1 & #3. The BOD Daily Loading is the same as that calculated in Example #1, 136,186 g/day or 300.2 lb/day. The required tank size is a bit larger because of the lower design SALR used in this case and the calculated effluent BOD concentration is 12 mg/L rather than the 14 mg/L calculated in Example #1 (with the 7.5 value for SALR). The results for the BOD stage calculations are shown in the Figure 18 spreadsheet screenshot below.

The calculations for the Nitrate removal stage would be carried out exactly the same as described in Example #4 for a single stage nitrate removal process with the same wastewater flow rate, influent TKN, and design SALR (0.63 g NH₃-N/m²/d). The results are shown in the Figure 10 spreadsheet screenshot (on page 24), including the specified effluent NH₃-N concentration of 3.3 mg/L from this stage.

The calculations for the post-anoxic denitrification stage are as follows. The S.I. version of the spreadsheet can be used with the 0.2 MGD wastewater flow rate specified as 757 m³/d. All of the other inputs remain as given above. The answers in S.I. units (if different than the U.S. solution) are shown in parentheses at the end of each part of the solution below

- i) The NO₃-N loading rate will be (0.2 MGD)(35 – 3.3 mg/L)(8.34 lb/MG/mg/L) = 52.9 lb/day = (52.9 lb/day)*(453.59 g/lb) = **23,984 g NO₃-N/day**

(Note that 35 mg/L is the primary effluent TKN concentration and 3.3 mg/L is the estimated effluent NH₃-N concentration.)

- ii) Required carrier surface area = (23984 g/day)/(2 g/m²/day) = 11992 m².

$$\begin{aligned} \text{Required carrier volume} &= 11508 \text{ m}^2/500 \text{ m}^2/\text{m}^3 = 23.98 \text{ m}^3 = \\ &= (23.98 \text{ m}^3)(3.2808^3 \text{ ft}^3/\text{m}^3) = \mathbf{846.9 \text{ ft}^3}. \quad \quad \quad (23.98 \text{ m}^3) \end{aligned}$$



Your Course Title Here
A SunCam online continuing education course

III. Carrier and Tank Shape Parameter Inputs for all Three Stages					
Carrier Spec. Surf. Area = (from carrier mfr/vendor)	500	m ² /m ³	Liquid Depth in Tank =	8	ft
			Tank L:W ratio =	1.5	
(target L:W - only used if tank is rectangular)					
Design Carrier Fill % =	40%		Click on green box and then on arrow to Select Tank Shape:		
(Carrier fill % is typically between 30% and 70%. Lower values are more conservative, allowing future capacity expansion or reduction of SALR by adding more carrier.)			rectangular		
			Carrier % Void Space =	60%	
			(from carrier mfr/vendor - only needed to calculate hydraulic detention time)		
IV. Calculation of Carrier Volume and Required Tank Volume & Dimensions					
1. First Stage (BOD Removal) Calculations					
			Required Tank Volume =	113.5	m ³
BOD Daily Loading =	300.2	lb/day		4007.8	ft ³
BOD Daily Loading =	136186	g/day		29978	gal
Carrier Surf. Area needed =	22698	m ²	Calculated Tank Width =	18.3	ft
Calculated Carrier Volume =	45.40	m ³	Calculated Tank Length =	27.4	ft
Tank Liquid Volume =	3366.6	ft ³	Nominal Hydraulic Retention Time at		
			Design Average Flow =	181	min
Estimate of BOD Surface Area			Peak Hourly Flow =	45.3	min
Removal Rate, SARR =	5.61	g/m ² /d	Calculated Effl BOD Conc.:	12	mg/L
Est. of BOD Removal Rate:	127334	g/day	If the calculated Effl. BOD conc. is		
	280.7	lb/day	too high, the design value of SALR (in cell C26) should be reduced.		

Figure 18. Screenshot Post-Anoxic Denitrification Calculations – BOD Removal Stage

- iii) For 40% carrier fill: Required tank volume = $846.9 \text{ ft}^3 / 0.40 = \underline{2117.5 \text{ ft}^3}$.
(59.96 m³)



Your Course Title Here
A SunCam online continuing education course

iv) The volume of liquid in the reactor can be calculated as:
 tank volume – [carrier volume(1 – void %)], Thus the volume of liquid is:
 $2117.5 - [846.9(1 - 0.60)] = \underline{1778.7 \text{ ft}^3}. \quad (50.37 \text{ m}^3)$

v) The HRT at design ave ww flow can be calculated as:
 $\text{HRT}_{\text{des ave}} = \text{reactor liquid volume} * 7.48 / [Q * 10^6 / (24 * 60)] =$
 $1778 * 7.48 / [0.2 * 10^6 / (24 * 60)] = \underline{96 \text{ min}}$

$\text{HRT}_{\text{peak hr}} = \text{HRT}_{\text{des ave}} / \text{peak hour factor} = 96 / 4 = \underline{24 \text{ min}}$

These results are shown in the **Figure 19** spreadsheet screenshot below

vi) Calculation of the alkalinity requirement is shown in the **Figure 20** spreadsheet screenshot below. Note that alkalinity is produced in the denitrification reactions, so less alkalinity addition will be needed with denitrification present. Using the equivalent weight of CaCO_3 as 50, the equivalent weight of NaHCO_3 as 84, the alkalinity use for nitrification as 7.14 g $\text{CaCO}_3/\text{g NH}_3\text{-N}$, the alkalinity produced by denitrification as 3.56 g $\text{CaCO}_3/\text{g NO}_3\text{-H}$, and the target effluent alkalinity as 80 mg/L as CaCO_3 , give the calculated alkalinity requirement as 81.9 mg/L as CaCO_3 . The rate of alkalinity addition needed can then be calculated as: $(0.2 \text{ MGD})(81.9 \text{ mg/L}) * 8.34 = \underline{136.7 \text{ lb/day as CaCO}_3}. \quad (61.9 \text{ kg/day as CaCO}_3)$. Multiplying this by the ratio of the equivalent weight of NaHCO_3 to the equivalent weight of CaCO_3 gives the daily NaHCO_3 requirement as 229.6 lb/day NaHCO_3 . **(104.1 kg/day as NaHCO_3)**

vii) Calculation of the methanol requirement in lb/day is shown at the bottom of the **Figure 20** screenshot. As shown, the calculations use the constants, 4.6 lb COD/lb $\text{NO}_3\text{-N}$ removed and 1.5 lb COD/lb Methanol. The required methanol dosage is then calculated as: $4.6/1.5 = 3.1 \text{ lb methanol /lb NO}_3\text{-N removed}$. The methanol requirement in lb/day is then equal to 3.1 times the previously calculated $\text{NO}_3\text{-N}$ removal rate of 44.9 lb/day, or 137.8 lb/day. **(62.5 kg/day)**



Your Course Title Here
A SunCam online continuing education course

III. Carrier and Tank Shape Parameter Inputs for all Three Stages					
Carrier Spec. Surf. Area = (from carrier mfr/vendor)	500	m ² /m ³	Click on green box and then on arrow to Select Tank Shape:		rectangular
Liquid Depth in Tank =	8	ft	Carrier % Void Space =	60%	
Tank L:W ratio =	1.5		(from carrier mfr/vendor - only needed to calculate hydraulic detention time)		
(target L:W - only used if tank is rectangular)					
IV. Calculation of Carrier Volume and Required Tank Volume & Dimensions					
3. Third Stage (Post-Anoxic) Calculations					
Design Carrier Fill % =	40%	(for third stage)	Required Tank Volume =	59.96	m ³
NO ₃ -N Daily Loading =	52.9	lb/day	Required Tank Volume =	2117.5	ft ³
NO ₃ -N Daily Loading =	23984	g/day		15839	gal
Carrier Surf. Area needed =	11992	m ²	Calculated Tank Width =	13.3	ft
Calculated Carrier Volume =	23.98	m ³	Calculated Tank Length =	19.9	ft
Tank Liquid Volume =	1778.7	ft ³	Nominal Hydraulic Retention Time at		
Estimate of NO ₃ -N Surface Area			Design Average Flow =	96	min
Removal Rate, SARR =	1.70	g/m ² /d	Peak Hourly Flow =	24	min
Est. of NO ₃ -N Removal Rate:	20386	g/day	Calculated Effl NO ₃ -N Conc.:	4.8	mg/L
	44.9	lb/day	If the calculated Effl. NO ₃ -N conc. is too high, the design value of SALR (in cell C36) should be reduced.		
1st stage tank volume -					
3rd stage tank volume =	53.5				
To make the 3rd stage tank volume the same as the first stage tank volume, use Excel's Goal Seek process to set cell C101 equal to zero by changing the value in cell C90.					

Figure 19. Post-Anoxic Denitrification Calculations – Anoxic Stage – Part 1



Your Course Title Here
A SunCam online continuing education course

<u>VII. Calculation of Alkalinity Requirements</u>			
<u>Input:</u>	Target Effluent Alkalinity =	80	mg/L as CaCO ₃
<u>Constants needed for Calculations:</u>			
Equiv Wt. of CaCO ₃ =	50	g/equiv.	Equiv Wt. of NaHCO ₃ = 84 g/equiv.
Alkalinity used for Nitrification =	7.14	g CaCO ₃ /g NH ₃ -N removed	
Alkalinity produced by Denitrification =	3.57	g CaCO ₃ /g NO ₃ -N removed	
<u>Calculations</u>			
Alkalinity to be added =	81.9	mg/L as CaCO ₃	
Daily Alkalinity Requirement =	136.7	lb/day as CaCO ₃	
<u>For sodium bicarbonate use to add alkalinity:</u>			
Daily NaHCO ₃ Requirement =	229.6	lb/day NaHCO ₃	
<u>VII. Calculation of Carbon Source Requirements</u>			
<u>Inputs:</u>	Carbon Source to be used:	Methanol	
	COD Requirement for Denitrification =	4.6	lb COD/lb NO ₃ -N removed
	COD Content of Carbon Source =	1.5	lb COD/lb Carbon Source
<u>Calculations</u>			
Carbon Source Dosage =	3.1	lb Carbon Source/lb NO ₃ -N removed	
Daily Carbon Source Requirement =	137.8	lb/day	62.51788514

Figure 20. Post-Anoxic Denitrification Calculations – Anoxic Stage – Part 2



Your Course Title Here
A SunCam online continuing education course

11. Pre-Anoxic Denitrification Process Design Calculations

The process design calculations for pre-anoxic denitrification, are similar to those just discussed for a post-anoxic denitrification process. The graph shown in **Figure 21** (prepared using values from a similar graph in Rusten and Paulsrud's presentation in Ref #4 below) will be used to obtain values for SARR/SALR vs SALR for the pre-anoxic denitrification stage.


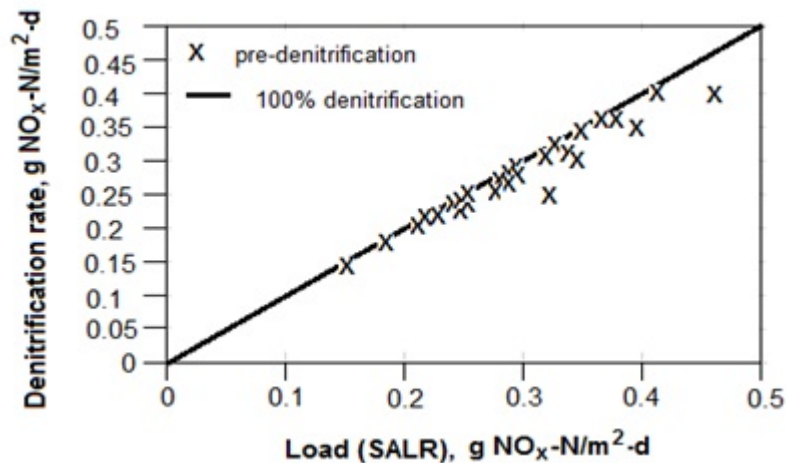


Figure 21. SARR/SALR vs SALR for Pre-Anoxic Denitrification

A typical flow diagram for a pre-anoxic denitrification MBBR process is shown in **Figure 22** below. As discussed previously for a post-anoxic denitrification MBBR system, process design of a pre-anoxic denitrification MBBR system also requires sizing an MBBR tank for BOD removal, one for nitrification and one for denitrification. Process design for the nitrification stage is essentially the same as just discussed for the post-anoxic denitrification process.



Your Course Title Here
A SunCam online continuing education course

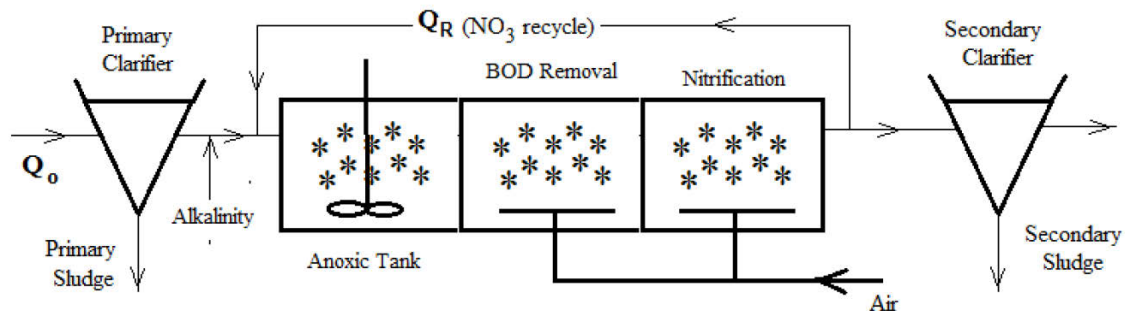

Pre-Anoxic Denitrification

HHZ

Figure 22. MBBR Flow Diagram for Pre-Anoxic Denitrification

Process Design results for the BOD removal stage will be a bit different from those for the BOD removal stage in the post-anoxic process, because some of the incoming BOD will be used as the carbon source in the denitrification reactions in the pre-anoxic tank. For the pre-anoxic process, the BOD loading rate (in lb/day) should be calculated as:

$$\text{BOD Daily Loading} = (Q_o \cdot S_o \cdot 8.34) - (0.67 \cdot (20/7) \cdot \text{NO}_3\text{-N removal rate})$$

The second term is the estimated BOD removal rate in the anoxic reactor through its use in the denitrification reactions. This gives a lower BOD loading rate than that for the post-anoxic process with the same primary clarifier effluent coming in. Hence the required tank size for BOD removal will be smaller for the pre-anoxic process.

The main difference from the post-anoxic denitrification process design calculations is for the denitrification stage, which will be discussed and illustrated with **Example #8** calculations below.

Example #8: Carry out the process design as described below for the denitrification stage of a pre-anoxic denitrification process with the wastewater flow and concentrations given in Examples #1, #2, and #3. [0.2 MGD containing 180 mg/L BOD and 35 mg/L TKN (in the primary effluent)]. Consider that the primary effluent alkalinity is 140 mg/L as $CaCO_3$ and the design SALR for the denitrification stage is to be 0.9 g $NO_3\text{-N}/m^2/d$. The nitrification stage was designed for an effluent $NH_4\text{-N}$ concentration of 3.3 mg/L.

For the first stage (Denitrification) calculate each of the following:



Your Course Title Here
A SunCam online continuing education course

- i) The nitrate loading
- ii) The required carrier volume for a carrier with specific surface area of 500 m²/m³
- iii) The required MBBR tank volume for a design carrier fill % of 40%
- iv) The volume of liquid in the MBBR reactor for design carrier % void space of 60%.
- v) The average hydraulic retention time at design average wastewater flow and at design peak hourly flow if the design peak hour factor is 4.
- vi) The required NO₃-N recycle rate in order to achieve a target NO₃-N concentration of 9 mg/L.
- vii) The alkalinity requirement in lb/day as CaCO₃ and in lb/day NaHCO₃, for target effluent alkalinity of 80 mg/L as CaCO₃.

Solution - The solution is shown in **Figure 23**, **Figure 24**, and **Figure 25**, which are screenshots of different parts of an Excel worksheet used to carry out the calculations for this example. **Figure 23** is from the top part of the worksheet and shows the user inputs and the calculation of the estimated **SARR/SALR** ratio for the denitrification stage. Note also that a user input value is needed for the estimated NO₃-N recycle ratio. This initial estimated value is used in an iterative calculation to determine the required NO₃-N recycle ratio in order to achieve the target effluent NO₃-N concentration.

The S.I. version of the spreadsheet can be used with the 0.2 MGD wastewater flow rate specified as 757 m³/d. All of the other inputs remain as given above. The answers in S.I. units (if different than the U.S. solution) are shown in parentheses at the end of each part of the solution below

Figure 24 is from the middle of the worksheet and shows the answers for parts i) through vi). The calculations and results are as follows:

- i) Most of the nitrate loading to the pre-anoxic denitrification tank is typically in the NO₃-N recycle flow rather than in the primary effluent flow entering the tank. The NO₃-N loading rate will be (0.2 MGD)(Prim Effl NO₃-N)(8.34 lb/MG/mg/L) + (0.2 MGD)(Recycle Ratio)(Target Effl NO₃-N)(8.34) = 40.9 lb/day = (40.9 lb/day)*(453.59 g/lb) = **18,534 g NO₃-N/day**
- ii) Required carrier surface area = (18,534 g/day)/(0.9 g/m²/day) = 20,593 m².

Required carrier volume = 20,593 m²/500 m²/m³. = 41.186 m³ = (41.186 m³)(3.2808³ ft³/m³) = **1454 ft³**. (**41.186 m³**)
- iii) For 40% carrier fill: Required tank volume = 1454 ft³/0.40 = **3636.2 ft³**. (**103.0 m³**)



Your Course Title Here
A SunCam online continuing education course

- iv) The volume of liquid in the reactor can be calculated as:
 tank volume – [carrier volume(1 – void %)], Thus the volume of liquid is:
 $3636.2 - [1454.4(1 - 0.60)] = \underline{3054.4 \text{ ft}^3}$. (86.49 m³)
- v) The HRT at design ave ww flow can be calculated as:
 $\text{HRT}_{\text{des ave}} = \text{reactor liquid volume} * 7.48 / [Q * 10^6 / (24 * 60)] =$
 $3054.4 * 7.48 / [0.2 * 10^6 / (24 * 60)] = \underline{164 \text{ min}}$
- $\text{HRT}_{\text{peak hr}} = \text{HRT}_{\text{des ave}} / \text{peak hour factor} = 164 / 4 = \underline{41 \text{ min}}$
- vi) The required NO₃-N recycle ratio is calculated with the iterative process described in blue in the middle of **Figure 24**. For this iterative process, the NO₃-N removal rate is calculated two different ways, one using the estimated SARR and the carrier surface area and the other using the wastewater flow rate times the influent TKN concentration minus the sum of the effluent nitrate and ammonia nitrogen. Excel's Goal Seek process is then used to set the difference between the two different calculations equal to zero by changing the estimated value of the NO₃-N recycle ratio. This process results in the required NO₃-N recycle ratio calculated to be **2.72**.
- viii) Calculation of the alkalinity requirement is shown in the **Figure 25** spreadsheet screenshot. Using the equivalent weight of CaCO₃ as 50, the equivalent weight of NaHCO₃ as 84, the alkalinity use for nitrification as 7.14 g CaCO₃/g NH₃-N, the alkalinity produced by denitrification as 3.56 g CaCO₃/g NO₃-H, and the target effluent alkalinity as 80 mg/L as CaCO₃, give the calculated alkalinity requirement as 97.1 mg/L as CaCO₃. The rate of alkalinity addition needed can then be calculated as: (0.2 MGD)(91.1 mg/L)*8.34 = **161.9 lb/day as CaCO₃**. (57.3 kg/day as CaCO₃)
 Multiplying this by the ratio of the equivalent weight of NaHCO₃ to the equivalent weight of CaCO₃ gives the daily NaHCO₃ requirement as **272.0 lb/day NaHCO₃**. (96.2 kg/day as NaHCO₃)



Your Course Title Here
A SunCam online continuing education course

MBBR Process Design Calculations - U.S. units					
Pre-Anoxic Denitrification Process					
Instructions: Enter values in blue boxes. Spreadsheet calculates values in yellow boxes					
I. Wastewater Parameter Inputs					
1. Parameters for All Three Stages					
Design ww Flow Rate, Q_o =	0.2	MGD	Prim. Effl. BOD, S_o =	180	mg/L
Prim. Effl. TKN Conc. =	35	mg/L	Prim. Effl. NO_3 -N Conc. =	0	mg/L
Peak Hour Factor =	4		Prim. Effl. Alkalinity =	140	mg/L as $CaCO_3$
2. Parameters for First (Pre-Anoxic) Stage:					
			Data points for SARR/SALR vs SALR		
Target Effl. NO_3 -N Conc. =	9	mg/L	SALR ($g/m^2/d$):	0.2	0.5
Est. of NO_3 -N Recycle Ratio:	2.72		SARR/SALR:	0.95	0.94
(Q_R/Q_o) - An estimate is needed here to start the iterative calculation in Sec IV below			(default values above are from a graph of Pre-Anoxic SARR vs SALR in ref #6 below right) (The graph is shown at the right.)		
Design Value of NO_3 -N Surface					
Area Loading Rate (SALR) =	0.9	$g/m^2/d$	Slope, SARR/SALR vs SALR:	-0.033	
See information on typical design values for SALR at right.			Intercept, SARR/SALR vs SALR:	0.957	
			Est. of SARR/SALR Ratio =	0.927	
(Surf. Area Removal Rate/Surf. Area Loading Rate)					
3. Parameters for Second (BOD Removal) Stage:					
			Data points for SARR/SALR vs SALR (for BOD7)		
Design Value of BOD Surface			SALR ($g/m^2/d$):	7.5	15.0
Area Loading Rate (SALR) =	6	$g/m^2/d$	SARR/SALR:	0.925	0.875
See information on typical design values for SALR at right.			(default values above are from the table of typical values of % BOD7 removal vs SALR shown at the right from ref #2)		
Est. of SARR/SALR Ratio =			0.935	Slope, SARR/SALR vs SALR:	-0.007
(Surf. Area Removal Rate/Surf. Area Loading Rate)				Intercept, SARR/SALR vs SALR:	0.975
4. Parameters for Third (Nitrification) Stage:					
Min Design Temp., T =	45	$^{\circ}F$	Target Effl NH_4 -N Conc, NH_4-N_e =	3.3	mg/L
Click on cell H26 and on arrow to select D.O Conc.					
			D.O Conc. in Reactor =	3.0	mg/L
5. Preliminary Calculations - Design SALR value for Nitrification					
% NH_4 -N removal =	91%		NH_4-N_e @ $SARR_{max}$ =	0.80	mg/L
Maximum SARR =	0.88	$g/m^2/d$	SARR @ NH_4-N_e , $15^{\circ}C$, $SARR_{15}$ =	0.88	$g/m^2/d$
			SARR @ NH_4-N_e , $T^{\circ}C$, $SARR_T$ =	0.57	$g/m^2/d$
SARR Temp. Coeff, θ =	1.058		Design Value for nitrification SALR =	0.63	$g/m^2/d$

Figure 23. Screenshot – Pre-Anoxic Denitrification Design Calculations – Part 1



Your Course Title Here
A SunCam online continuing education course

III. Carrier and Tank Shape Parameter Inputs for all Three Stages									
Carrier Spec. Surf. Area = (from carrier mfr/vendor)	500	m ² /m ³	Click on green box and then on arrow to Select Tank Shape:		rectangular				
Liquid Depth in Tank =	8	ft	Carrier % Void Space =		60%				
Tank L:W ratio = (target L:W - only used if tank is rectangular)	1.5		(from carrier mfr/vendor - only needed to calculate hydraulic detention time)						
IV. Calculation of Carrier Volume and Required Tank Volume & Dimensions									
1. First Stage (Pre-Anoxic Tank) Calculations					(Carrier fill % is typically between 30% and 70%. Lower values are more conservative, allowing future capacity expansion or reduction of SALR by adding more carrier.				
Design Carrier Fill % =	40%	(for first stage)	Calculated Tank Volume =		103.0	m ³			
NO ₃ -N Daily Loading =	40.9	lb/day			3636.2	ft ³			
NO ₃ -N Daily Loading =	18533.7	g/day			27199	gal			
Carrier Surf. Area needed =	20593.0	m ²	Calculated Tank Width =		17.4	ft			
Calculated Carrier Volume =	41.186	m ³	Calculated Tank Length =		26.1	ft			
Tank Liquid Volume =	3054.4	ft ³	Nominal Hydraulic Retention Time at						
Estimate of NO ₃ -N Surface Area			Design Average Flow =		164	min			
Removal Rate, SARR =	0.83	g/m ² /d	Peak Hourly Flow =		41	min			
Req'd NO ₃ -N Removal Rate: (for Effl. NO ₃ -N = Target Value)	37.86	lb/day	Est. of NO ₃ -N Removal Rate:		37.86	g/day			
			Est. Rem Rate - Req'd Rate:		0.0000	g/day			
NOTE: Use Excel's "Goal Seek" to find Q_R/Q₀ as follows: Place the cursor on cell H73 and click on "Goal Seek" (in the "tools" menu of older versions and under "Data - What if Analysis" in newer versions of Excel). Enter values to "Set cell:" H73, "To value:" 0, "By changing cell:" c17, and click on "OK". The calculated value of Q_R/Q₀ will appear in cell C17 and cell H73 should equal zero if the process worked properly. Note that an initial estimate of Q_R/Q₀ is needed in cell C17 to start the iterative process.									

Figure 24. Screenshot – Pre-Anoxic Denitrification Design Calculations – Part 2



Your Course Title Here
A SunCam online continuing education course

VII. Calculation of Alkalinity Requirements			
Input:	Target Effluent Alkalinity =		80 mg/L
Constants needed for Calculations:			
Equiv Wt. of CaCO_3 =	50	g/equiv.	Equiv Wt. of NaHCO_3 = 84 g/equiv.
Alkalinity used for Nitrification =	7.14	g CaCO_3 /g $\text{NH}_3\text{-N}$ removed	
Alkalinity produced by Denitrification =	3.57	g CaCO_3 /g $\text{NO}_3\text{-N}$ removed	
Calculations			
Alkalinity to be added =	97.1	mg/L as CaCO_3	
Daily Alkalinity Requirement =	161.9	lb/day as CaCO_3	
For sodium bicarbonate use to add alkalinity:			
Daily NaHCO_3 Requirement =	272.0	lb/day NaHCO_3	

Figure 25. Screenshot – Pre-Anoxic Denitrification Design Calculations – Part 3

12. Summary

The MBBR (moving bed biofilm reactor) process is an attached growth process that uses plastic carriers to provide a surface on which biofilm grows. The plastic carriers are kept suspended in the aeration tank by an aerator for an aerobic process or by mechanical mixing for an anoxic or anaerobic process. The plastic carriers are kept in the system by a sieve at the outlet of the tank. The MBBR process doesn't require sludge recycle, because the biomass remains in the system attached to the plastic carrier. The required reactor size for an MBBR process is typically significantly smaller than for an activated sludge process treating the same wastewater flow, or for other common attached growth processes like the RBC or trickling filter. It can be used for BOD removal, biological nitrification, biological denitrification, and biological phosphorus removal.

This course provides discussion of and detailed examples of process design calculations for a single stage BOD removal MBBR system, a single stage tertiary



Your Course Title Here
A SunCam online continuing education course

nitrification MBBR system, a two-stage BOD removal MBBR system, a post-anoxic denitrification MBBR system and a pre-anoxic denitrification MBBR system.

14. References

1. Odegaard, Hallvard, "Compact Wastewater Treatment with MBBR," DSD International Conference, Hong Kong, 12, 11-14-2014.
2. Odegaard, H., "The Moving Bed Biofilm Reactor," in Igarashi, T, Watanabe, Y, Asano, T, and Tambo N., *Water Environmental Engineering and Reuse of Water*, Hokkaido Press 1999, p 250-305/
3. Steichen, M. & Phillips, H., Black & Veatch, "Process and Practical Considerations for IFAS and MBBR Technologies," Headworks International Presentation, 03/18/2010.
4. Rusten, B. and Paulrud, B, *Improved Nutrient Removal with Biofilm Reactors*, Aquateam – Norwegian Water Technology Center, Oslo, Norway.
5. McQuarrie, J.P. and Boltz, J.PI, *Moving Bed Biofilm Reactor Technology: Process Applications, Design and Performance*, Water Environment Research, Vol 83, No. 6, June 2011.
6. Bengtson, Harlan H., "[MBBR Wastewater Treatment Design Spreadsheet](#)," An online article at www.EngineeringExcelSpreadsheets.com .
7. Bengtson, Harlan H., "[Spreadsheets for MBBR Wastewater Treatment Process Design Calculations](#)," available as a paperback or as an Amazon Kindle e-book.
8. Bengtson, Harlan H., "[Spreadsheets for MBBR Denitrification Design Calculations](#)," an Amazon Kindle e-book.