



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

INSPIRING CREATIVE AND INNOVATIVE MINDS

www.utm.my

Specialized Short Course on **MEMBRANE TECHNOLOGY** for Water and Wastewater Treatment

27 – 28 June 2009 (4 -5 Rajab 1430 H)

Prince Khalid bin Sultan Chair for Water Research
Civil Engineering Department, Hall 1 A 36
College of Engineering, King Saud University



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

INSPIRING CREATIVE AND INNOVATIVE MINDS

www.utm.my

Lecture 5

Membrane Applications: Drinking Water Production

Prof. Dr. Ir. Zaini Ujang

Ph.D, P.Eng. (M), C.Eng. (UK), C.Sci. (UK), C.W.E.M. (UK), MIEM, DNS, PPI

Institute of Environmental and Water Resources Management (IPASA)
Universiti Teknologi Malaysia



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Presentation Menu

Part 1: Introduction

Part 2: Membrane configurations

Part 3: Membrane systems

Part 4: Microfiltration


Part 5: Ultrafiltration

Part 6: Reverse osmosis



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

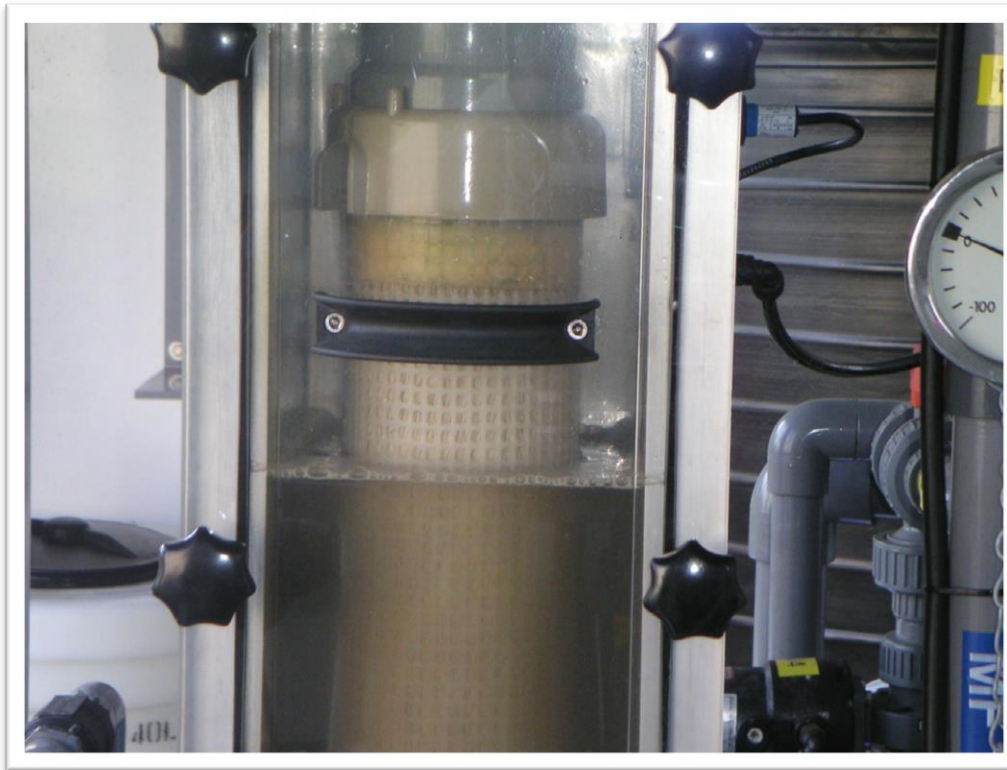

Part 1. Introduction



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Drinking Water Production

Sources of Water

- Seawater & brackish water
- Ground water
- Surface water
 - *Rivers*
 - *Lakes*
- Rainwater
- Treated used water





UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Drinking Water Production Design Considerations

- Depends on raw water quality
- Design objectives set by health authority
- Quality → public health:
 - Chemical aspects
 - Microbiological aspects
 - Physical aspects



UTM
UNIVERSITI TEKNOLOGI MALAYSIA


www.utm.my

Drinking Water Production WHO Guidelines, Food Act

Quality → public health:

- Chemical aspects
- Microbiological aspects
- Physical aspects

Ecotoxicology studies



Quality guidelines



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Drinking Water Production WHO Guidelines (1984)

- Microbiological aspects
- Biological aspects
- Chemical and physical aspects
- Radioactive materials



Drinking Water Production

WHO Guidelines – Microbiological aspects (1984)

Treated Water Entering the Distribution System

■ Faecal coliforms	0/100 ml
■ Coliform microorganisms	0/100 ml

Water in Distribution System

■ Faecal coliforms	0/100 ml
■ Coliform microorganisms	0/100 ml
■ Coliform microorganisms	3/100 ml (Occasional)

Bottled Drinking Water

■ Faecal coliforms	0/100 ml
■ Coliform microorganisms	0/100 ml



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Drinking Water Production

WHO Guidelines – Chemical aspects (1984)

Compounds	Guidelines values ($\mu\text{g/L}$)	ADI (mg/kg body weight)
DDT (total isomers)	1	0.005
Aldrin & dieldrin	0.03	0.0001
Chlordane (total isomers)	0.3	0.001
Hexachlorobenzene	0.01	-
Heptachlor and heptachlor epoxide	0.1	0.0005
Gamma-HCH (lindane)	3	0.01
Methoxychlor	30	0.1



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Drinking Water Production

Food Act 1983 (Malaysia)

- Almost similar to WHO guidelines
- Higher requirements in a few parameters
- Being updated several times



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Drinking Water Production

Food Act 1983 (Malaysia)

Compounds	Standard
Colour	15 Hazen
Turbidity	5 NTU
Aluminium	0.2 mg/L
Arsenic	0.05 mg/L
Cadmium	0.005 mg/L
Chloride	250 mg/L
Chromium	1 mg/L
Phenol	0.002 mg/L
Mercury	0.001 mg/L

INSPIRING CREATIVE AND INNOVATIVE MINDS



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Drinking Water Production


Food Act 1983 (Malaysia)

Compounds	Standard
Ferum	0.3 mg/L
Plumbum	0.05 mg/L
Magnesium	150 mg/L
Manganese	0.001 mg/L
Sodium	200 mg/L
Sulfat	400 mg/L
Zinc	5 mg/L
Residual chlorine	0.1 mg/L
Argentum	0.05 mg/L

INSPIRING CREATIVE AND INNOVATIVE MINDS



Membrane Technology

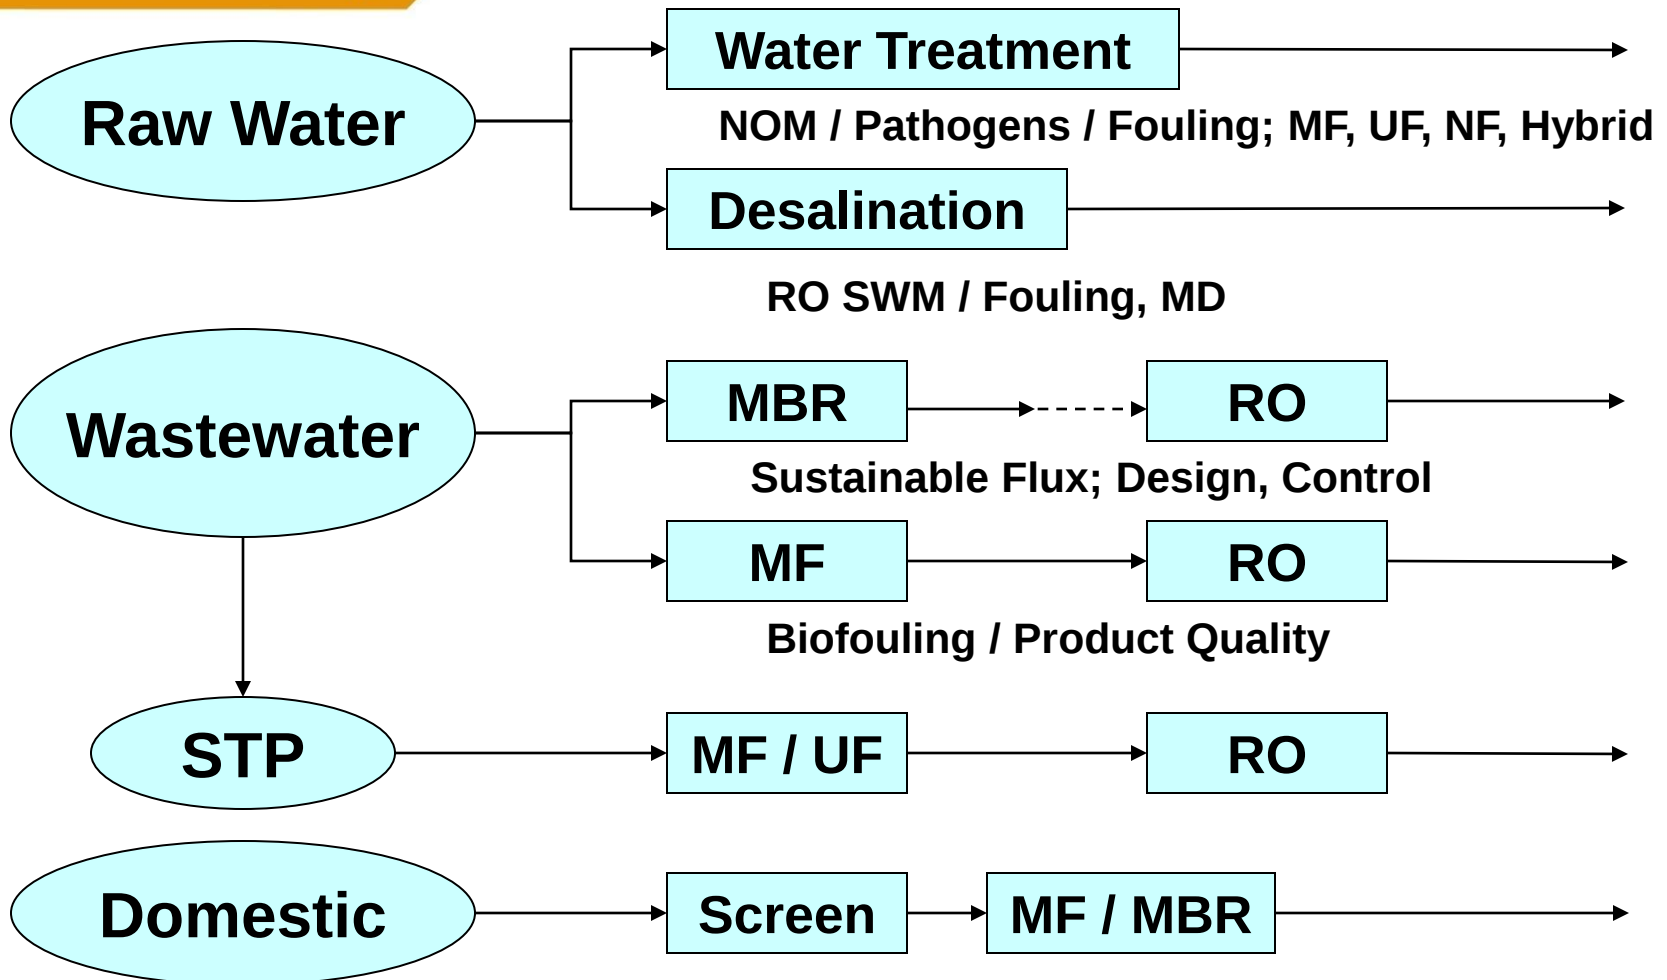



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Conventional Water Treatment Processes

Aeration

Gasses, Fe, Mn, odor & taste removal

Coagulation

Solid/liquid separation

Flocculation

Solid/liquid separation

Sedimentation

Solid/liquid separation

Filtration

Solid/liquid separation

Disinfection

Bacterial removal



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Advanced Water Treatment (1)

Oxidation

Organic, gasses, Fe, Mn, odor & taste removal

Coagulation

Solid/liquid separation

Flocculation

Solid/liquid separation

Sedimentation

Solid/liquid separation

Sand Filtration

Solid/liquid separation

Enhanced Oxidation

Organic removal

Activated Carbon

Taste & odor

Disinfection

Bacterial removal



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Advanced Water Treatment (2)

Coagulation & PAC

Solid/liquid separation

Sedimentation

Solid/liquid separation

Ozonation

Organic, taste & odor removal

Sand filtration

Solid/liquid separation

Nanofiltration

Solid/liquid separation & NOM removal

Disinfection

Bacterial removal



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Advanced Water Treatment (3)

Coagulation & PAC

Solid/liquid separation

Sedimentation

Solid/liquid separation

Microfiltration

Organic, taste & odor removal

Nanofiltration

Solid/liquid separation & NOM removal

Disinfection

Bacterial removal



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Advanced Water Treatment (4)

Coagulation

Solid/liquid separation

IMF-PAC

Solid/liquid separation

Organic, taste & odor removal

NOM removal

Disinfection

Bacterial removal

Treatment Principles: Selective Barrier

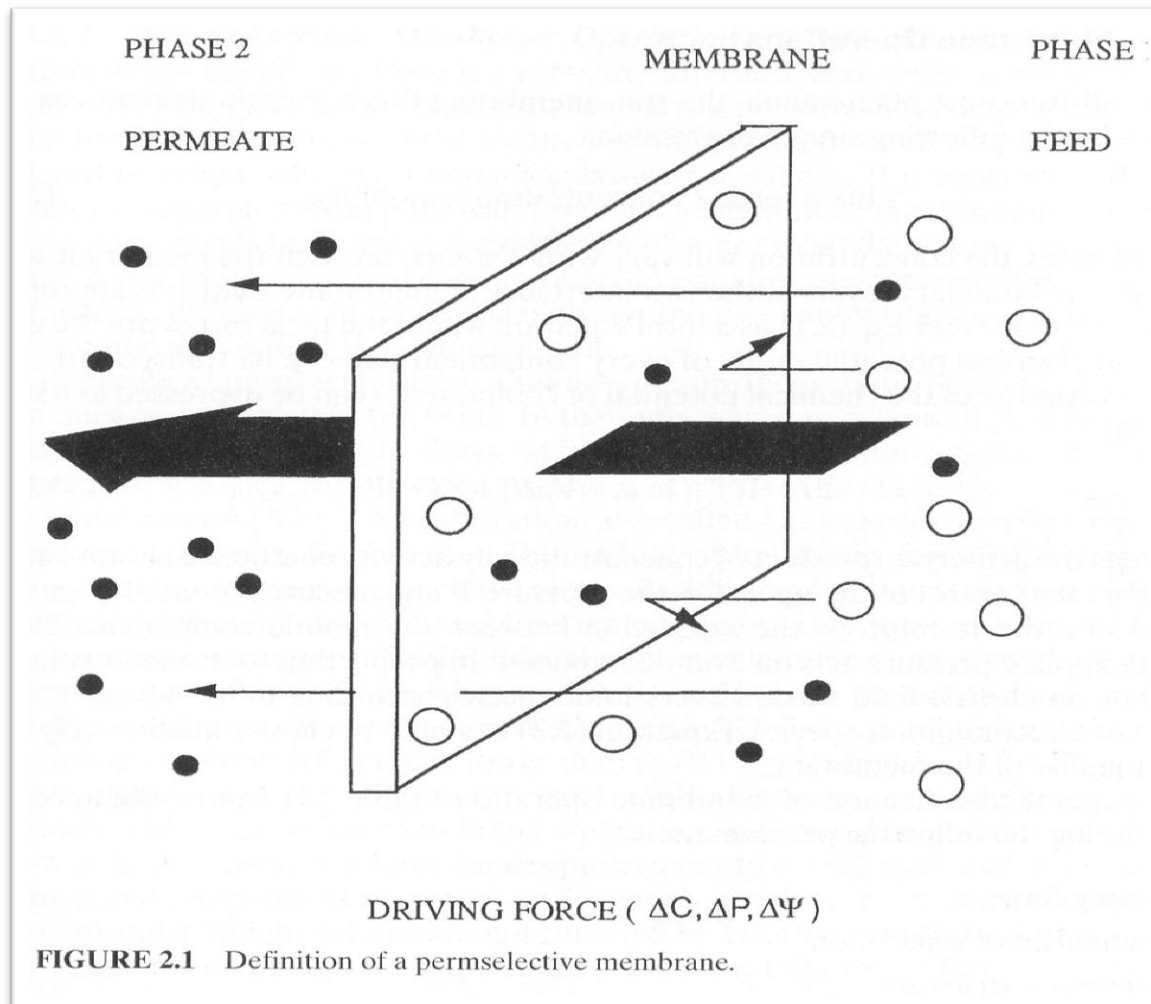


FIGURE 2.1 Definition of a permselective membrane.



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Target Water Pollutants & Technology Options

Era	Pollutants	Solutions
1800s	Pathogenic bacteria	Sewer system
1900s	BOD, COD	Biological wastewater plants
1950s	Heavy metals, biodegradable substances	Treatment at source
1970s	Eutrophication	N and P control
1980s	Trace substances, carcinogens, flavor, taste	Activated carbon, membrane technology
1990s	CO ₂ , NH ₄ , N ₂ O, CFCs, NO _x , SO _x	Energy saving, photosynthetic bacteria, biotechnology, MBR
2000s	Endocrine disrupting chemicals (EDCs), eco-hazard	Membrane technology

INSPIRING CREATIVE AND INNOVATIVE MINDS



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Overcoming Cryptosporidium Outbreak




Membrane plant for water treatment, Ogose Town, Japan

INSPIRING CREATIVE AND INNOVATIVE MINDS



Filtration Spectrum

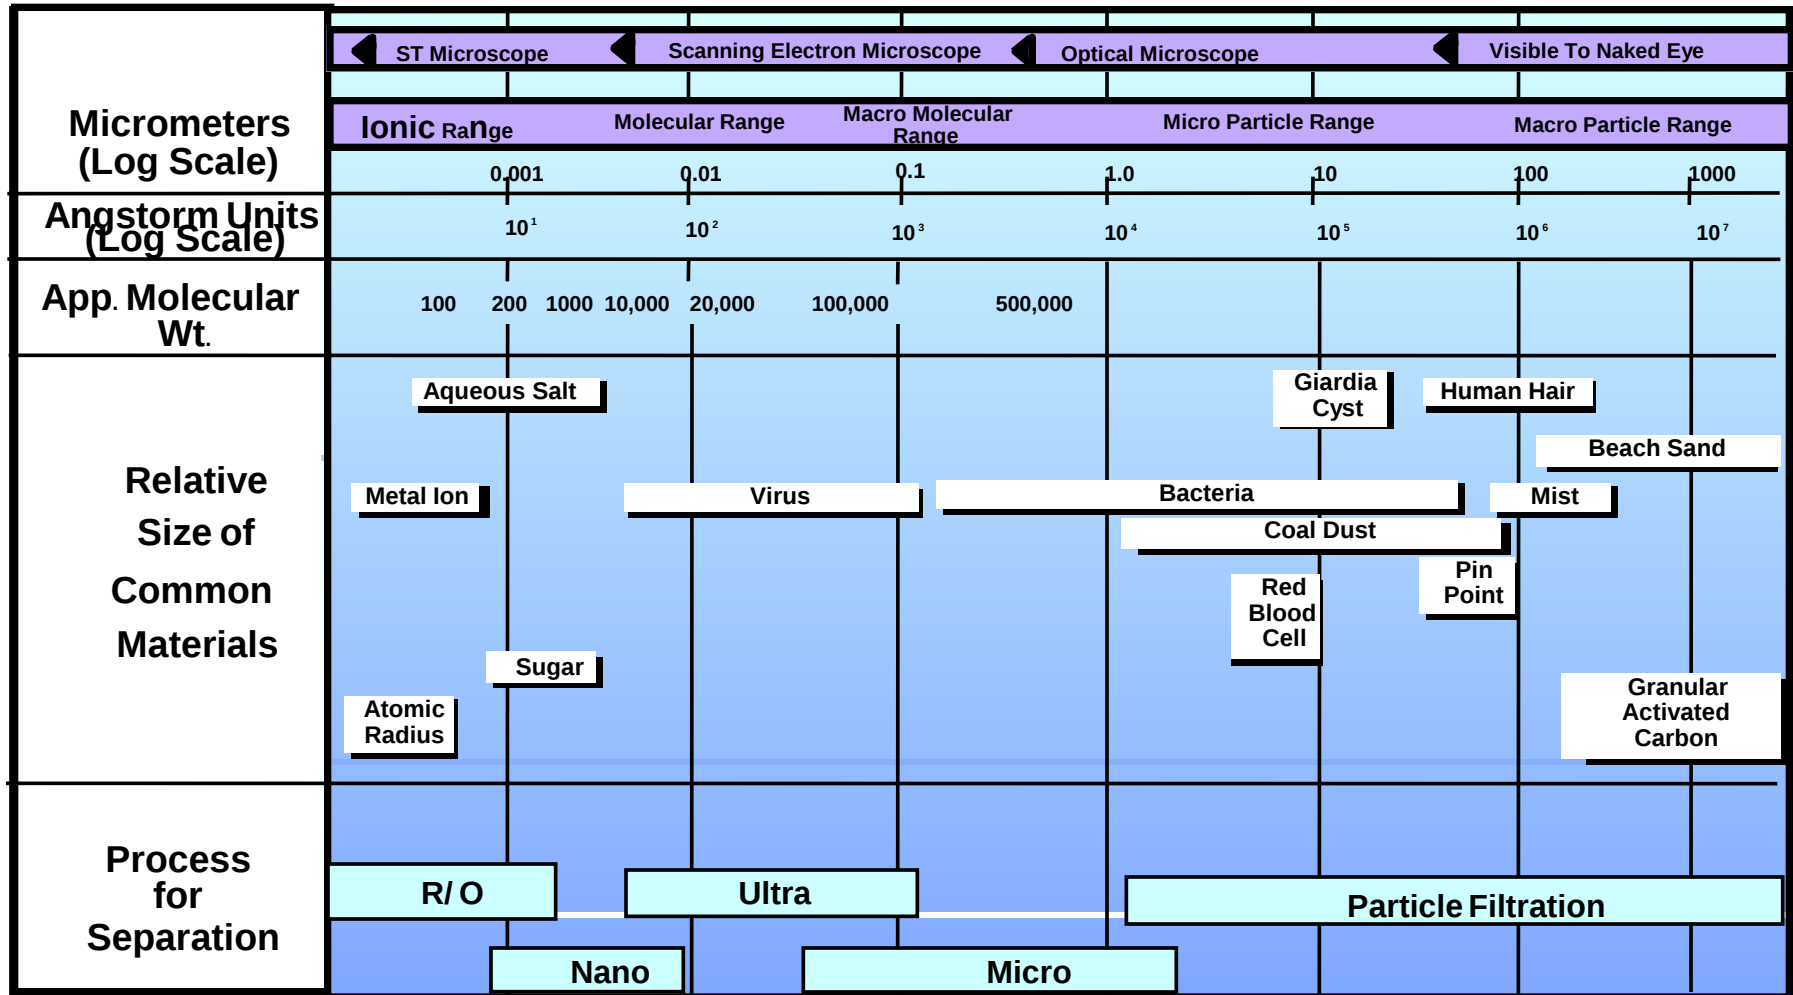



UTM
UNIVERSITI TEKNOLOGI MALAYSIA


www.utm.my



Part 2. Membrane Configurations



The Trend of the Past

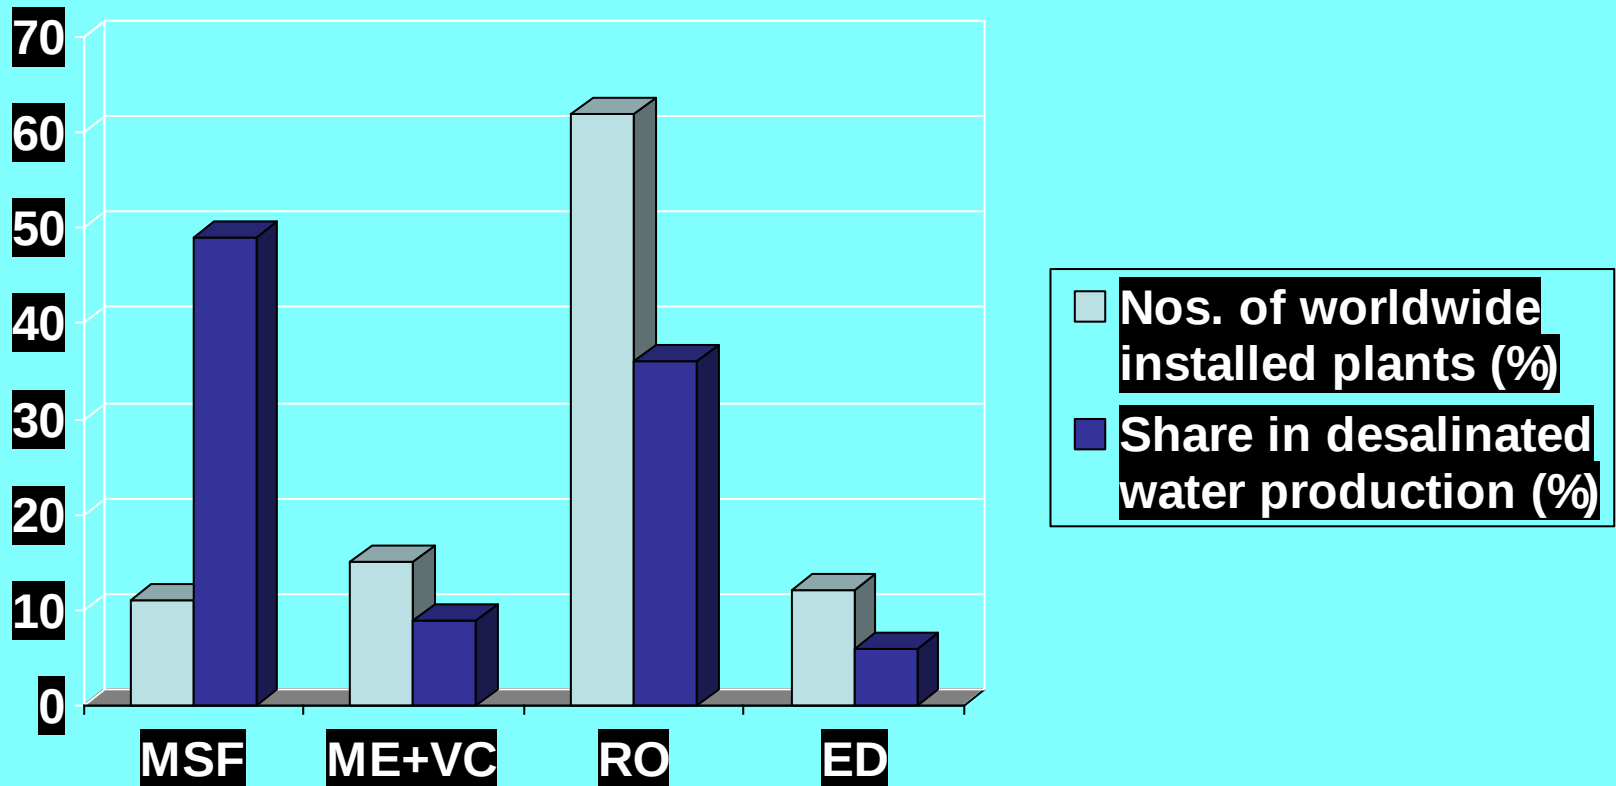

Installation of Desalination Technology, 1990-2000, by size (ref; IDA inventory)



UTM
UNIVERSITI TEKNOLOGI MALAYSIA


www.utm.my

Reality on Membrane Cost

Spiral-wound module trends (20 years)

Cost/Element down to 40%, Productivity up 200%


Declining cost of membrane elements

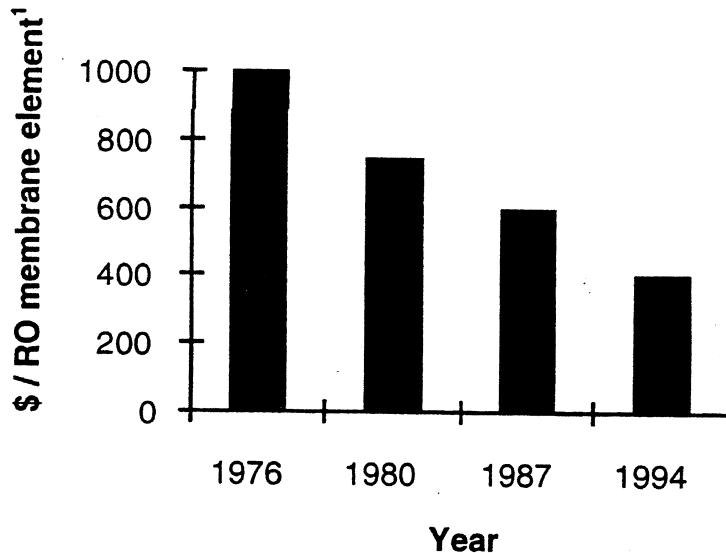

Source: Water Factory 21 municipal wastewater reclamation plant

¹ 8-inch spiral wound cellulose acetate membrane elements

Declining energy requirements for desalting municipal wastewater¹

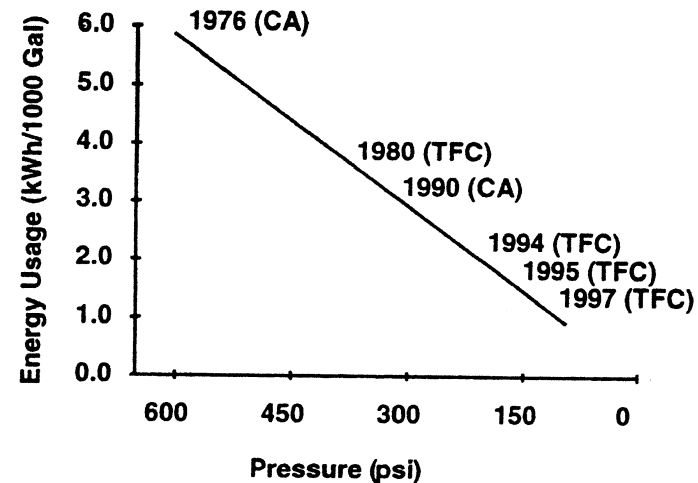

Source: Water Factory 21 municipal wastewater
Adapted by C.Gabelich MWD

¹ Membranes operating at a nominal flux of 10.4 gfd
at 20 °C on lime treated secondary effluent



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Module Configurations

- **Flat sheet membrane**
- **Tubular**
- **Hollow fibre**
- **Spiral wound**

**Based on specifications by manufacturers,
consultants, system integrators**



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Module Configuration Considerations

- **Treatment objectives**
- **Manufacturers' specifications**
- **Size of operation**
- **Operating cost estimation (low OPEX?, high CAPEX?)**
- **Capital expenditure (low CAPEX, high OPEX?)**



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Part 3. Membrane Systems





UTM
UNIVERSITI TEKNOLOGI MALAYSIA


www.utm.my

Physical Separation

- **Single membrane operation**
- **Multiple membrane operations**
- **Hybrid conventional treatment system
+ membrane operation**




Single Membrane Operation

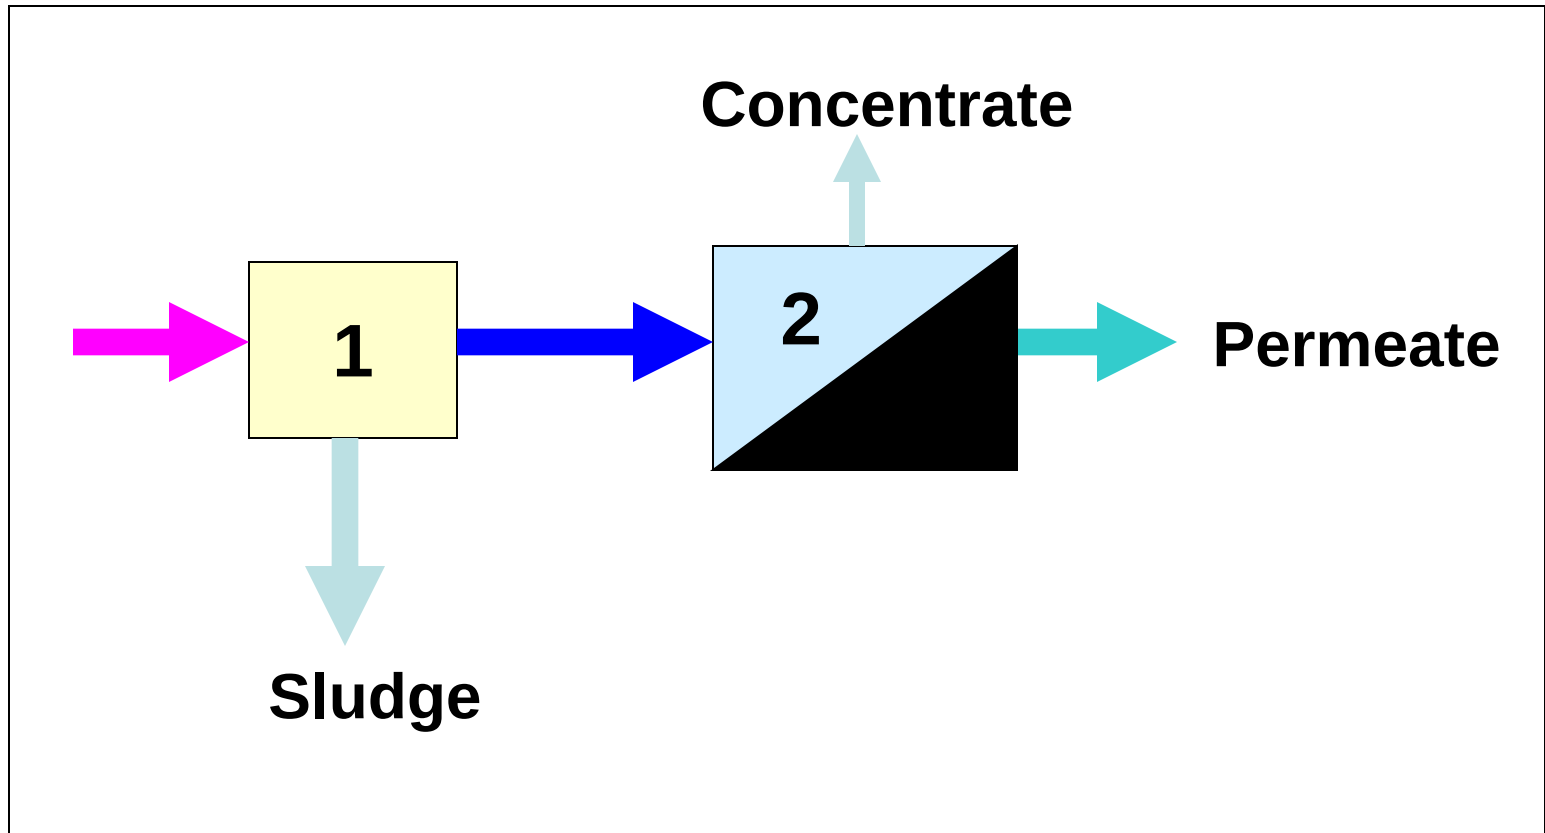


(1) Pretreatment unit (2) Membrane unit (s)

Single Membrane Operation

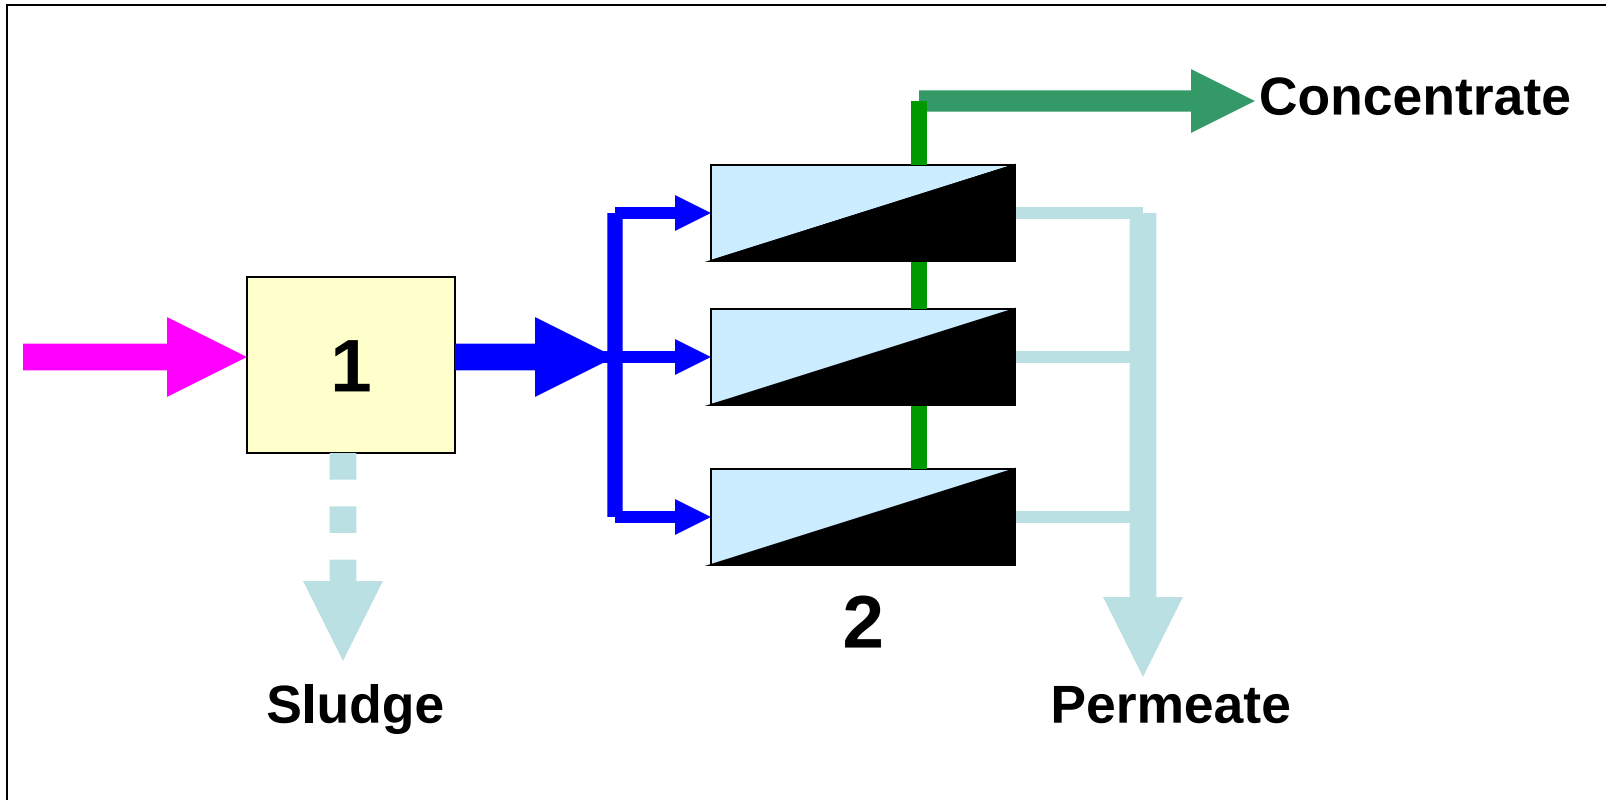


(1) Pretreatment unit (2) Membrane unit (s)

Multiple Membranes Operation

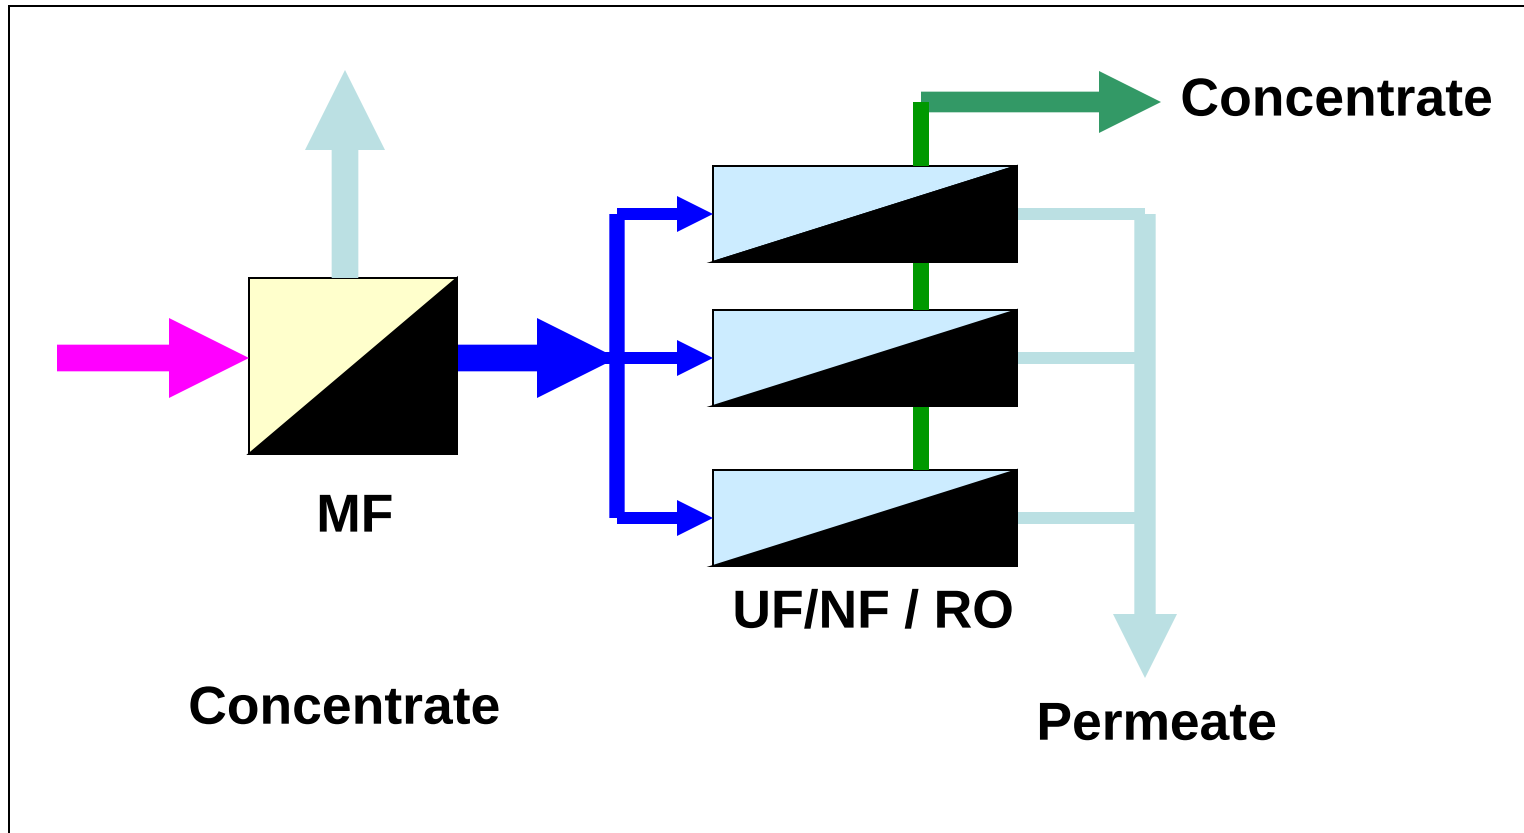

Normally, first with UF, followed by UF, NF and RO

Multiple Membranes Operation

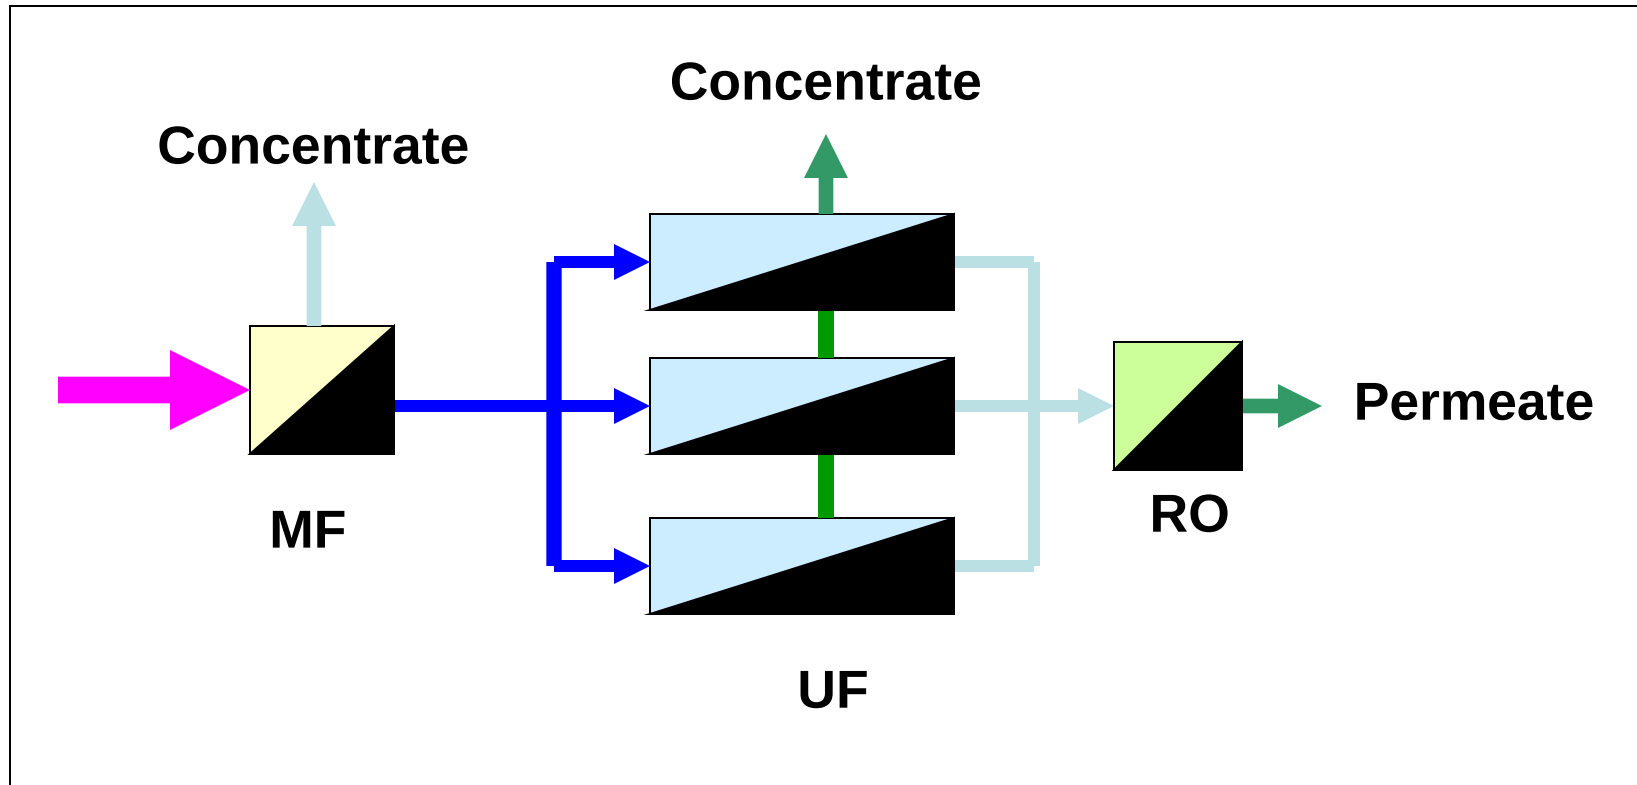

Normally, first with UF, followed by UF, NF and RO



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my



Part 4. Microfiltration




Microfiltration


- Exact pore size is a matter of debate
- Generally – filterable of *0.02-10* micron
- Particles, colloids, microorganisms (incl. *bacteria and virus*)
- Larger flux compared to UF, NF or RO
- Separation based on *sieving process* (or also known as surface filtration)
- Opposite to surface is depth filtration
- Operation pressure: 50 to 500 KPa

Microfiltration

Surface filtration vs Depth Filtration

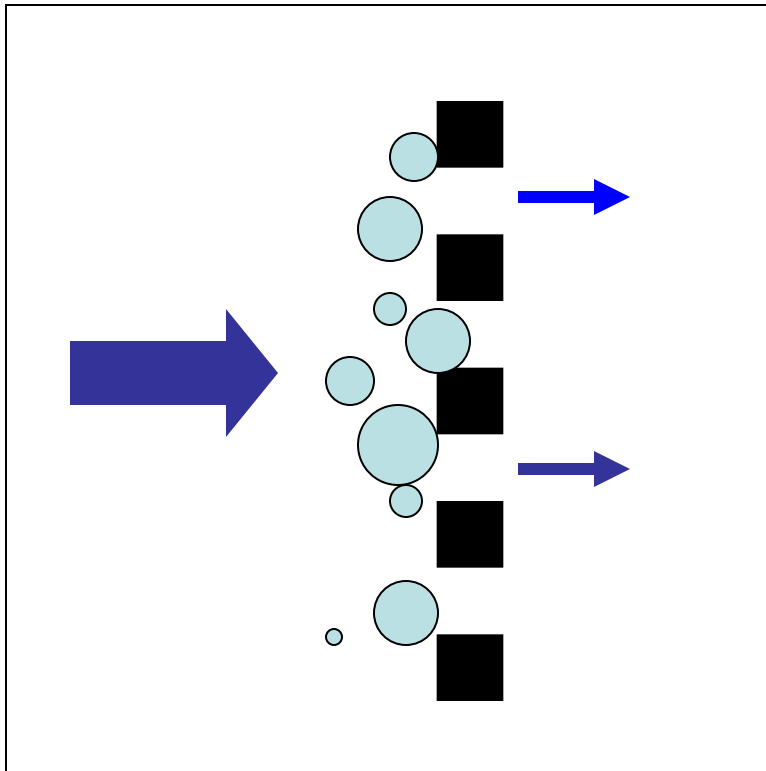


Surface filtration

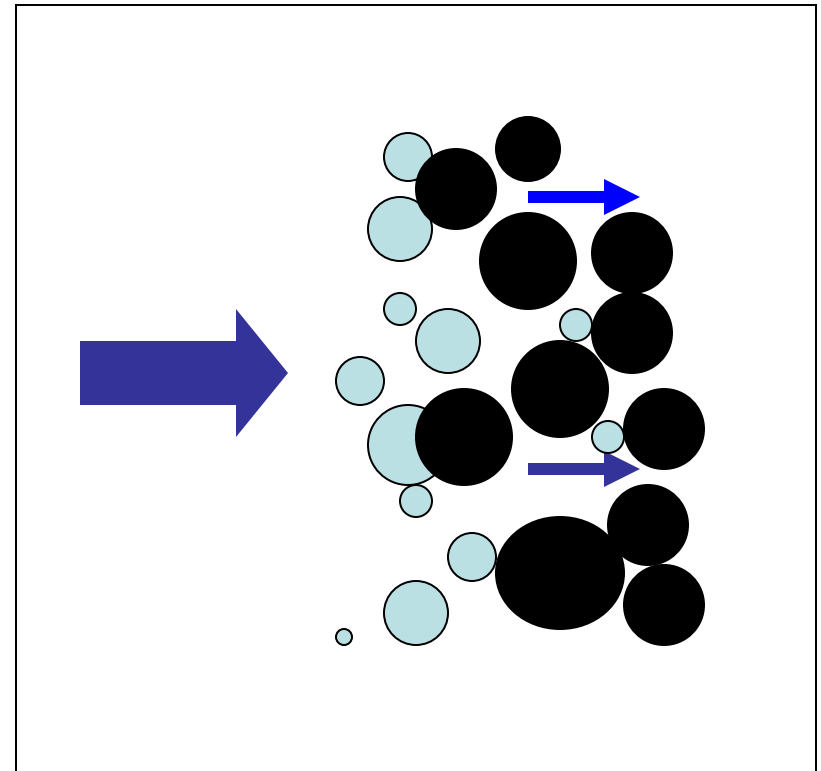


Depth filtration

Microfiltration

Deadend vs Crossflow Filtration

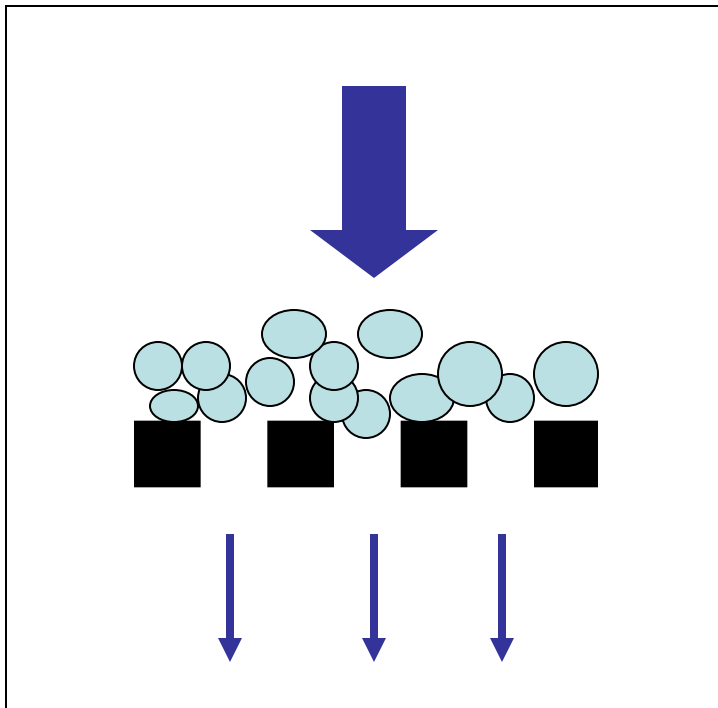

Deadend filtration

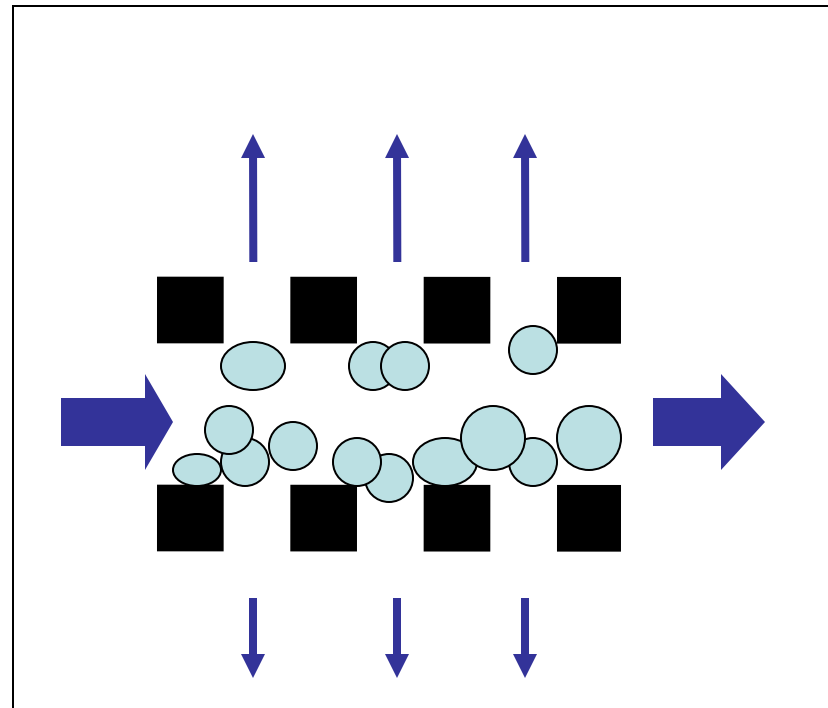

Crossflow filtration




UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Microfiltration

Deadend vs Crossflow Filtration

Cake thickness ----
Flux ——

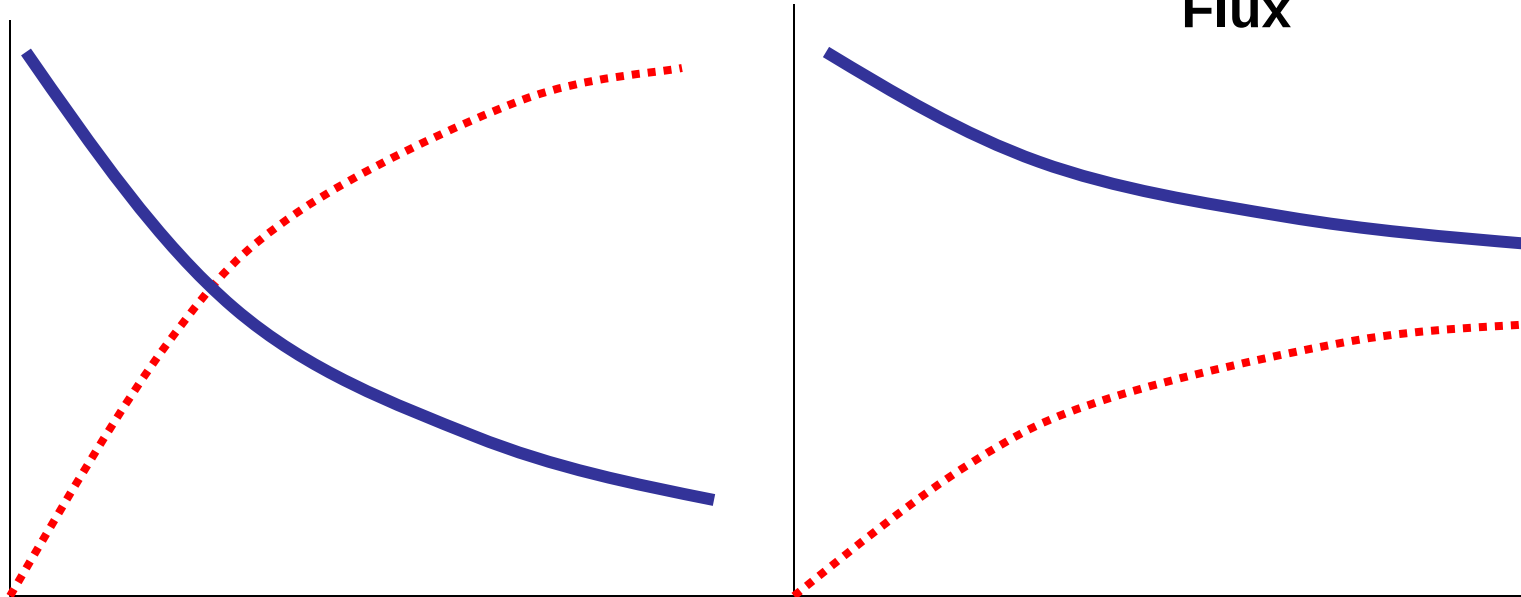

Dead-end

Cross-flow



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Microfiltration

Fouling and Flux Decline

Internal membrane fouling

Attachment of materials within the internal pore structure of membrane, or directly to membrane surface due to adsorption, precipitation, pore plugging, particulate adhesion etc.

External cake fouling

Formation of stagnant cake layer on the membrane surface

due to concentration-polarization as the material being filtered

is carried to the membrane by permeate flow and is then rejected by membrane



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Membrane Permeability

$$\text{Permeability} = (\text{filtration rate} \div \text{area}) \times \text{pressure difference}$$

- Testing before design stage
- Benchmarking procedures
- Testing before commissioning
- Testing before fouling studies



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Microfiltration System Components

- Piping systems
- Pumps
- MF modules
- Pressure gauges
- Feeding and permeate tanks
- Control systems
- Pretreatment facilities



Process Parameters for Design

■ Fluid to be filtered

- State-liquid or gas? Composition
- Quantity, viscosity, temperature etc.

■ Suspended materials to be retained

- Composition, liquid or solid? Concentration

■ System considerations

- Specifications of process and materials
- Constancy / variability of feed
- Need for sterile conditions?
- Time for processing?
- Batch or continuous processes?



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Applications of Microfiltration

- Potable water production (colloid & bacteria removal)
 - Mineral processing
 - Enhanced contacting (ion exchange, activated carbon)
 - Bioseparation
 - Syringe filters
- Clarification



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Membrane Plant

Ogose Town, Japan

Design criteria	Values / specifications
Design flow	4000 m ³ /day
Membrane	4UF, 2 MF
Recovery rate	99%
Pretreatment	Coagulation, rapid sand filter
Backwash	Pressurize water & air scrubbing



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Immersed Membrane Filtration Microfiltration/PAC System

- **Similar membrane used in MBR**
- **Reaction zone for**
 - ▶ adsorption
 - ▶ biodegradation
 - ▶ coagulation
- **Flexibility in operation**
 - ▶ operation at high SS concentration
 - ▶ adapt type & age of suspension as required
 - ▶ Single-step process



UTM
UNIVERSITI TEKNOLOGI MALAYSIA


www.utm.my

Immersed Membrane Filtration Microfiltration/PAC System

- **NOM & SOC's removal**
- **Biological removal of BDOC**
- **Reduced sludge volumes (0.1% of treated water flow rate)**
- **Absolute containment of PAC within the system independent of process conditions**


Operating Principle Microfiltration/PAC System

- Hollow fiber or plate & frame
- Outside-in mode
- 2 reaction basins:
 - (a) Reaction zone
 - (b) Permeate side
- Aeration is used to:
 - (a) Creating turbulence
 - (b) Avoid PAC sedimentation

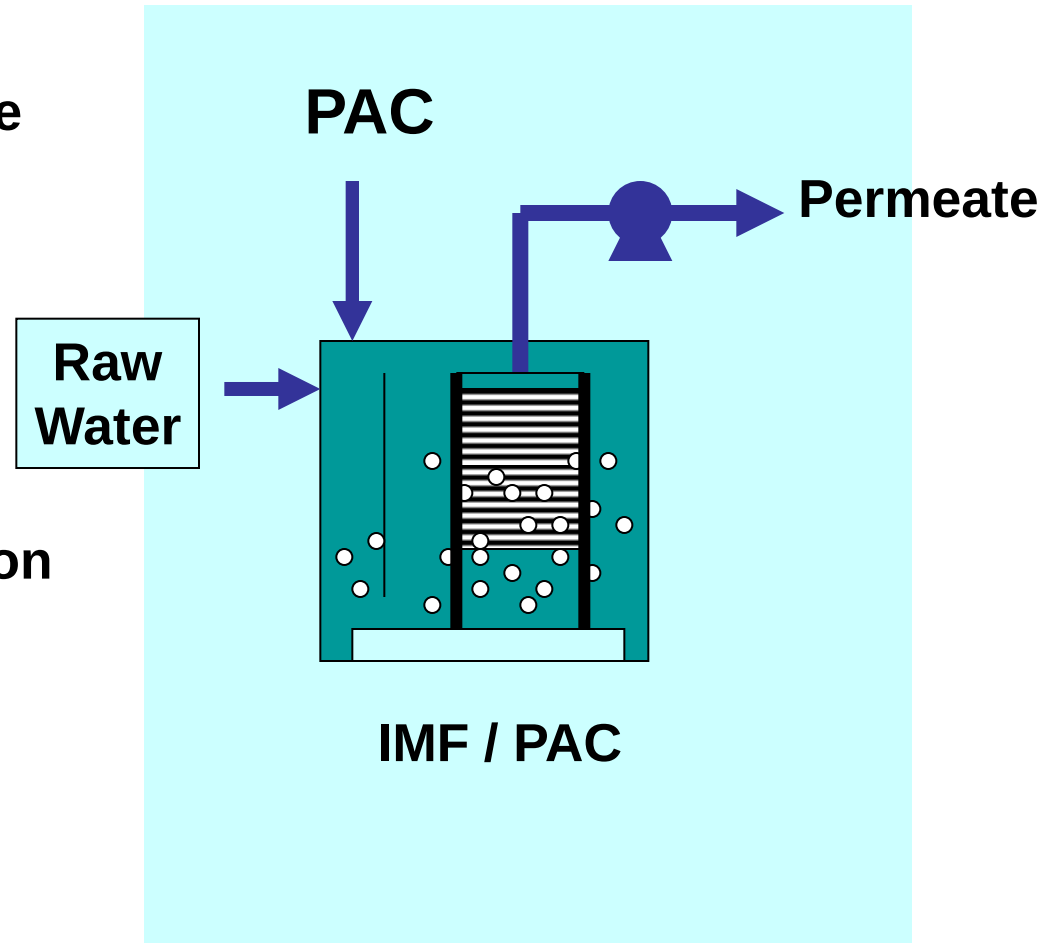

Operating Principle Microfiltration/PAC System

- Optimal & cost-effective utilization of PAC by allowing PAC aging inside the completely mixed reaction zone
- Optimal mixing & contact between water & PAC for maximum effectiveness

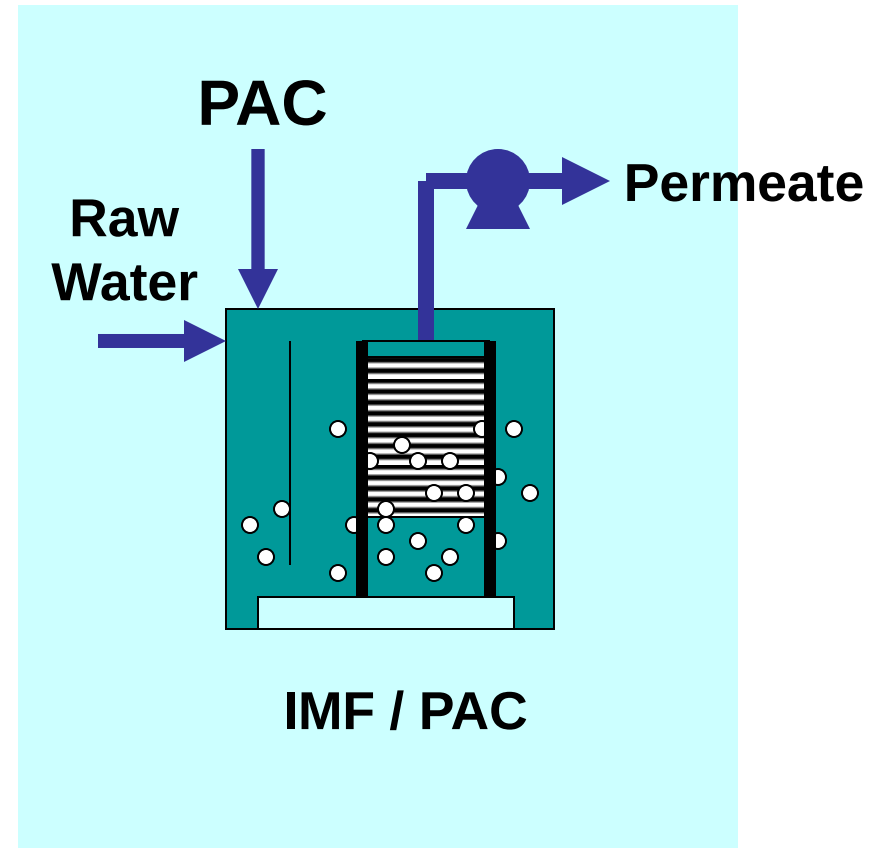



Operating Principle Microfiltration/PAC System

- PAC replacement is adaptable to the feed water quality with batch replenishment following procedure:
 - ▶ One a day a fraction of PAC slurry is purged to keep PAC slurry concentration stable in reactor.
- A replacement rate ▶ AGE
- Age = average residence time of particles inside reaction zone

$$Age = \frac{V_d}{V_R}$$

V_d = daily purge volume

V_R = reaction zone volume

$$D = \frac{M}{age \times Q_D}$$

D = PAC dosage rate

M = PAC in slurry


Q_D = daily flow rate



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Immersed Microfiltration Newater Plant, Kranji, Singapore

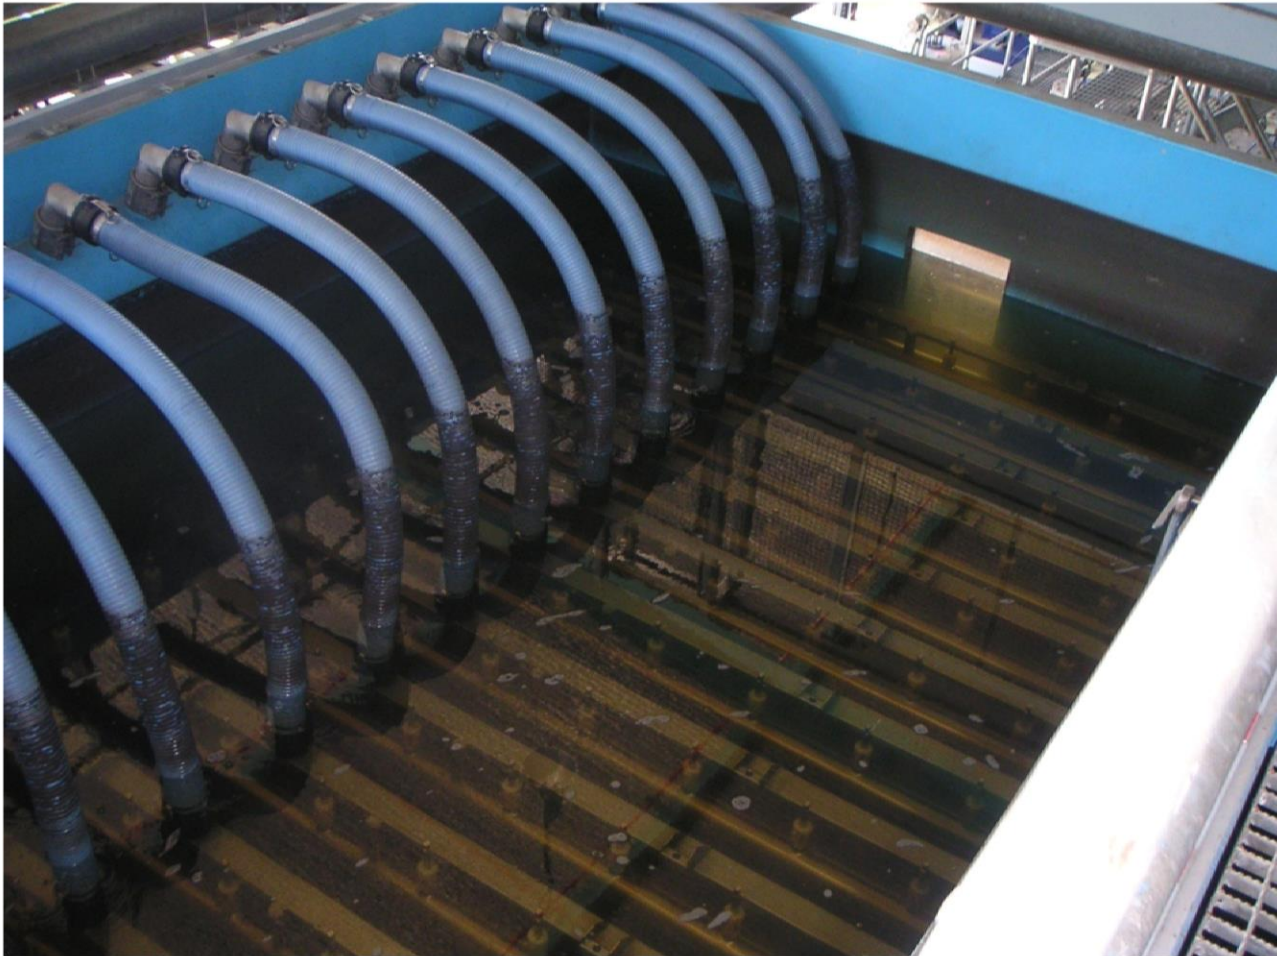

INSPIRING CREATIVE AND INNOVATIVE MINDS



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Part 5. Ultrafiltration



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Introduction to Ultrafiltration

- Sieving process for separation (similar to MF)
- Almost similar pressure range as MF
- Major difference with MF: pore size ($\text{MF} > 0.1\mu\text{m}$)
- For water treatment, UF is used as clarification and disinfection operation, MF as treatment
- Remove all types of bacteria and virus
- Operating pressure: 50 to 500 KPa



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my



Part 6. Reverse Osmosis



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Reverse Osmosis

- RO is a pressure-driven operation in which the solvent of the solution is transferred through a dense membrane tailored to retain salts and low-molecular-weight solutes.
- If a concentrated saline solution is separated from pure water by RO, the difference in chemical potential tends to promote the diffusion of water from the diluted compartment to the concentrated compartment in order to equalize the concentrations.



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Reverse Osmosis

- At equilibrium, the difference in the levels between the 2 compartments corresponds to the osmotic pressure of the saline solution.
- To get economical and viable flow, at least twice the osmotic pressure must be exerted
- For sea water, pressures of 5 to 8 MPa are used



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Nanofiltration

Also known as low-pressure RO

- Lies between RO and UF in terms of selectivity
- Removal of multivalent ions and organics
- Monovalent are poorly rejected (requires RO)
- NF leads to osmotic backpressure which is much lower than RO
- Pressure: 0.5 to 1.5 MPa



UTM
UNIVERSITI TEKNOLOGI MALAYSIA


www.utm.my

Nanofiltration Applications

Also known as low-pressure RO


- **Water softening**
- **Removal of organic matters, esp. NOM**
- **Removal of multivalent ions**
- **Desalting of organic reaction products**
- **Removal of arsenic and other metals**
- **Removal of endocrine disrupting chemicals**

Multiple Membrane Operations for Surface Water

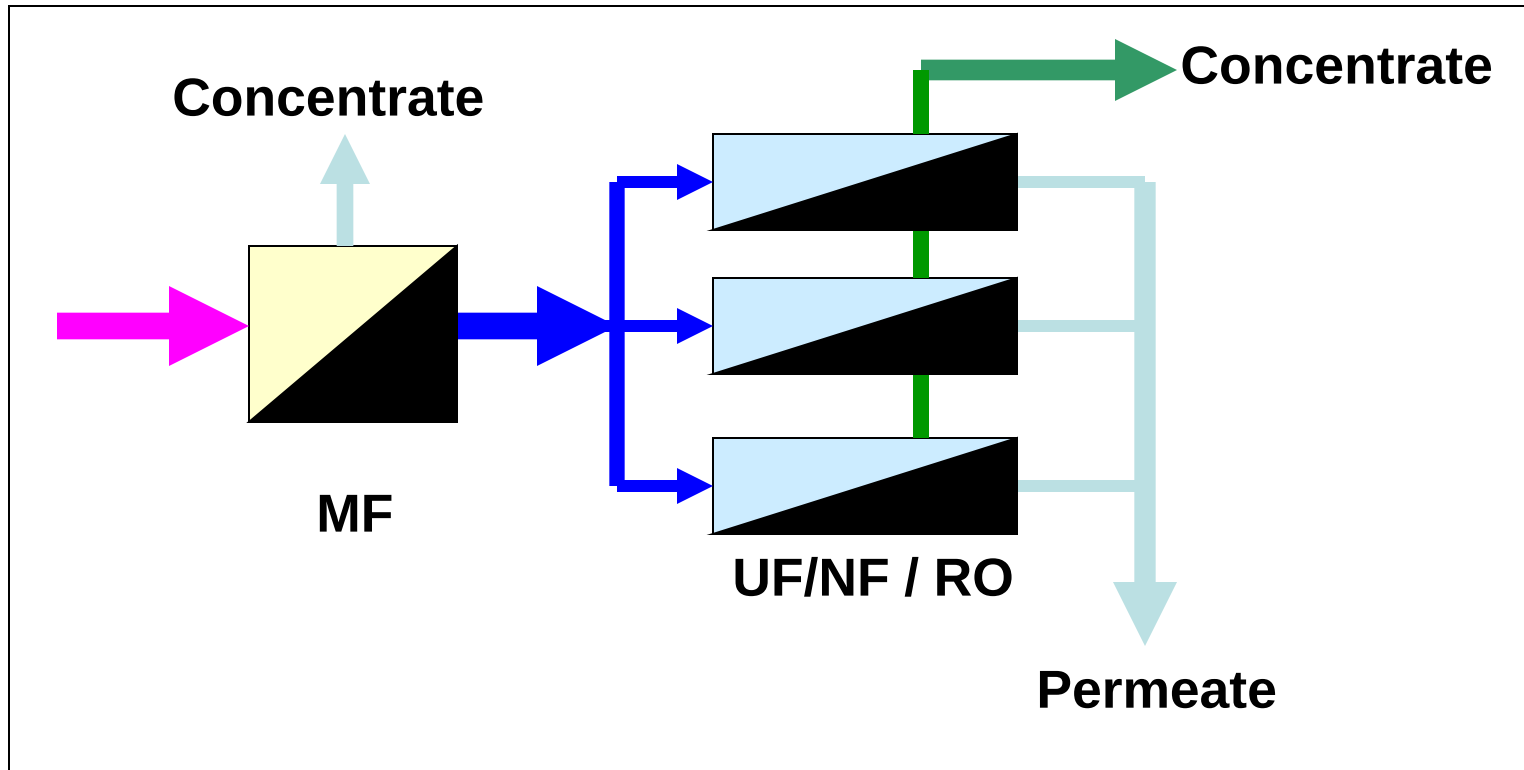

Normally, first with MF, followed by UF, NF and RO
(depends on the treatment objectives and quality of feed water)

Multiple Membrane Operations for Seawater

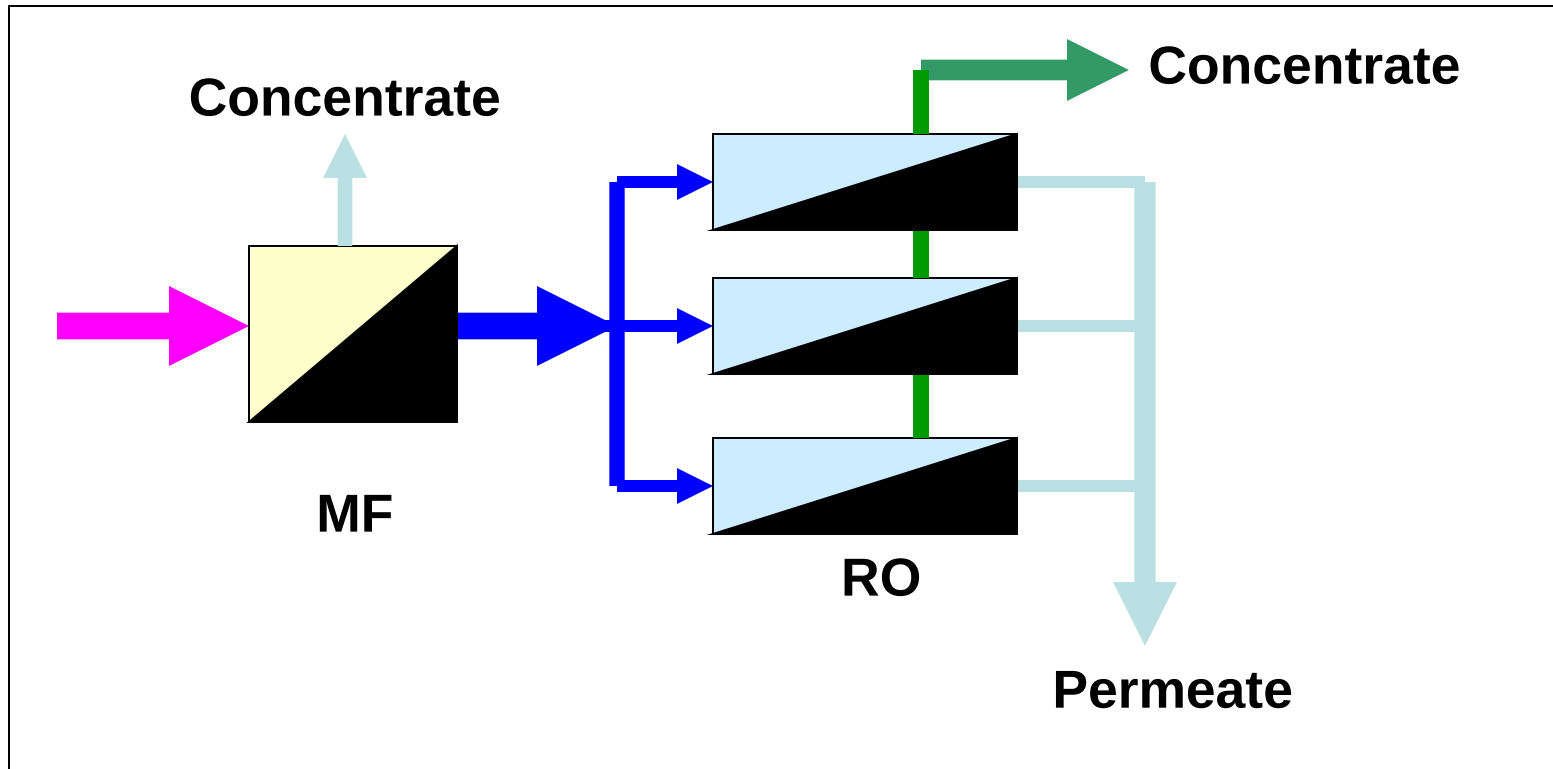


Normally, first with MF, followed RO



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

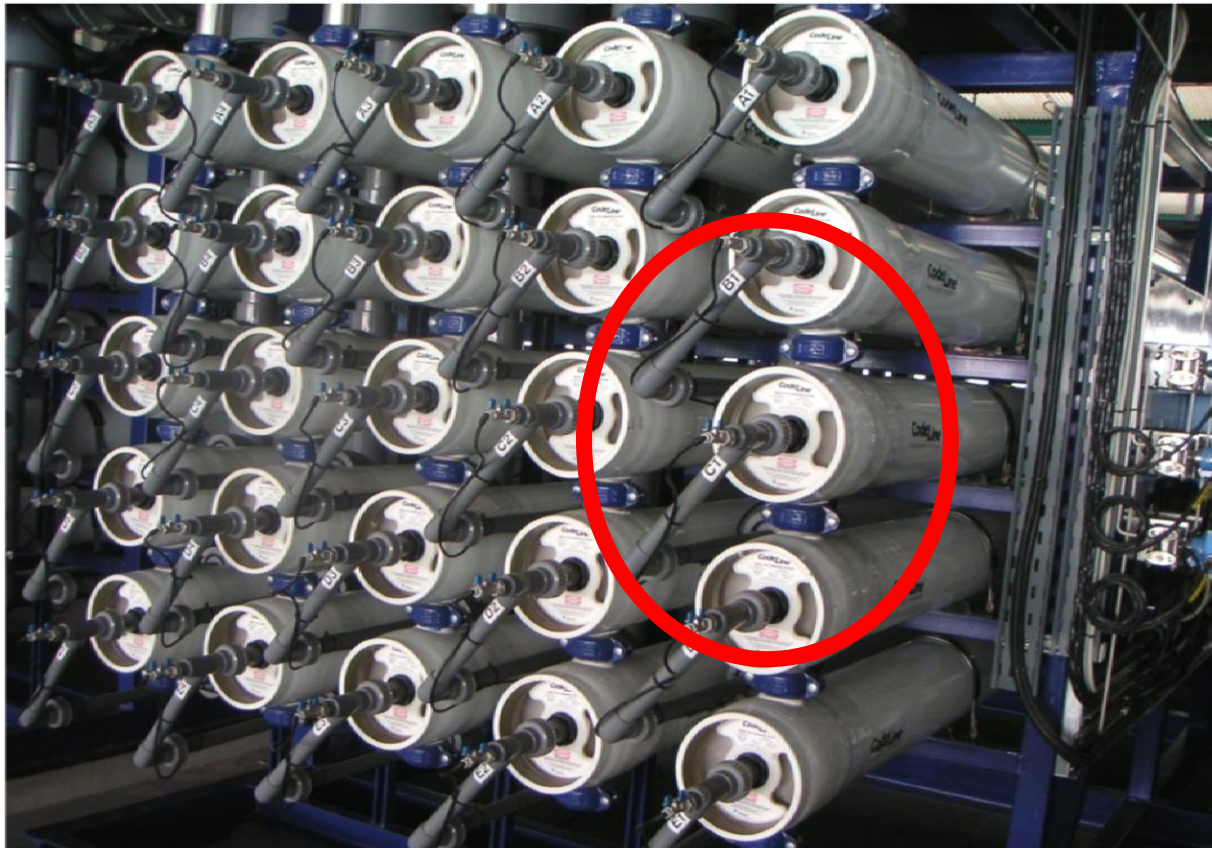

INSPIRING CREATIVE AND INNOVATIVE MINDS



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Conclusions

- **Membrane technology is well accepted in high quality of drinking water production**
- **Membrane technology is growing fast and very instrumental for the protection of public health and consumers' needs**



UTM
UNIVERSITI TEKNOLOGI MALAYSIA

www.utm.my

Future Directions

- **Membrane technology will be central in public water production – EDC, heavy metals etc.**
- **Membrane is to be a household technology in many industries for process water treatment, waste recycling and cleaner production**
- **Membrane vs Pollution??**
- **Membrane to be the option for upgrading of the existing water treatment facilities**