



Clarifier Calculations





Prepared By
Michigan Department of Environmental Quality
Operator Training and Certification Unit

Clarifier Calculations



Hydraulic Loading Solids Loading

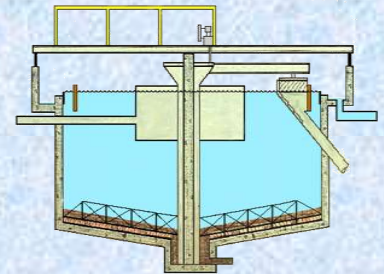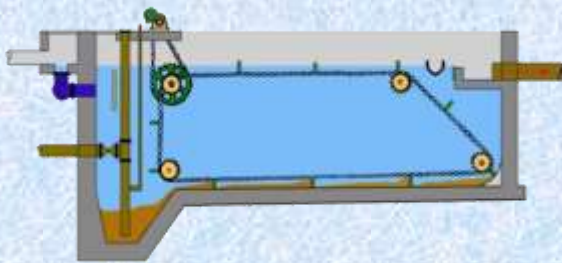

Clarifier Loading Calculations

$$\text{Detention Time (DT)} = \frac{\text{Tank Volume, MG} \times 24}{\text{Flow into Tank, MGD}}$$

$$\text{Surface Overflow Rate (SOR)} = \frac{\text{Flow, gallons/day}}{\text{Surface Area, ft}^2}$$


$$\text{Weir Overflow Rate (WOR)} = \frac{\text{Flow, gallons/day}}{\text{Length of Weir, ft}}$$

$$\text{Solids Loading} = \frac{\text{Solids, lbs/day}}{\text{Surface Area, ft}^2}$$

But First



Area and Volume Calculations

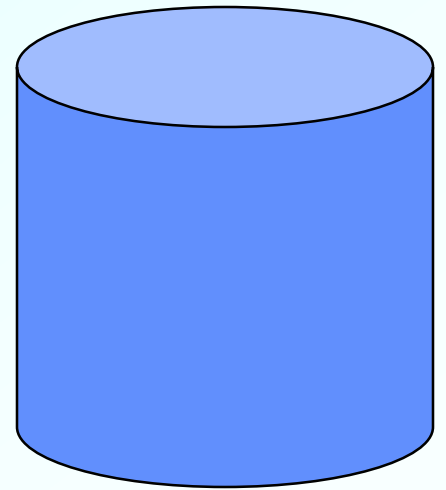

Surface Area Calculations

Rectangles

Surface Area, ft^2 = Length, ft X Width, ft

Example 1:

If a tank is 10 ft long and 5 ft wide,
what is the surface area?

$$\text{SA, ft}^2 = 10 \text{ ft} \times 5 \text{ ft} = 50 \text{ ft}^2$$

Surface Area Calculations

Rectangles

Surface Area, $\text{ft}^2 = \text{Length, ft} \times \text{Width, ft}$

Example 2:

If a tank is 10 ft 6 inches long
and 5 ft 9 inches wide,
what is the surface area in sq. ft.?

NOT

SA, $\text{ft}^2 = 10.6 \text{ ft} \times 5.9 \text{ ft}$

Converting Inches to Feet

$$6 \text{ inches} = \frac{6 \text{ inches}}{12 \text{ in/ft}} = 0.5 \text{ ft}$$

So: 10 ft 6 inches = 10.5 ft

$$9 \text{ inches} = \frac{9 \text{ inches}}{12 \text{ in/ft}} = 0.75 \text{ ft}$$

So: 5 ft 9 inches = 5.75 ft

Surface Area Calculations

Rectangles

Surface Area, ft² = Length, ft X Width, ft

Example 2:

**If a tank is 10 ft 6 inches long
and 5 ft 9 inches wide,
what is the surface area in sq. ft.?**

$$\text{SA, ft}^2 = 10.5 \text{ ft} \times 5.75 \text{ ft} = 60.4 \text{ ft}^2$$

Surface Area Calculations

Rectangles

Surface Area, ft^2 = Length, ft X Width, ft

**Work Calculations on Separate Paper
Answers Given on Next Slides**

Practice 1:

If a clarifier is **25 ft** long and **9 ft** wide,
what is the surface area in sq. ft.?

Practice 2:

If a clarifier is **22 ft 3 inches** long
and **7 ft 7 inches** wide,
what is the surface area in sq. ft.?

Surface Area Calculations

Rectangles

Surface Area, $\text{ft}^2 = \text{Length, ft} \times \text{Width, ft}$

Practice 1:

If a clarifier is 25 ft long and 9 ft wide,
what is the surface area in sq. ft.?

$$\text{SA, ft}^2 = 25 \text{ ft} \times 9 \text{ ft} = 225 \text{ ft}^2$$

Surface Area Calculations

Rectangles

Surface Area, ft^2 = Length, ft X Width, ft

Practice 2:

**If a clarifier is 22 ft 3 inches long
and 7 ft 7 inches wide,
what is the surface area in sq. ft.?**

Converting Inches to Feet

$$3 \text{ inches} = \frac{3 \text{ inches}}{12 \text{ in/ft}} = 0.25 \text{ ft}$$

So: 22 ft 6 inches = 22.25 ft

$$7 \text{ inches} = \frac{7 \text{ inches}}{12 \text{ in/ft}} = 0.58 \text{ ft}$$

So: 7 ft 7 inches = 7.58 ft

Surface Area Calculations

Rectangles

Surface Area, $\text{ft}^2 = \text{Length, ft} \times \text{Width, ft}$

Practice 2:

If a clarifier is 22 ft 3 inches long
and 7 ft 7 inches wide,
what is the surface area in sq. ft.?


$$\text{SA, ft}^2 = 22.25 \text{ ft} \times 7.58 \text{ ft} = 60.4 \text{ ft}^2$$

Surface Area Calculations

Circles

Diameter:

The distance across a circle, going through the center.

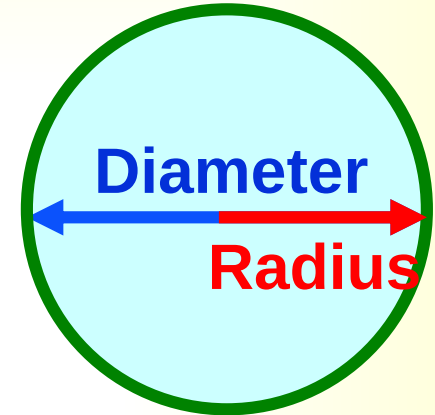

Radius:


The distance from the center a circle to the perimeter.

$$\text{Radius} = \frac{\text{Diameter}}{2}$$

Surface Area Calculations

Circles



**Circumference =
distance around circle**

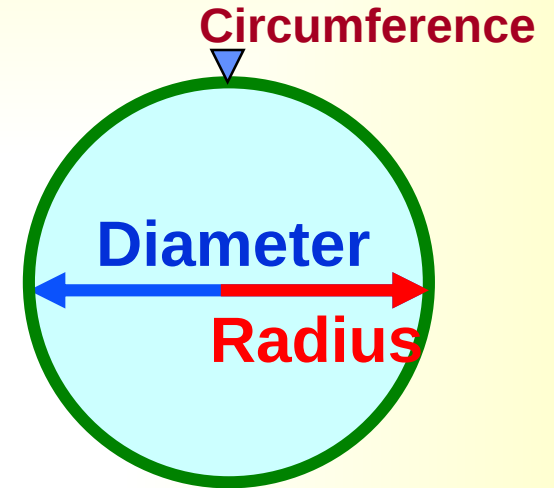

Surface Area Calculations

Circles

pie

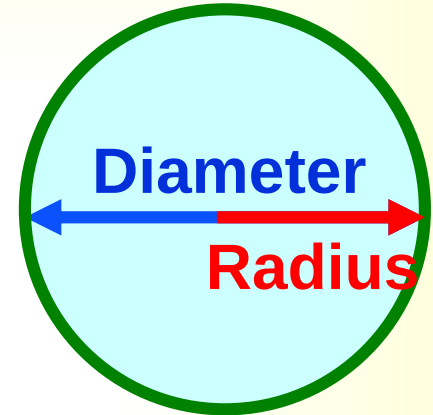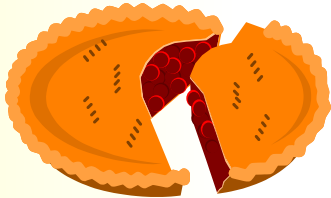


Surface Area Calculations

Circles

$$\text{pi} = \pi$$


$$= \frac{\text{Circumference}}{\text{Diameter}}$$

$$= 3.14 \text{ for any circle}$$

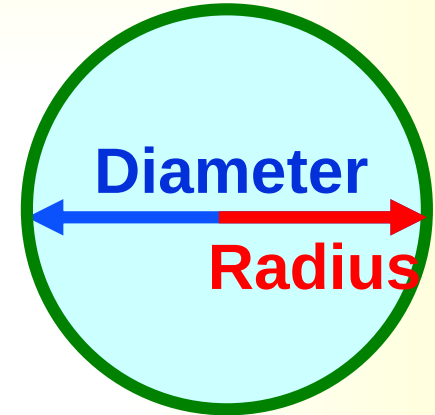

Surface Area Calculations

Circles

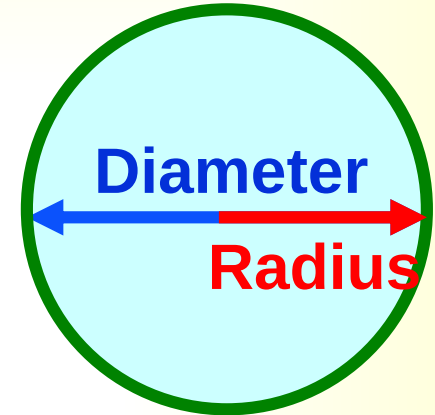

$$\text{Surface Area} = \pi r^2$$

$$= 3.14 \times \text{radius} \times \text{radius}$$

Surface Area Calculations

Circles

$$\text{Surface Area} = \pi r^2 = 3.14 \times r^2$$

OR

$$A = 3.14 \times (D/2)^2 = 3.14 \times \frac{D^2}{2^2} = \frac{3.14 \times D^2}{4}$$

OR


$$A = \frac{3.14}{4} \times D^2 = 0.785 \times D^2$$

Any one of the Three Formulas Can Be Used

Surface Area Calculations

Circles

$$\text{Surface Area} = \pi r^2$$

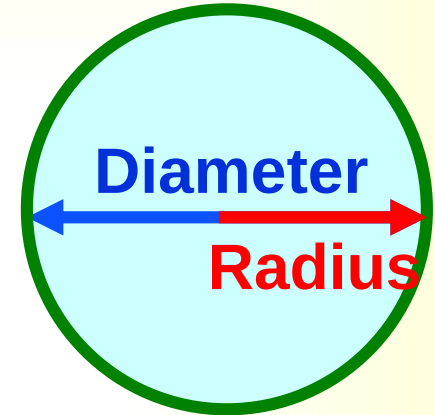

Example 1:

If a tank has a radius of 15 feet,
what is the surface area?


$$S A = \pi r^2 = 3.14 \times 15 \text{ ft.} \times 15 \text{ ft.}$$

$$= 707 \text{ ft}^2$$

Surface Area Calculations

Circles

$$\text{Surface Area} = \pi r^2$$

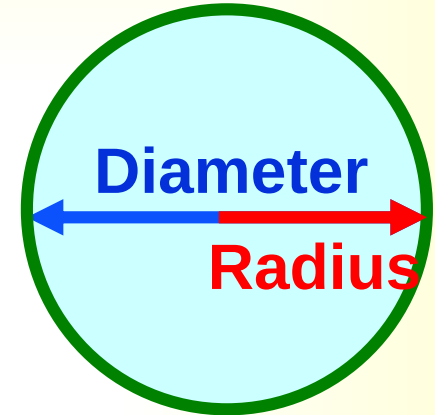

Example 2:


If a tank has a diameter of 25 feet,
what is the surface area?

$$\begin{aligned} S A &= \pi r^2 = 3.14 \times 12.5 \text{ ft.} \times 12.5 \text{ ft.} \\ &= 491 \text{ ft}^2 \end{aligned}$$

Surface Area Calculations

Circles

$$\text{Surface Area} = \pi r^2$$

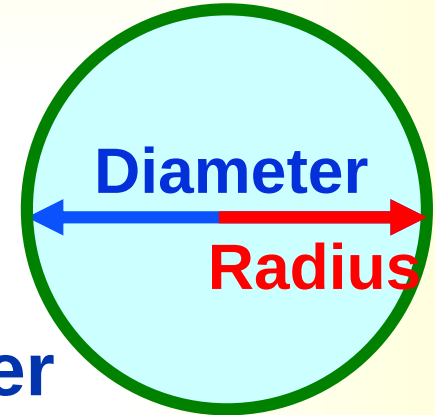

Work Calculations on Separate Paper
Answers Given on Next Slides

Practice 1:

If a tank has a diameter of 50.5 feet,
what is the surface area?


Practice 2:

If a tank has a diameter of
50 feet 7 inches, what is the surface area?

Surface Area Calculations

Circles

$$\text{Surface Area} = \pi r^2$$

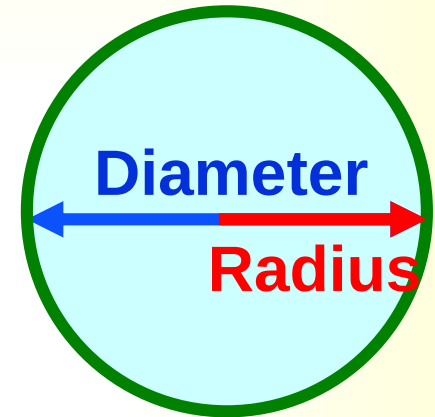

Practice 1:


If a tank has a diameter of 50.5 feet,
what is the surface area?

$$\begin{aligned} S A &= \pi r^2 = 3.14 \times 25.25 \text{ ft.} \times 25.25 \text{ ft.} \\ &= 2002 \text{ ft}^2 \end{aligned}$$

Surface Area Calculations

Circles

$$\text{Surface Area} = \pi r^2$$

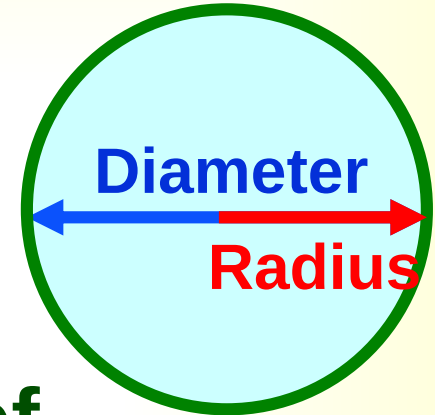

Practice 2:

If a tank has a diameter of 50 feet 7 inches, what is the surface area?

$$7 \text{ inches} = \frac{7 \text{ inches}}{12 \text{ in/ft}} = 0.58 \text{ ft}$$


$$50 \text{ feet } 8 \text{ inches} = 50.58 \text{ ft}$$

$$\text{Radius} = 50.58 \text{ ft} \div 2 = 25.29 \text{ ft}$$

Surface Area Calculations

Circles

$$\text{Surface Area} = \pi r^2$$

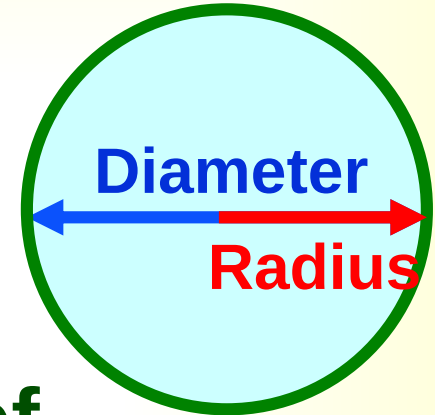

Practice 2:

If a tank has a diameter of 50 feet 7 inches, what is the surface area?

$$\begin{aligned} S A &= \pi r^2 = 3.14 \times 25.29 \text{ ft.} \times 25.29 \text{ ft.} \\ &= 2008 \text{ ft}^2 \end{aligned}$$

Volume Calculations

Volume – Three D







©2000 SouthWest




Volume Calculations

Volume – Three Dimensions

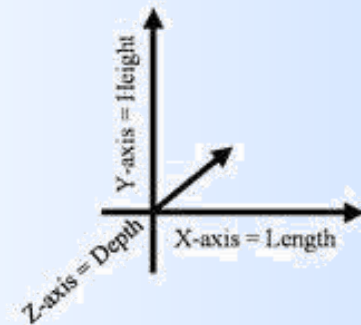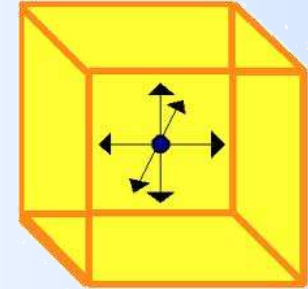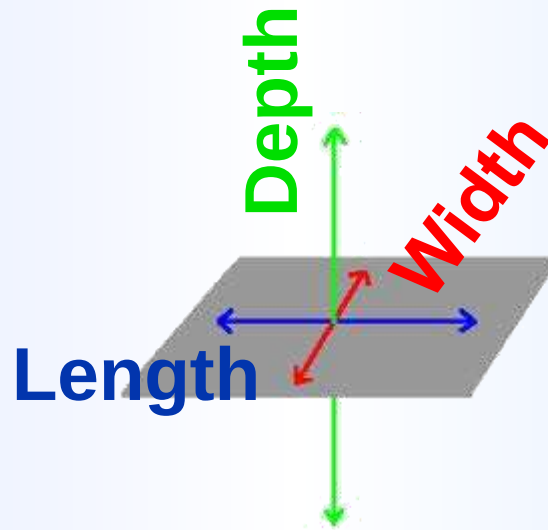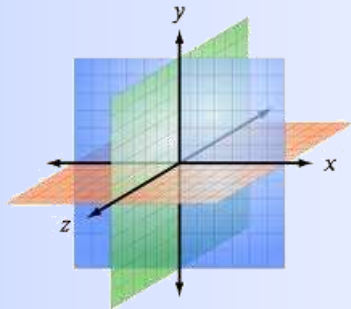

Volume Calculations

Rectangular Tanks



Volume = Length X Width X Height (or Depth)


Example 1:

If a tank is 10 feet long, 5 feet wide, and 5 feet deep, what is the volume in **cubic feet**?

$$\text{Vol.} = 10 \text{ ft} \times 5 \text{ ft} \times 5 \text{ ft} = 250 \text{ ft}^3$$

Volume Calculations

Rectangular Tanks



Volume = Length X Width X Height (or Depth)


Example 2:

If a tank is 20 ft. long, 7 ft. wide, and 5.5 ft. deep, what is the volume in **cubic feet**?

$$\text{Vol.} = 20 \text{ ft} \times 7 \text{ ft} \times 5.5 \text{ ft} = 770 \text{ ft}^3$$

Volume Calculations

Rectangular Tanks



Volume = Length X Width X Height (or Depth)


Example 3:

If a tank is 25 ft. long, 9 ft. 3 inches wide, and 7.5 ft. deep, what is the volume in **gallons**?

$$\text{Vol.} = 25 \text{ ft} \times 9.25 \text{ ft} \times 7.5 \text{ ft} = 1734 \text{ ft}^3$$

Volume Calculations

Rectangular Tanks



Volume = Length X Width X Height (or Depth)

Example 3:


If a tank is 25 ft. long, 9 ft. 3 inches wide, and 7.5 ft. deep, what is the volume in **gallons**?

There are 7.48 gallons in one cubic foot

OR 7.48 gal/ft³

Volume Calculations

Rectangular Tanks



Volume = Length X Width X Height (or Depth)

Example 3:

If a tank is 25 ft. long, 9 ft. 3 inches wide, and 7.5 ft. deep, what is the volume in **gallons**?


$$\text{Vol.} = 25 \text{ ft} \times 9.25 \text{ ft} \times 7.5 \text{ ft} = 1734 \text{ ft}^3$$

$$1734 \text{ ft}^3 \times 7.48 \text{ gal/ft}^3 = 12,970 \text{ gallons}$$

Volume Calculations

Rectangular Tanks

Work Calculations on Separate Paper
Answers Given on Next Slides



Practice 1:

If a tank is 21 feet long, 9 feet wide, and 7 feet deep, what is the volume in **cubic feet**?

Practice 2:


If a tank is 22 ft. long, 9 ft. wide, and 7.5 ft. deep, what is the volume in **cubic feet**?

Practice 3:

If a tank is 35 ft. long, 12 ft. 3 inches wide, and 9.5 ft. deep, what is the volume in **gallons**?

Volume Calculations

Rectangular Tanks



Volume = Length X Width X Height (or Depth)


Practice 1:

If a tank is 21 feet long, 9 feet wide, and 7 feet deep, what is the volume in **cubic feet**?

$$\text{Vol.} = 21 \text{ ft} \times 9 \text{ ft} \times 7 \text{ ft} = 1323 \text{ ft}^3$$

Volume Calculations

Rectangular Tanks



Volume = Length X Width X Height (or Depth)


Practice 2:

If a tank is 22 ft. long, 9 ft. wide, and 7.5 ft. deep, what is the volume in **cubic feet**?

$$\text{Vol.} = 22 \text{ ft} \times 9 \text{ ft} \times 7.5 \text{ ft} = 1485 \text{ ft}^3$$

Volume Calculations

Rectangular Tanks



Volume = Length X Width X Height (or Depth)


Practice 3:

If a tank is 35 ft. long, 12 ft. 3 inches wide, and 9.5 ft. deep, what is the volume in **gallons**?

$$\text{Vol.} = 35 \text{ ft} \times 12.25 \text{ ft} \times 9.5 \text{ ft} = 4073 \text{ ft}^3$$

Volume Calculations

Rectangular Tanks



Volume = Length X Width X Height (or Depth)

Practice 3:


If a tank is 35 ft. long, 12 ft. 3 inches wide, and 9.5 ft. deep, what is the volume in **gallons**?

There are 7.48 gallons in one cubic foot

OR 7.48 gal/ft³

Volume Calculations

Rectangular Tanks



Volume = Length X Width X Height (or Depth)

Practice 3:

If a tank is 35 ft. long, 12 ft. 3 inches wide, and 9.5 ft. deep, what is the volume in **gallons**?


$$\text{Vol.} = 35 \text{ ft} \times 12.25 \text{ ft} \times 9.5 \text{ ft} = 4073 \text{ ft}^3$$

$$4073 \text{ ft}^3 \times 7.48 \text{ gal/ft}^3 = 30,466 \text{ gallons}$$


Volume Calculations

Round (Cylinder) Tanks

Volume – Three Dimensions

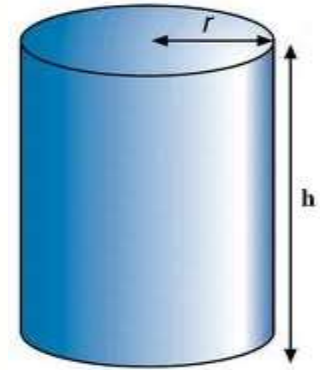

$$V = \pi r^2 h$$

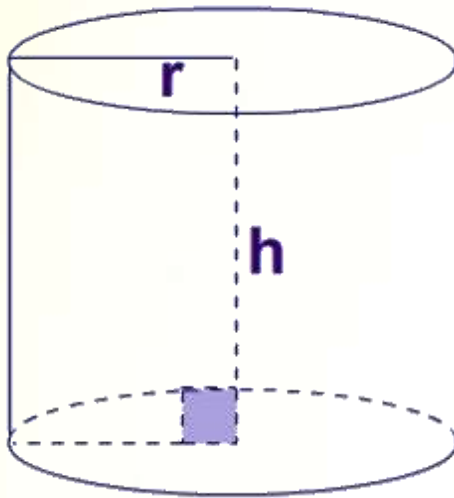


$$\pi = 3.14$$

r = Radius of circle

h = Height (or Depth)

Volume Calculations

Round (Cylinder) Tanks

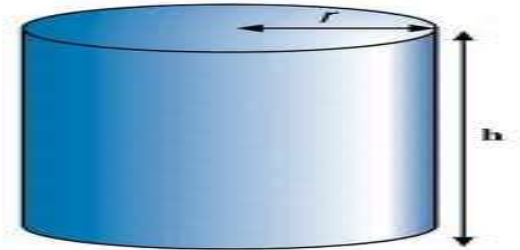


Example 1

Find the Volume in cubic feet of a tank having a radius of 10 feet and a depth of 8 feet.

$$\begin{aligned} V &= \pi r^2 h = 3.14 \times 10 \text{ ft} \times 10 \text{ ft} \times 8 \text{ ft} \\ &= 3.14 \times 800 \text{ ft}^3 \\ &= 2512 \text{ ft}^3 \end{aligned}$$

Volume Calculations

Round (Cylinder) Tanks

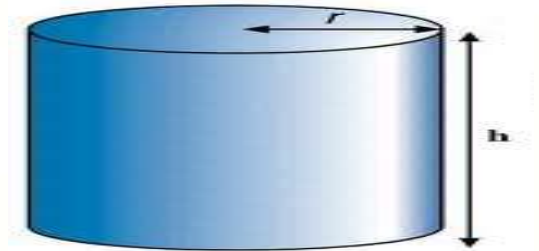


Example 2

Find the Volume in cubic feet of a tank having a diameter of 30 feet and a depth of 8 feet.

$$\begin{aligned} V &= \pi r^2 h = 3.14 \times 15 \text{ ft} \times 15 \text{ ft} \times 8 \text{ ft} \\ &= 3.14 \times 1800 \text{ ft}^3 \\ &= 5652 \text{ ft}^3 \end{aligned}$$

Volume Calculations

Round (Cylinder) Tanks

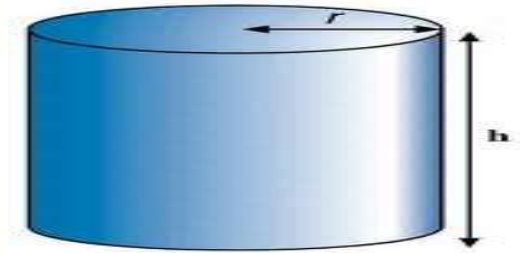

Example 3

Find the Volume in **gallons** of a tank having a diameter of 50 feet and a depth of 9 feet.

$$V = \pi r^2 h = 3.14 \times 25 \text{ ft} \times 25 \text{ ft} \times 9 \text{ ft}$$

$$= 17,662.5 \text{ ft}^3$$


$$\underline{\times 7.48 \text{ gal/ft}^3}$$

$$= 132,116 \text{ gallons}$$

Volume Calculations

Round (Cylinder) Tanks

Volume – Three Dimensions

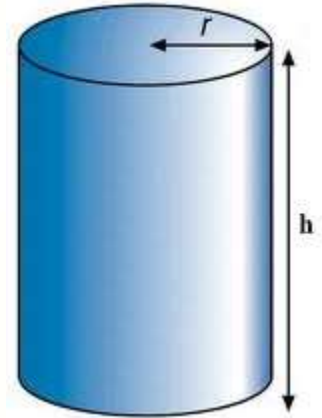


$$V = \pi r^2 h$$

$$\pi = 3.14$$

r = Radius of circle


h = Height (or Depth)

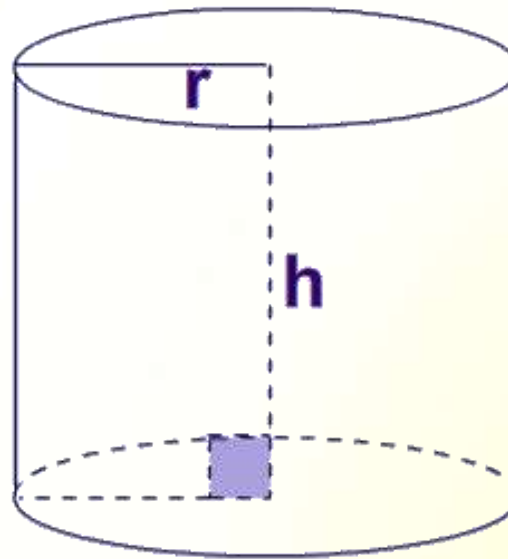

Volume Calculations

Round (Cylinder) Tanks

$$V = \pi r^2 h$$

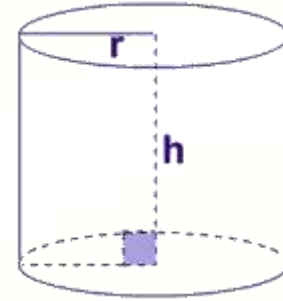

**Work Calculations on Separate Paper
Answers Given on Next Slides**

Practice 1

Find the Volume in cubic feet of a tank having a radius of 22 feet and a depth of 10 feet.

Practice 2


Find the Volume in cubic feet of a tank having a diameter of 28 feet and a depth of 7.5 feet.

Practice 3

Find the Volume in **gallons** of a tank having a diameter of 48 feet and a depth of 7 feet.

Volume Calculations

Round (Cylinder) Tanks

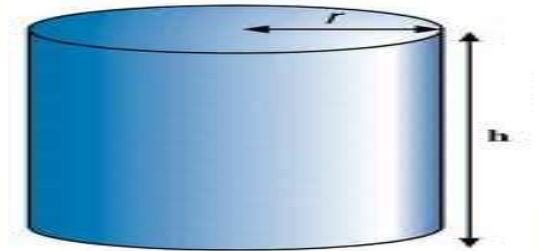


Practice 1

Find the Volume in cubic feet of a tank having a radius of 22 feet and a depth of 10 feet.

$$\begin{aligned} V &= \pi r^2 h = 3.14 \times 22 \text{ ft} \times 22 \text{ ft} \times 10 \text{ ft} \\ &= 3.14 \times 4840 \text{ ft}^3 \\ &= 15,198 \text{ ft}^3 \end{aligned}$$

Volume Calculations

Round (Cylinder) Tanks

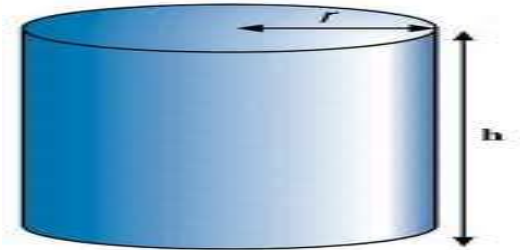


Practice 2

Find the Volume in cubic feet of a tank having a diameter of 28 feet and a depth of 7.5 feet.

$$\begin{aligned} V &= \pi r^2 h = 3.14 \times 14 \text{ ft} \times 14 \text{ ft} \times 7.5 \text{ ft} \\ &= 3.14 \times 1470 \text{ ft}^3 \\ &= 4616 \text{ ft}^3 \end{aligned}$$

Volume Calculations

Round (Cylinder) Tanks

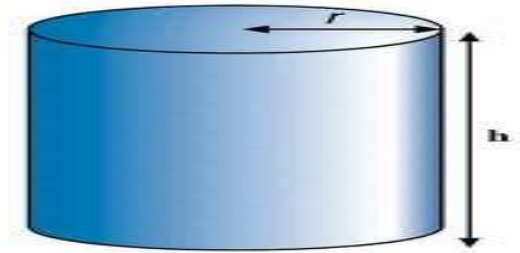

Practice 3

Find the Volume in **gallons** of a tank having a diameter of 48 feet and a depth of 7 feet.

$$V = \pi r^2 h = 3.14 \times 24 \text{ ft} \times 24 \text{ ft} \times 7 \text{ ft}$$

$$= 12,660 \text{ ft}^3$$



$$\underline{\times 7.48 \text{ gal/ft}^3}$$

$$= 94,700 \text{ gallons}$$

Volume Calculations

**What about a Round Tank
with a Cone Bottom**

?

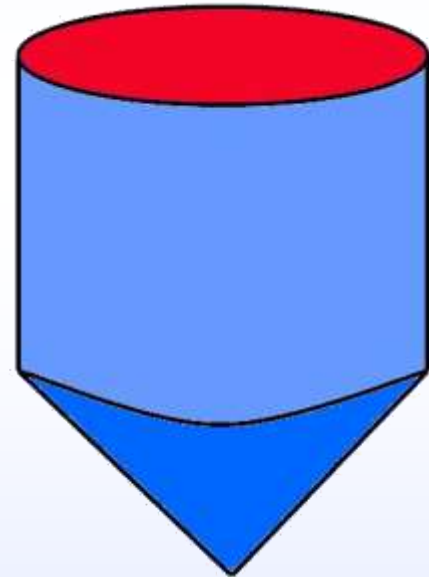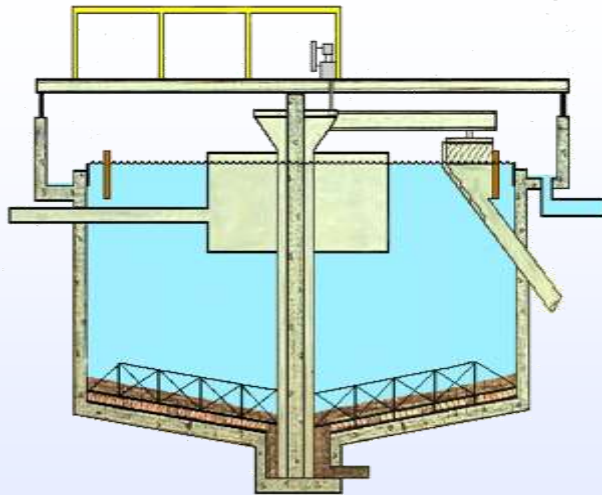


Volume Calculations

Cylinder with Cone Bottom

$$V_{\text{cylinder}} = \pi r^2 h_1$$




$$V_{\text{cone}} = \frac{1}{3} \pi r^2 h \text{ or } \frac{\pi r^2 h_2}{3}$$

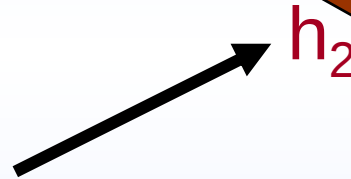

$$V_{\text{total}} = V_{\text{cylinder}} + V_{\text{cone}}$$

Volume Calculations

Cylinder with Cone Bottom

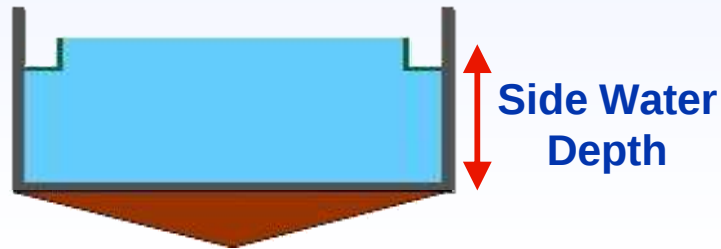

**For Secondary Clarifiers
Volume of Cone Not Considered**


**Insignificant Compared to Total Volume
(Filled with Sludge)**

Clarifier Loading


Hydraulic Loading

Detention Time (DT)

The time it takes for a drop of water to travel from inlet to outlet

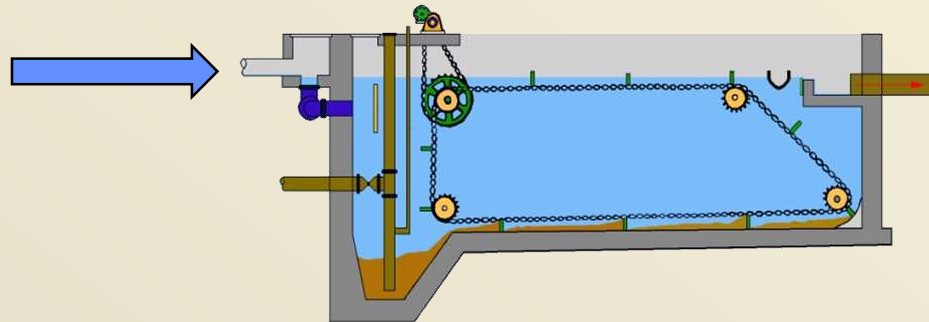


Clarifier Detention Time

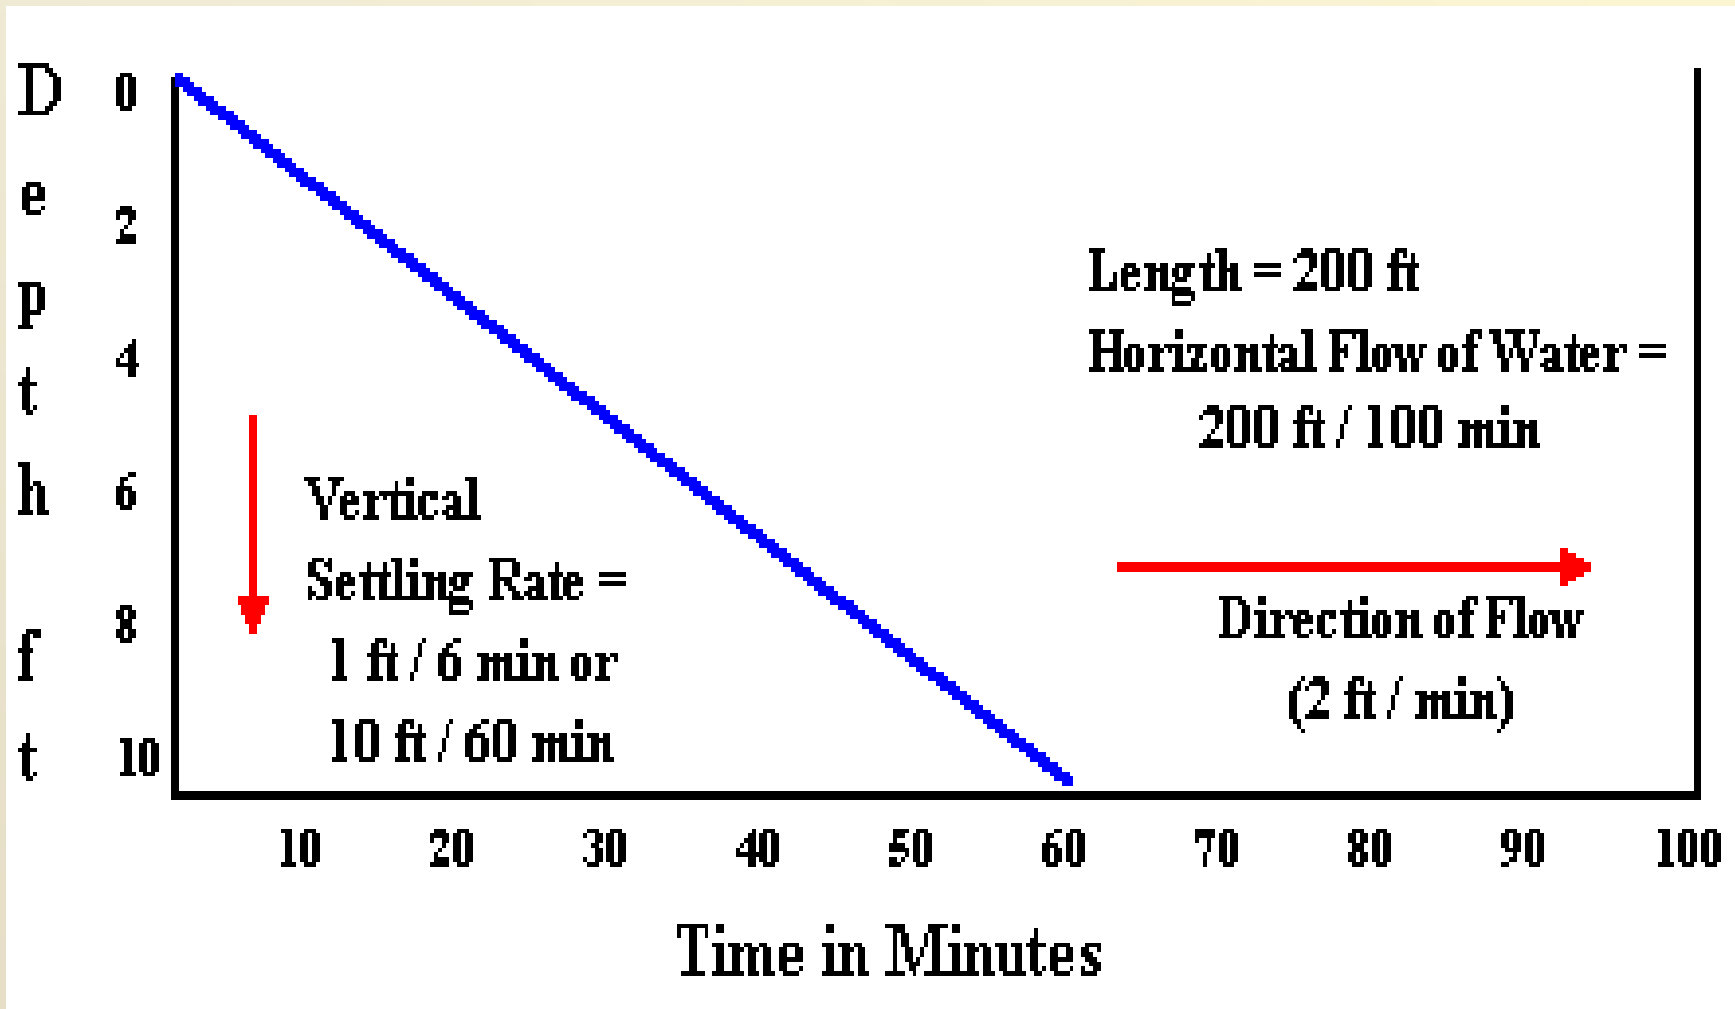

Must Have Detention Time Long Enough for Solids to Settle

Sedimentation Efficiency

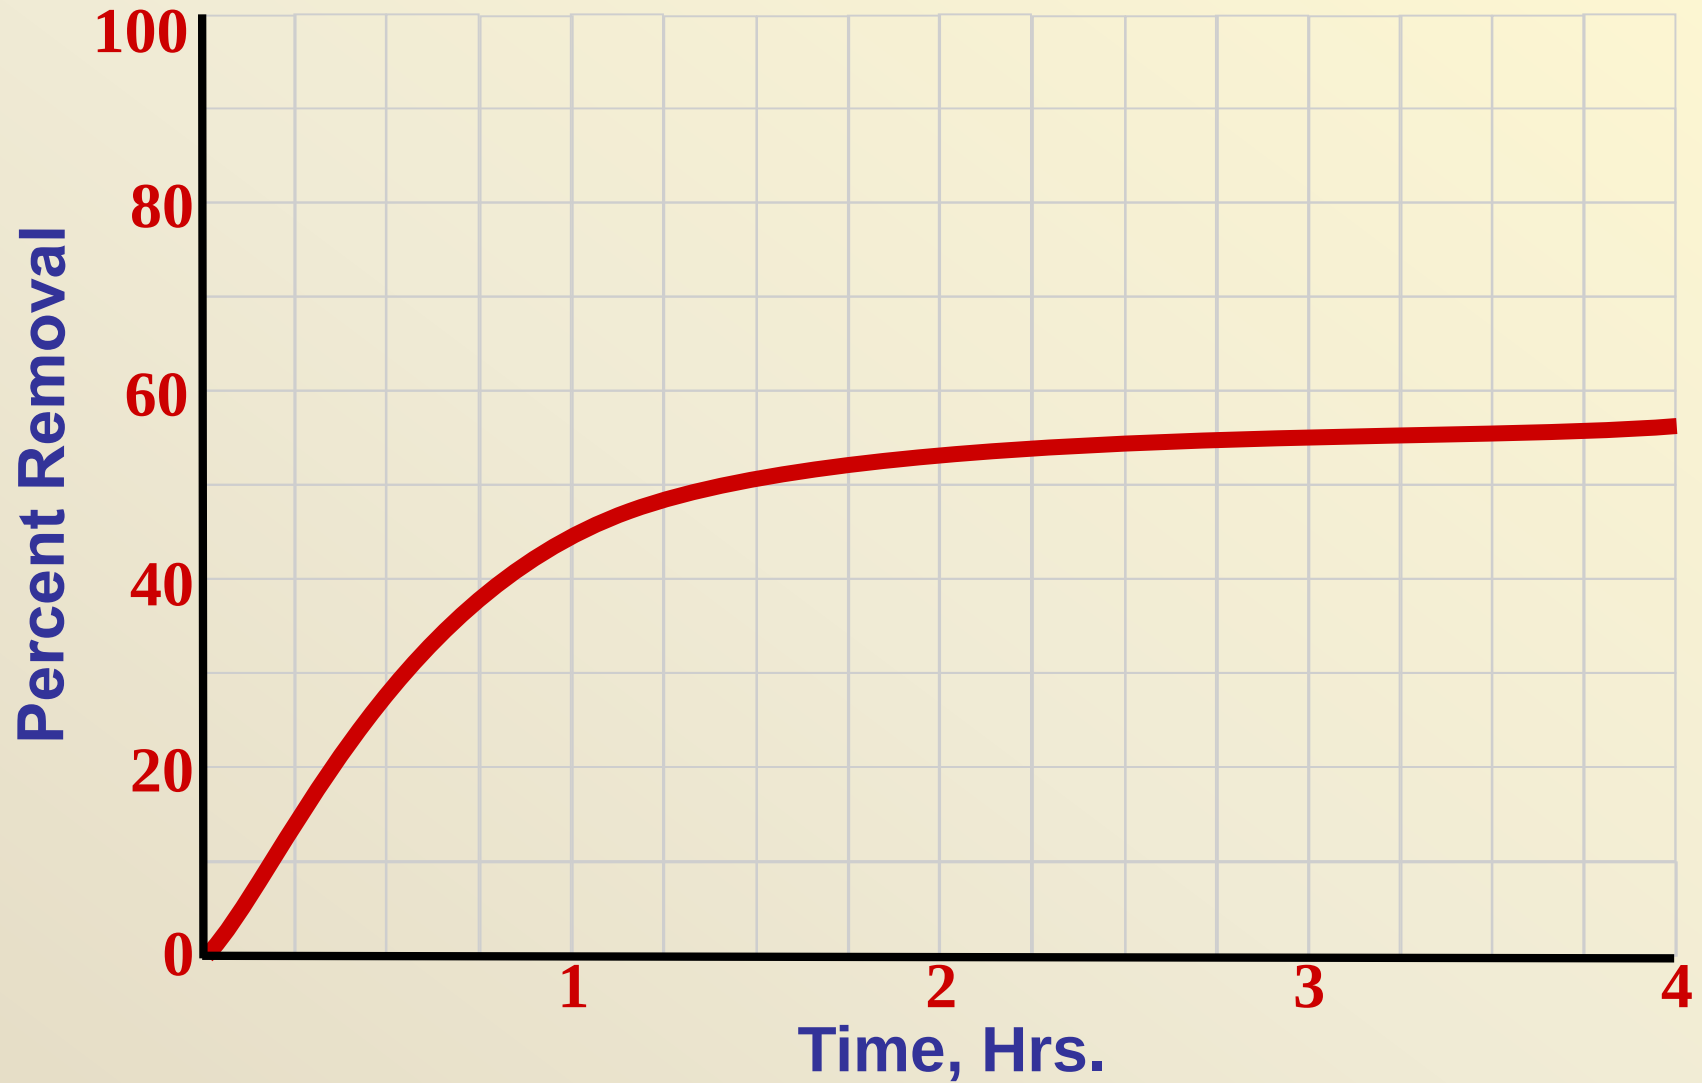

Too Long – No Increase in Removal

Clarifier Loading

Hydraulic Loading

Detention Time (DT)

The time it takes for a drop of water to travel from inlet to outlet

Typical Design Value = 2 – 3 Hours

Hydraulic Loading

$$\text{Detention Time} = \frac{\text{Tank Volume}}{\text{Influent Rate}}$$

Example 1a:

Calculate the **Detention Time** in for a clarifier with a **volume of 25,000 gallons** that receives a **flow of 310,000 gal/day**.

$$\text{Detention Time} = \frac{\text{Volume}}{\text{Flow}}$$

$$= \frac{25,000 \text{ gallons}}{310,000 \text{ gallons/day}} = 0.08 \text{ Days}$$

Hydraulic Loading

$$\text{Detention Time} = \frac{\text{Tank Volume}}{\text{Influent Rate}}$$

Example 1b:

Calculate the **Detention Time** in HOURS for a clarifier with a **volume of 25,000 gallons** that receives a **flow of 310,000 gal/day**.

$$\begin{aligned} \text{Detention Time} &= \frac{\text{Volume}}{\text{Flow}} \\ &= \frac{25,000 \text{ gallons}}{310,000 \text{ gallons/day}} = 0.08 \text{ Days} \end{aligned}$$

$$0.08 \text{ Days} \times 24 \text{ hours/days} = 1.9 \text{ Hours}$$

Clarifier Loading

Hydraulic Loading

Detention Time (DT)

The time it takes for a drop of water to travel from inlet to outlet

$$\text{Detention Time} = \frac{\text{Tank Volume}}{\text{Flow into Tank}}$$

Clarifier Loading

Hydraulic Loading

Detention Time (DT)

The time it takes for a drop of water to travel from inlet to outlet

$$\text{DT, hrs} = \frac{\text{Tank Volume, (MG or Gallons)} \times 24}{\text{Flow into Tank, (MG/D or Gal/D)}}$$

Detention Time



Example 1. Find the detention time in hours of a circular sedimentation tank having a volume of 75,000 gallons and a flow of 900,000 gallons per day.

$$\text{DT, hrs} = \frac{\text{Tank Volume, gallons} \times 24 \text{ hr/day}}{\text{Flow into Tank, gallons/day}}$$

$$\text{DT, hrs} = \frac{75,000 \text{ gallons} \times 24 \text{ hr/day}}{900,000 \text{ gallons/day}}$$

$$= 2 \text{ hour}$$

Detention Time



Example 2. Find the detention time in hours of a circular sedimentation tank having a volume of 55,000 gallons and a flow of 0.75 MGD.

$$\text{DT, hrs} = \frac{\text{Tank Volume, gallons} \times 24 \text{ hr/day}}{\text{Flow into Tank, gallons/day}}$$

$$0.75 \text{ MGD} = 750,000 \text{ gal/day}$$

Detention Time



Example 2. Find the detention time in hours of a circular sedimentation tank having a volume of 55,000 gallons and a flow of 0.75 MGD.

$$\text{DT, hrs} = \frac{\text{Tank Volume, gallons} \times 24 \text{ hr/day}}{\text{Flow into Tank, gallons/day}}$$

$$\text{DT, hrs} = \frac{55,000 \text{ gallons} \times 24 \text{ hr/day}}{750,000 \text{ gallons/day}}$$

$$= 1.8 \text{ hour}$$

Detention Time



Work Calculations on Separate Paper Answers Given on Next Slides

Practice 1. Find the detention time in hours of a clarifier having a volume of 52,000 gallons and a flow of 520,000 gallons per day.

Practice 2. Find the detention time in hours of a rectangular sedimentation tank having a volume of 16,400 gallons and a flow of 0.225 MGD.

Detention Time



Practice 1. Find the detention time in hours of a clarifier having a volume of 52,000 gallons and a flow of 520,000 gallons per day.

$$\text{DT, hrs} = \frac{\text{Tank Volume, gallons} \times 24 \text{ hr/day}}{\text{Flow into Tank, gallons/day}}$$

$$\text{DT, hrs} = \frac{52,000 \text{ gallons} \times 24 \text{ hr/day}}{520,000 \text{ gallons/day}}$$

$$= 2.4 \text{ hour}$$

Detention Time



Practice 2. Find the detention time in hours of a rectangular sedimentation tank having a volume of 16,400 gallons and a flow of 0.225 MGD.

$$\text{DT, hrs} = \frac{\text{Tank Volume, gallons} \times 24 \text{ hr/day}}{\text{Flow into Tank, gallons/day}}$$

$$0.225 \text{ MGD} = 220,000 \text{ gal/day}$$

Detention Time



Practice 2. Find the detention time in hours of a rectangular sedimentation tank having a volume of 16,400 gallons and a flow of 0.225 MGD.

$$\text{DT, hrs} = \frac{\text{Tank Volume, gallons} \times 24 \text{ hr/day}}{\text{Flow into Tank, gallons/day}}$$

$$\text{DT, hrs} = \frac{16,400 \text{ gallons} \times 24 \text{ hr/day}}{225,000 \text{ gallons/day}}$$

$$= 1.75 \text{ hour}$$

Clarifier Loading

Hydraulic Loading

Detention Time (DT)

The time it takes for a drop of water to travel from inlet to outlet

$$\text{Detention Time} = \frac{\text{Tank Volume}}{\text{Flow into Tank}}$$

$$\text{DT, hrs} = \frac{\text{Tank Volume, (MG or Gallons)} \times 24}{\text{Flow into Tank, (MG/D or Gal/D)}}$$

Typical Design Value = 2 – 3 Hours

Clarifier Loading


Hydraulic Loading

Surface Overflow Rate (SOR)

OR

Surface Loading Rate (SLR)

The flow in gallons per day into the clarifier per square foot of surface area

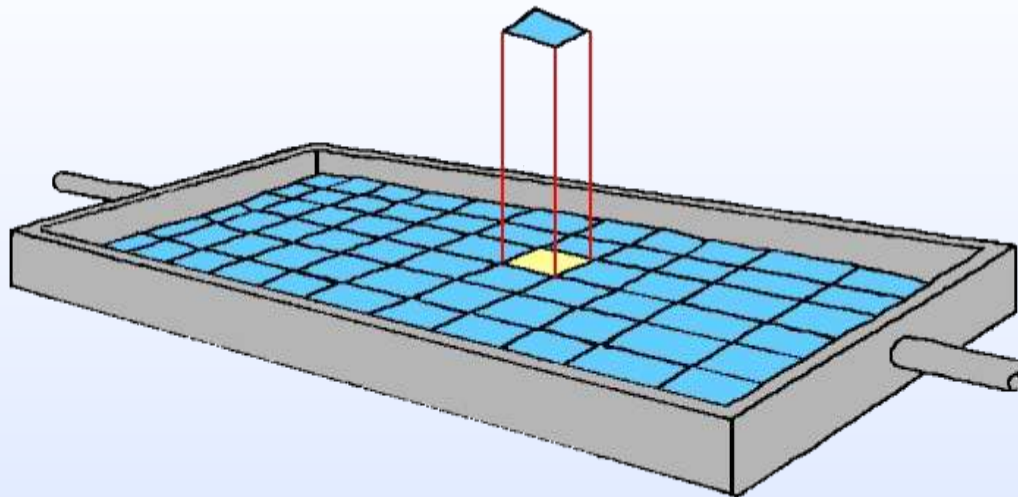

Clarifier Loading

Hydraulic Loading

Surface Overflow Rate (SOR)

OR

Surface Loading Rate (SLR)

The flow in gallons per day into the clarifier per square foot of surface area

$$\text{SOR, gpd/ft}^2 = \frac{\text{Flow, gallons/day}}{\text{Surface Area, ft}^2}$$

Clarifier Loading

Hydraulic Loading

Surface Overflow Rate (SOR)

$$\text{SOR, gpd/ft}^2 = \frac{\text{Flow, gallons/day}}{\text{Surface Area, ft}^2}$$

Need:

Flow in gallons/day

and

Surface Area, ft²

$$SA = L \times W$$

$$SA = \pi r^2$$

Clarifier Loading

Hydraulic Loading

Surface Overflow Rate (SOR)

$$\text{SOR, gpd/ft}^2 = \frac{\text{Flow, gallons/day}}{\text{Surface Area, ft}^2}$$

Typical Design Value = 400 - 800 gal/day/ft²

Clarifier Loading

Hydraulic Loading - Surface Overflow Rate (SOR)

Example 1.

Calculate the Surface Overflow Rate for a clarifier that is 50 ft long, 15 ft wide, 12 ft deep, and receives a flow of 338,000 gallons per day.

$$\text{SOR, gpd/ft}^2 = \frac{\text{Flow, gallons/day}}{\text{Surface Area, ft}^2}$$

$$\text{Surface Area, ft}^2 = 50 \text{ ft} \times 15 \text{ ft} = 750 \text{ ft}^2$$

$$\text{SOR, gpd/ft}^2 = \frac{338,000 \text{ gallons per day}}{750 \text{ ft}^2}$$

$$= 451 \text{ gpd/ft}^2$$

Clarifier Loading

Hydraulic Loading - Surface Overflow Rate (SOR)

Example 2.

Calculate the Surface Overflow Rate for a clarifier that has a diameter of 60 ft, and receives an influent flow of 1.65 MGD.

$$\text{SOR, gpd/ft}^2 = \frac{\text{Flow, gallons/day}}{\text{Surface Area, ft}^2}$$

$$\text{Flow, gallons/day} = 1.65 \text{ MGD} \times 1,000,000$$

$$= 1,650,000 \text{ gallons per day}$$

$$\text{Surface Area, ft}^2 = \pi r^2 = 3.14 \times 30 \text{ ft} \times 30 \text{ ft}$$

$$= 2826 \text{ ft}^2$$

Clarifier Loading

Hydraulic Loading - Surface Overflow Rate (SOR)

Example 2.

Calculate the Surface Overflow Rate for a clarifier that has a diameter of 60 ft, and receives an influent flow of 1.65 MGD.

$$\text{SOR, gpd/ft}^2 = \frac{\text{Flow, gallons/day}}{\text{Surface Area, ft}^2}$$

$$\text{SOR, gpd/ft}^2 = \frac{1,650,000 \text{ gallons per day}}{2826 \text{ ft}^2}$$

$$= 584 \text{ gpd/}$$



Clarifier Loading

Hydraulic Loading - **Surface Overflow Rate (SOR)**

**Work Calculations on Separate Paper
Answers Given on Next Slides**

Practice 1.

Calculate the Surface Overflow Rate for a clarifier that is **35 ft long**, **9 ft wide**, **7 ft deep**, and receives a flow of **235,000 gallons** per day.

Practice 2.

Calculate the Surface Overflow Rate for a clarifier that has a **diameter of 45 ft.** and receives an influent **flow of 0.65 MGD.**

Clarifier Loading

Hydraulic Loading - Surface Overflow Rate (SOR)

Practice 1.

Calculate the Surface Overflow Rate for a clarifier that is **35 ft long**, **9 ft wide**, **7 ft deep**, and receives a flow of **235,000 gallons** per day.

$$\text{SOR, gpd/ft}^2 = \frac{\text{Flow, gallons/day}}{\text{Surface Area, ft}^2}$$

$$\text{Surface Area, ft}^2 = 35 \text{ ft} \times 9 \text{ ft} = 315 \text{ ft}^2$$

$$\text{SOR, gpd/ft}^2 = \frac{235,000 \text{ gallons per day}}{315 \text{ ft}^2}$$

$$= 746 \text{ gpd/ft}^2$$

Clarifier Loading

Hydraulic Loading - Surface Overflow Rate (SOR)

Practice 2.

Calculate the Surface Overflow Rate for a clarifier that has a diameter of 45 ft. and receives an influent flow of 0.65 MGD.

$$\text{SOR, gpd/ft}^2 = \frac{\text{Flow, gallons/day}}{\text{Surface Area, ft}^2}$$

$$\text{Flow, gallons/day} = 0.65 \text{ MGD} \times 1,000,000$$

$$= 650,000 \text{ gallons per day}$$

$$\text{Surface Area, ft}^2 = \pi r^2 = 3.14 \times 22.5 \text{ ft} \times 22.5 \text{ ft}$$

$$= 1590 \text{ ft}^2$$

Clarifier Loading

Hydraulic Loading - Surface Overflow Rate (SOR)

Practice 2.

Calculate the Surface Overflow Rate for a clarifier that has a diameter of 45 ft, and receives an influent flow of 0.65 MGD.

$$\text{SOR, gpd/ft}^2 = \frac{\text{Flow, gallons/day}}{\text{Surface Area, ft}^2}$$

$$\text{SOR, gpd/ft}^2 = \frac{650,000 \text{ gallons per day}}{1590 \text{ ft}^2}$$

$$= 409 \text{ gpd/ft}^2$$

Clarifier Loading

Hydraulic Loading

Surface Overflow Rate (SOR)

$$\text{SOR, gpd/ft}^2 = \frac{\text{Flow, gallons/day}}{\text{Surface Area, ft}^2}$$

Typical Design Value = 300 - 1200 gal/day/ft²
(800 gal/day/ft²)

Clarifier Loading

Hydraulic Loading

Weir Overflow Rate (WOR)

The flow in gallons per day per
linear foot of weir

$$\text{WOR, gal/d/ft} = \frac{\text{Flow, gallons/day}}{\text{Length of Weir, ft}}$$


Typical Design Value = ~10,000 gal/day/ft

Clarifier Loading

Hydraulic Loading - Weir Overflow Rate (WOR)

$$\text{WOR, gal/d/ft} = \frac{\text{Flow, gallons/day}}{\text{Length of Weir, ft}}$$

Rectangular Tanks - Length of Weir, ft

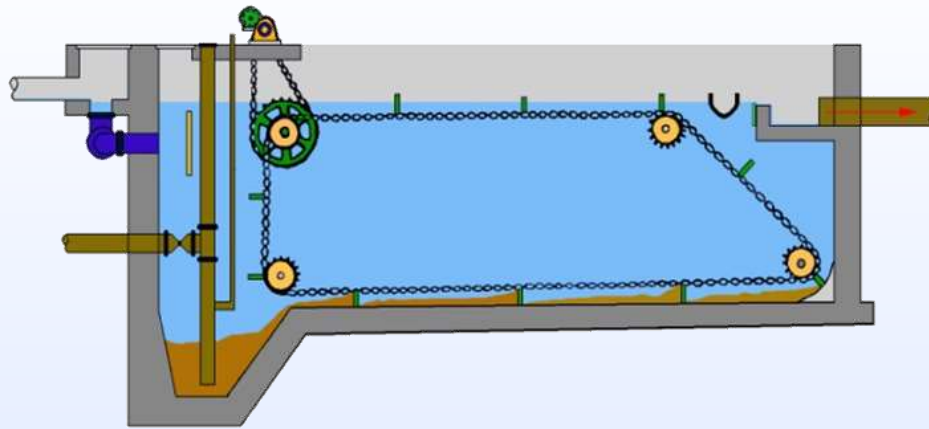


Clarifier Loading

Hydraulic Loading - Weir Overflow Rate (WOR)


$$\text{WOR, gal/d/ft} = \frac{\text{Flow, gallons/day}}{\text{Length of Weir, ft}}$$

Rectangular Tanks - Length of Weir, ft


= Width

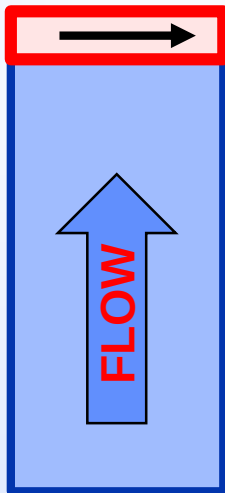

= 2 X Width

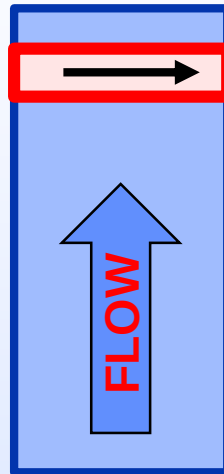

= 4 X Width

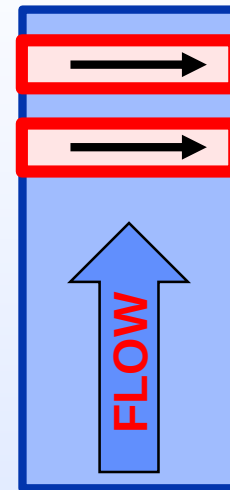

Clarifier Loading


Hydraulic Loading - Weir Overflow Rate (WOR)

Example 1

A primary clarifier is 20 feet wide, 60 feet long, and has a SWD of 12 feet. The clarifier has two effluent troughs across the width that allow the water to flow over both sides of each trough. The average flow to the clarifier is 0.65 MGD. Calculate the weir over flow rate for this clarifier.

$$\text{WOR, gal/d/ft} = \frac{\text{Flow, gallons/day}}{\text{Length of Weir, ft}}$$

$$\text{Flow, gallons/day} = 0.65 \text{ MGD} \times 1,000,000 = 650,000 \text{ gal/day}$$

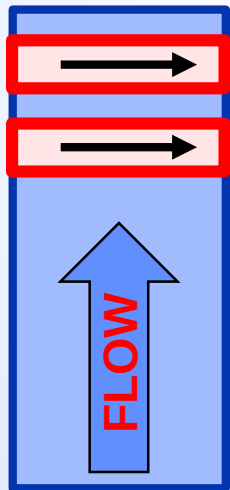

$$\text{Length of Weir, ft} = 4 \times \text{Width}$$

$$= 4 \times 20 \text{ ft}$$

$$= 80 \text{ ft}$$

Clarifier Loading

Hydraulic Loading - Weir Overflow Rate (WOR)


Example 1

A primary clarifier is 12 feet wide, 40 feet long, and has a SWD of 8 feet. The clarifier has two effluent troughs across the width that allow the water to flow over both sides of each trough. The average flow to the clarifier is 0.65 MGD. Calculate the weir over flow rate for this clarifier.

$$\text{WOR, gal/d/ft} = \frac{\text{Flow, gallons/day}}{\text{Length of Weir, ft}}$$

$$= \frac{650,000 \text{ gal/day}}{80 \text{ ft}}$$

$$= 8,125 \text{ gal/day/ft}$$

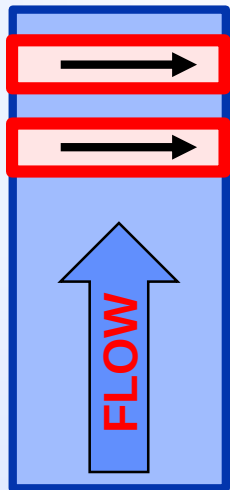

Clarifier Loading

Hydraulic Loading - Weir Overflow Rate (WOR)

$$\text{WOR, gal/d/ft} = \frac{\text{Flow, gallons/day}}{\text{Length of Weir, ft}}$$

Work Calculations on Separate Paper Answers Given on Next Slides

Practice 1

A primary clarifier is 18 feet wide, 45 feet long, and has a SWD of 9 feet. The clarifier has an effluent trough across the end. The average flow to the clarifier is 0.085 MGD. Calculate the weir over flow rate for this clarifier.

Practice 2

A primary clarifier is 12 foot wide, 40 foot long, and has a SWD of 8 feet. The clarifier has two effluent troughs across the width that allow the water to flow over both sides of each trough. The average flow to the clarifier is 0.41 MGD. Calculate the weir over flow rate for this clarifier.

Clarifier Loading


Hydraulic Loading - Weir Overflow Rate (WOR)

Practice 1

A primary clarifier is 18 feet wide, 45 feet long, and has a SWD of 9 feet. The clarifier has an effluent trough across the end. The average flow to the clarifier is 0.085 MGD. Calculate the weir over flow rate for this clarifier.

$$\text{WOR, gal/d/ft} = \frac{\text{Flow, gallons/day}}{\text{Length of Weir, ft}}$$

$$\text{Flow, gallons/day} = 0.085 \text{MGD} \times 1,000,000 = 85,000 \text{ gal/day}$$

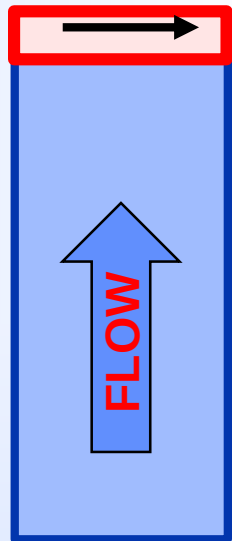

$$\text{Length of Weir, ft} = \text{Width}$$

$$\text{WOR, gal/d/ft} = \frac{85,000 \text{ gal/day}}{9 \text{ ft}}$$

$$= 9,444 \text{ gal/day/ft}$$

Clarifier Loading


Hydraulic Loading - Weir Overflow Rate (WOR)

Practice 2

A primary clarifier is 12 foot wide, 40 foot long, and has a SWD of 8 feet. The clarifier has two effluent troughs across the width that allow the water to flow over both sides of each trough. The average flow to the clarifier is 0.41 MGD. Calculate the weir over flow rate for this clarifier.

$$\text{WOR, gal/d/ft} = \frac{\text{Flow, gallons/day}}{\text{Length of Weir, ft}}$$

$$\text{Flow, gallons/day} = 0.41 \text{ MGD} \times 1,000,000 = 410,000 \text{ gal/day}$$

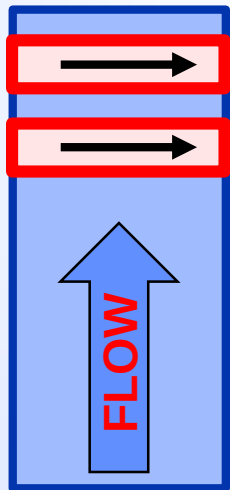

$$\begin{aligned} \text{Length of Weir, ft} &= 4 \times \text{Width} \\ &= 4 \times 12 \text{ ft} \\ &= 48 \text{ ft} \end{aligned}$$

Clarifier Loading

Hydraulic Loading - Weir Overflow Rate (WOR)


Practice 2

A primary clarifier is 12 foot wide, 40 foot long, and has a SWD of 8 feet. The clarifier has two effluent troughs across the width that allow the water to flow over both sides of each trough. The average flow to the clarifier is 0.41 MGD. Calculate the weir over flow rate for this clarifier.

$$\text{WOR, gal/d/ft} = \frac{\text{Flow, gallons/day}}{\text{Length of Weir, ft}}$$

$$= \frac{410,000 \text{ gal/day}}{48 \text{ ft}}$$

$$= 8,542 \text{ gal/day/ft}$$

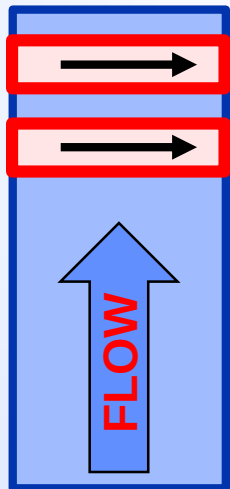


Clarifier Loading

Hydraulic Loading - Weir Overflow Rate (WOR)

$$\text{WOR, gal/d/ft} = \frac{\text{Flow, gallons/day}}{\text{Length of Weir, ft}}$$


Weir Length for a Circular Clarifier ?

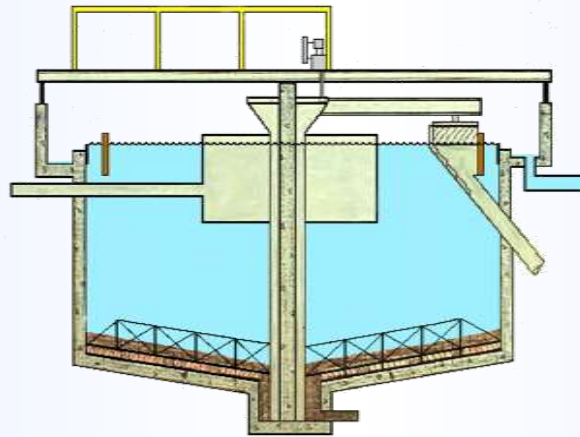

Surface Area Calculations

Circles


**Circumference =
distance around circle**

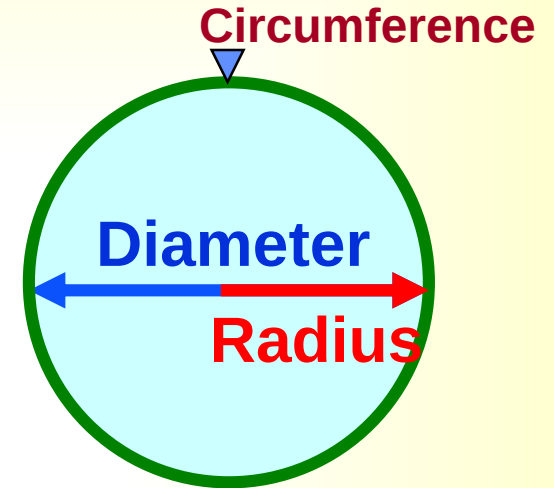

Surface Area Calculations

Circles

Circumference =
distance around circle

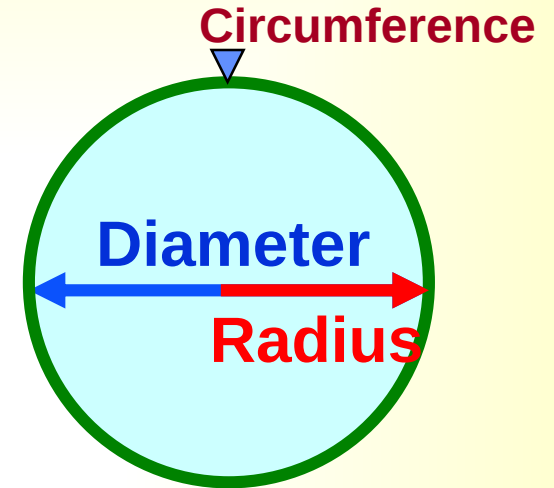


$$\frac{\text{Circumference}}{\text{Diameter}} = \frac{C}{D} = \pi = 3.14 \text{ for any circle}$$

$$C = \pi D$$

Surface Area Calculations

Circles

Circumference =
distance around circle

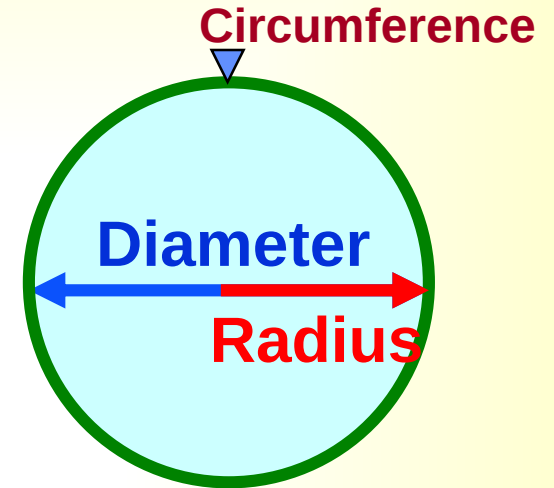

For Weir Length

D = Diameter of the Weir

(May Not be same as Tank)



$$C = \pi D$$

Clarifier Loading

Hydraulic Loading - Weir Overflow Rate (WOR)

$$\text{WOR, gal/d/ft} = \frac{\text{Flow, gallons/day}}{\text{Length of Weir, ft}}$$

Weir Length for a Circular Clarifier

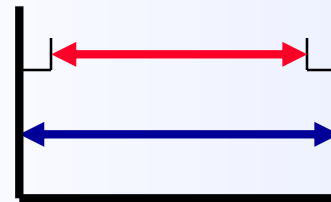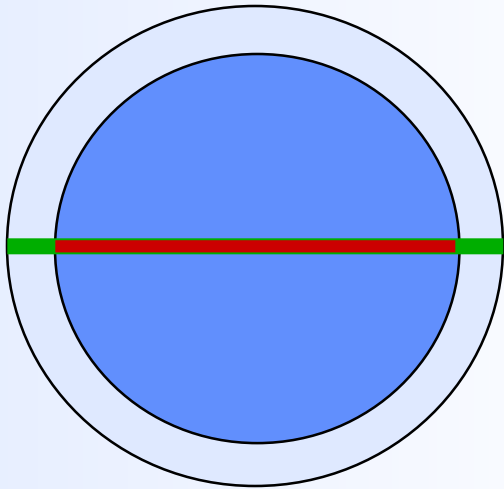


Clarifier Loading

Hydraulic Loading - Weir Overflow Rate (WOR)

Example 1.

The flow to a circular clarifier is **690,000 gallons per day**. The clarifier is 24 feet in diameter with the weirs set 1 foot from the outside wall, for a **weir diameter of 22 feet**. Calculate the weir overflow rate.

$$\text{WOR, gal/d/ft} = \frac{\text{Flow, gallons/day}}{\text{Length of Weir, ft}}$$

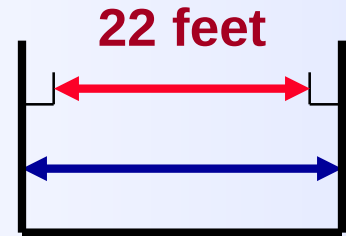

$$\text{Length of Weir, ft} = \pi \times \text{Weir Diameter}$$

$$= 3.14 \times 22 \text{ ft}$$

$$= 69.08 \text{ ft}$$


Clarifier Loading

Hydraulic Loading - Weir Overflow Rate (WOR)

Example 1.

The flow to a circular clarifier is **690,000 gallons per day**. The clarifier is 24 feet in diameter with the weirs set 1 foot from the outside wall, for a **weir diameter of 22 feet**. Calculate the weir overflow rate.

$$\text{WOR, gal/d/ft} = \frac{\text{Flow, gallons/day}}{\text{Length of Weir, ft}}$$

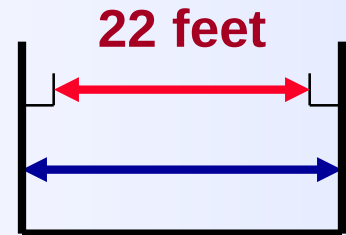

$$\text{WOR, gpd/ft} = \frac{690,000 \text{ gpd}}{69.08 \text{ ft}}$$


$$= 9,988 \text{ gpd/ft}$$

Hydraulic Loading - Weir Overflow Rate (WOR)

Example 2.

The flow to a circular clarifier is 1.65 MGD. The clarifier is 60 feet in diameter with the weir set in 1 foot from the outside wall. Calculate the weir overflow rate.

$$\text{WOR, gal/d/ft} = \frac{\text{Flow, gallons/day}}{\text{Length of Weir, ft}}$$

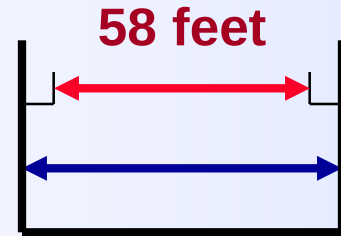

$$\begin{aligned}\text{Length of Weir, ft} &= \pi \times \text{Weir Diameter} \\ &= 3.14 \times 58 \text{ ft} \\ &= 182 \text{ ft}\end{aligned}$$

$$\text{WOR, gpd/ft} = \frac{1,650,000 \text{ gpd}}{182 \text{ ft}} = 9,066 \text{ gpd/ft}$$

Hydraulic Loading - Weir Overflow Rate (WOR)

Work Calculations on Separate Paper Answers Given on Next Slides

Practice 1.

The flow to a circular clarifier is 0.80 MGD. The clarifier is 30 feet in diameter with the weir set in 1 foot from the outside wall. Calculate the weir overflow rate.

Practice 2.

The flow to a circular clarifier is 1.4 MGD. The clarifier is 54 feet in diameter with the weir set in 1 foot from the outside wall. Calculate the weir overflow rate.

Practice 3.


The flow to a circular clarifier is 2.1 MGD. The clarifier is 75 feet in diameter with the weir set in 18 inches from the outside wall. Calculate the weir overflow rate.

Hydraulic Loading - Weir Overflow Rate (WOR)

Practice 1.

The flow to a circular clarifier is 0.80 MGD. The clarifier is 30 feet in diameter with the weir set in 1 foot from the outside wall. Calculate the weir overflow rate.

$$\text{WOR, gal/d/ft} = \frac{\text{Flow, gallons/day}}{\text{Length of Weir, ft}}$$

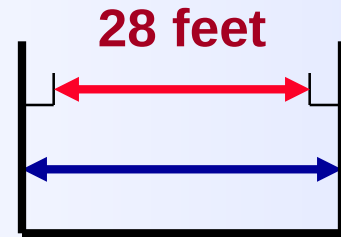

$$\begin{aligned}\text{Length of Weir, ft} &= \pi \times \text{Weir Diameter} \\ &= 3.14 \times 28 \text{ ft} \\ &= 88 \text{ ft}\end{aligned}$$


$$\text{WOR, gpd/ft} = \frac{800,000 \text{ gpd}}{88 \text{ ft}} = 9,091 \text{ gpd/ft}$$

Hydraulic Loading - Weir Overflow Rate (WOR)

Practice 2.

The flow to a circular clarifier is 1.4 MGD. The clarifier is 54 feet in diameter with the weir set in 1 foot from the outside wall. Calculate the weir overflow rate.

$$\text{WOR, gal/d/ft} = \frac{\text{Flow, gallons/day}}{\text{Length of Weir, ft}}$$

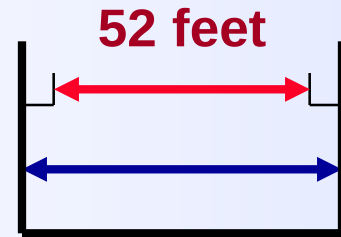

$$\begin{aligned}\text{Length of Weir, ft} &= \pi \times \text{Weir Diameter} \\ &= 3.14 \times 52 \text{ ft} \\ &= 163 \text{ ft}\end{aligned}$$


$$\text{WOR, gpd/ft} = \frac{1,400,000 \text{ gpd}}{163 \text{ ft}} = 8,589 \text{ gpd/ft}$$

Hydraulic Loading - Weir Overflow Rate (WOR)

Practice 3.

The flow to a circular clarifier is 2.1 MGD. The clarifier is 75 feet in diameter with the weir set in 18 inches from the outside wall. Calculate the weir overflow rate.

$$\text{WOR, gal/d/ft} = \frac{\text{Flow, gallons/day}}{\text{Length of Weir, ft}}$$

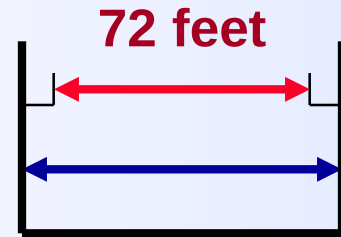

$$\begin{aligned}\text{Length of Weir, ft} &= \pi \times \text{Weir Diameter} \\ &= 3.14 \times 72 \text{ ft} \\ &= 226 \text{ ft}\end{aligned}$$


$$\text{WOR, gpd/ft} = \frac{2,100,000 \text{ gpd}}{226 \text{ ft}} = 9,292 \text{ gpd/ft}$$

Clarifier Loading

Hydraulic Loading

Weir Overflow Rate (WOR)

The flow in gallons per day per linear foot of weir

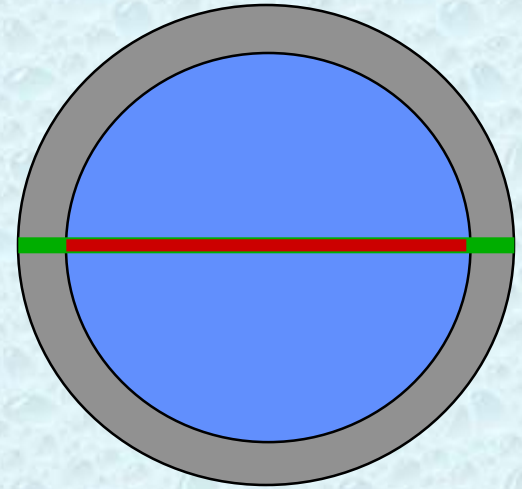

$$\text{WOR, gal/d/ft} = \frac{\text{Flow, gallons/day}}{\text{Length of Weir, ft}}$$

Typical Design Value = ~10,000 gal/day/ft

Clarifier Loading

Solids Loading - Solids Loading Rate (SLR)

The pounds per day of solids in the clarifier influent per square foot of surface area

$$\text{SLR, lbs/d/ft}^2 = \frac{\text{Solids, lbs/day}}{\text{Surface Area, ft}^2}$$

Same Calculations as for
Hydraulic Loading


$$SA = L \times W$$

$$SA = \pi r^2$$

Clarifier Loading

Solids Loading - Solids Loading Rate (SLR)

The pounds per day of solids in the clarifier influent per square foot of surface area

$$\text{SLR, lbs/d/ft}^2 = \frac{\text{Solids, lbs/day}}{\text{Surface Area, ft}^2}$$


“Pounds Equation”

“Pounds Equation”

Pounds =

Conc. x Flow (or Volume) x 8.34 Lbs/gallon

Concentration
Of STUFF
In the
Water

X

Quantity
Of Water
The STUFF
Is In

X

Weight
Of The
Water

“Pounds Equation”

Flow (volume) and concentration must be expressed in specific units.

Flow or volume must be expressed as **millions of gallons**:

$$\frac{\text{gallons}}{1,000,000 \text{ gal/MG}} = \text{MG}$$

i.e.) A tank contains 1,125,000 gallons of water. How many **million gallons** are there?

$$\frac{1,125,000 \text{ gal}}{1,000,000 \text{ gal/MG}} = 1.125 \text{ MG}$$

“Pounds Equation”

Concentration must be expressed
as **parts per million parts**.

Concentration usually reported as
milligrams per liter.

This unit is equivalent to **ppm**.

$$\frac{1 \text{ mg}}{\text{liter}} = \frac{1 \text{ mg}}{1000 \text{ grams}} = \frac{1 \text{ mg}}{1,000,000 \text{ mg}} = \text{ppm}$$

$$\text{ppm} = \frac{\text{Parts}}{\text{Mil Parts}} = \frac{\text{Lbs.}}{\text{Mil Lbs.}}$$

“Pounds Equation”

When **flow** (volume) is expressed as **MG** and conc. is in ppm, the units cancel to leave only pounds.

Lbs. =

Concentration x Flow (or volume) x 8.34 lbs/gallon

$$\frac{\cancel{\text{Lbs.}}}{\cancel{\text{M}} \cancel{\text{Lbs.}}} \times \cancel{\text{M}} \cancel{\text{gal}} \times \frac{\text{Lbs.}}{\cancel{\text{gal}}}$$


“Pounds Equation”

If the **flow** rate is entered in M gal per day (MG/D), the answer will be in **lbs/day**.

Example:

The flow to a clarifier is **1.2 MGD** and the concentration of suspended solids in the flow is **2500 mg/L**. How many **pounds** of suspended solids come into the clarifier each day?

$$\text{Lbs/day} = \text{conc. (mg/L)} \times \text{flow (MGD)} \times \frac{8.34 \text{ lbs}}{\text{gal}}$$

$$\text{Lbs/day} = 2500 \text{ mg/L} \times \frac{1,200,000 \text{ gal/day}}{1,000,000 \text{ gal/MG}} \times \frac{8.34 \text{ lbs}}{\text{gal}}$$

$$= 2500 \times 1.2 \times 8.34$$


$$= 25,020 \text{ Lbs/day}$$

Clarifier Loading

Solids Loading - Solids Loading Rate (SLR)

The pounds per day of solids in the clarifier influent per square foot of surface area

$$\text{SLR, lbs/d/ft}^2 = \frac{\text{Solids, lbs/day}}{\text{Surface Area, ft}^2}$$

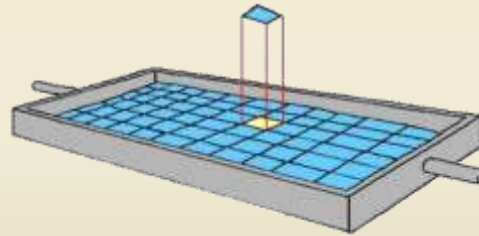

Typical Design Value = Max 30 lbs/d/ft²

Clarifier Loading

Solids Loading - Solids Loading Rate (SLR)

Example 1.

Calculate the Solids Loading Rate for a clarifier with a 50 ft diameter and a depth of 12 feet, and receives a flow of 2.4 MGD with a suspended solids concentration of 1800 mg/L.

$$\text{SLR, lbs/d/ft}^2 = \frac{\text{Solids, lbs/day}}{\text{Surface Area, ft}^2}$$

Solids, lbs/day =

$$1800 \text{ mg/L} \times 2.4 \text{ MGD} \times 8.34 \text{ lbs/gal} = 36,029 \text{ lbs/d}$$

$$\text{SA} = 3.14 \times 25 \text{ ft} \times 25 \text{ ft} = 1962.5 \text{ ft}^2$$

$$\text{SLR, lbs/d/ft}^2 = \frac{36,029 \text{ lbs/day}}{1962.5 \text{ ft}^2} = 18.4 \text{ lbs/d/ft}^2$$

Clarifier Loading

Solids Loading - Solids Loading Rate (SLR)

Example 2.

Calculate the Solids Loading Rate for a clarifier with a 31 ft diameter and a depth of 9 feet, and receives a flow of 750,000 gallons per day with a suspended solids concentration of 2600 mg/L.

$$\text{SLR, lbs/d/ft}^2 = \frac{\text{Solids, lbs/day}}{\text{Surface Area, ft}^2}$$

Solids, lbs/day =

$$2600 \text{ mg/L} \times 0.75 \text{ MGD} \times 8.34 \text{ lbs/gal} = 16,263 \text{ lbs/d}$$

$$\text{SA} = 3.14 \times 15.5 \text{ ft} \times 15.5 \text{ ft} = 754 \text{ ft}^2$$

$$\text{SLR, lbs/d/ft}^2 = \frac{16,263 \text{ lbs/day}}{754 \text{ ft}^2} = 21.6 \text{ lbs/d/ft}^2$$

Clarifier Loading

Solids Loading - Solids Loading Rate (SLR)

**Work Calculations on Separate Paper
Answers Given on Next Slides**

Practice 1.

Calculate the Solids Loading Rate for a clarifier with a 12 ft width and a length of 50 feet, and receives a flow of 600,000 gallons per day with a suspended solids concentration of 3400 mg/L.

Practice 2.

Calculate the Solids Loading Rate for a clarifier with a 22 ft radius and a depth of 8.5 feet, and receives a flow of 1,450,000 gallons per day with a suspended solids concentration of 3400 mg/L.

Practice 3.

Calculate the Solids Loading Rate for a clarifier with a 22 ft diameter and a depth of 7 feet, and receives a flow of 0.82 MGD with a suspended solids concentration of 1950 mg/L.

Clarifier Loading

Solids Loading - Solids Loading Rate (SLR)

Practice 1.

Calculate the Solids Loading Rate for a clarifier with a 12 ft width and a length of 50 feet, and receives a flow of 600,000 gallons per day with a suspended solids concentration of 3400 mg/L.

$$\text{SLR, lbs/d/ft}^2 = \frac{\text{Solids, lbs/day}}{\text{Surface Area, ft}^2}$$

$$3400 \text{ mg/L} \times 0.6 \text{ MGD} \times 8.34 \text{ lbs/gal} = 17,014 \text{ lbs/d}$$

$$\text{SA} = 12 \text{ ft} \times 50 \text{ ft} = 600 \text{ ft}^2$$

$$\text{SLR, lbs/d/ft}^2 = \frac{17,014 \text{ lbs/day}}{600 \text{ ft}^2} = 28.4 \text{ lbs/d/ft}^2$$

Clarifier Loading

Solids Loading - Solids Loading Rate (SLR)

Practice 2.

Calculate the Solids Loading Rate for a clarifier with a 22 ft radius and a depth of 8.5 feet, and receives a flow of 1,450,000 gallons per day with a suspended solids concentration of 3400 mg/L.

$$\text{SLR, lbs/d/ft}^2 = \frac{\text{Solids, lbs/day}}{\text{Surface Area, ft}^2}$$

$$3400 \text{ mg/L} \times 1.45 \text{ MGD} \times 8.34 \text{ lbs/gal} = 41,116 \text{ lbs/d}$$

$$\text{SA} = 3.14 \times 22 \text{ ft} \times 22 \text{ ft} = 1520 \text{ ft}^2$$

$$\text{SLR, lbs/d/ft}^2 = \frac{41,116 \text{ lbs/day}}{1520 \text{ ft}^2} = 27.1 \text{ lbs/d/ft}^2$$

Clarifier Loading

Solids Loading - Solids Loading Rate (SLR)

Practice 3.

Calculate the Solids Loading Rate for a clarifier with a 22 ft diameter and a depth of 7 feet, and receives a flow of 0.82 MGD with a suspended solids concentration of 1950 mg/L.

$$\text{SLR, lbs/d/ft}^2 = \frac{\text{Solids, lbs/day}}{\text{Surface Area, ft}^2}$$

$$1950 \text{ mg/L} \times 0.82 \text{ MGD} \times 8.34 \text{ lbs/gal} = 13,336 \text{ lbs/d}$$

$$\text{SA} = 3.14 \times 11 \text{ ft} \times 11 \text{ ft} = 380 \text{ ft}^2$$


$$\text{SLR, lbs/d/ft}^2 = \frac{13,336 \text{ lbs/day}}{380 \text{ ft}^2} = 35.1 \text{ lbs/d/ft}^2$$

Clarifier Loading

Solids Loading - Solids Loading Rate (SLR)

The pounds per day of solids in the clarifier influent per square foot of surface area

$$\text{SLR, lbs/d/ft}^2 = \frac{\text{Solids, lbs/day}}{\text{Surface Area, ft}^2}$$

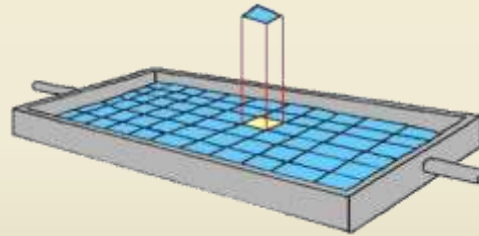

Typical Design Value = 25 - 30 lbs/d/ft²

Clarifier Loading Calculations

Detention Time (DT)

$$\text{DT, hrs} = \frac{\text{Tank Volume, MG} \times 24}{\text{Flow into Tank, MGD}}$$

Typical Design Value = 2 – 3 Hours

Surface Overflow Rate (SOR)

$$\text{SOR, gpd/ft}^2 = \frac{\text{Flow, gallons/day}}{\text{Surface Area, ft}^2}$$

Typical Design Value = 400 - 800 gal/d/ft²

Weir Overflow Rate (WOR)

$$\text{WOR, gal/d/ft} = \frac{\text{Flow, gallons/day}}{\text{Length of Weir, ft}}$$


Typical Design Value = ~10,000 gal/d/ft

Solids Loading

$$\text{SLR, lbs/d/ft}^2 = \frac{\text{Solids, lbs/day}}{\text{Surface Area, ft}^2}$$

Typical Design Value = 25 - 30 lbs/d/ft²

Clarifier Calculations



Prepared By
Michigan Department of Environmental Quality
Operator Training and Certification Unit